




# PROBLEM SUMMARY

Sample Rating Trend

VISCOSITY




Machine Id  
**PRESS 6 LOADER NON-FLAM**  
 Component  
**Hydraulic System**  
 Fluid  
**TEXACO HYDRAULIC SAFETY FLUID (--- GAL)**

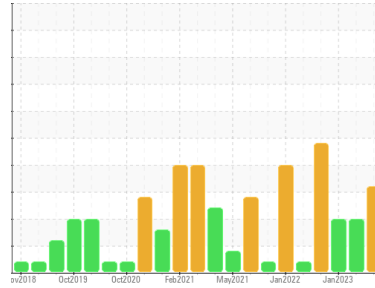


## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

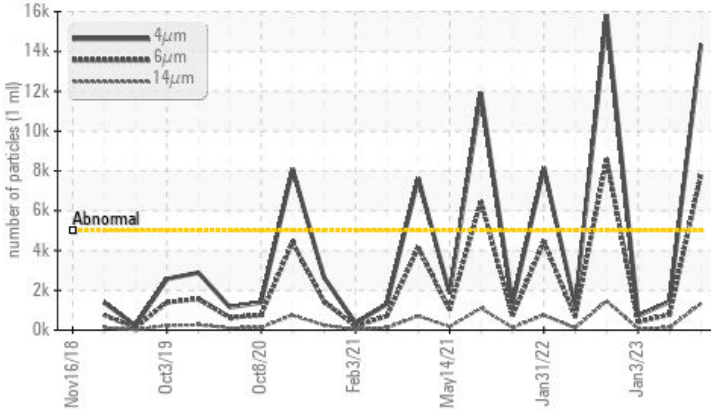

### ▲ Viscosity @ 40°C

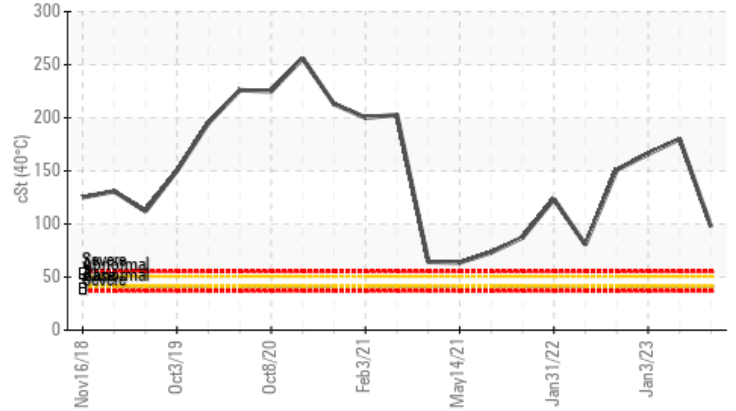

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>5000	▲ 14346	1442	720
Particles >6µm	ASTM D7647	>1300	▲ 7815	786	392
Particles >14µm	ASTM D7647	>160	▲ 1330	134	67
Particles >21µm	ASTM D7647	>40	▲ 448	45	22
Particles >38µm	ASTM D7647	>10	▲ 69	7	3
Particles >71µm	ASTM D7647	>3	▲ 7	1	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/20/18	18/17/14	17/16/13
Visc @ 40°C	cSt	ASTM D445 41	▲ 97.5	▲ 180	▲ 166

Customer Id: KAIRICVA  
 Sample No.: WC0782212  
 Lab Number: 06001036  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 24 Jan 2023 Diag: Jonathan Hester

#### WATER



We recommend an early resample to monitor this condition. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. Water value is low. The oil viscosity is higher than normal. The pH level of this fluid is within the acceptable limits. pH is 8.0.

[view report](#)



### 03 Jan 2023 Diag: Jonathan Hester

#### WATER



We recommend an early resample to monitor this condition. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. Water value is low. The oil viscosity is higher than normal. The pH level of this fluid is within the acceptable limits. pH is 10.0.

[view report](#)



### 26 Jul 2022 Diag: Jonathan Hester

#### WATER



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. Water is lower than normal. pH is 8.00. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

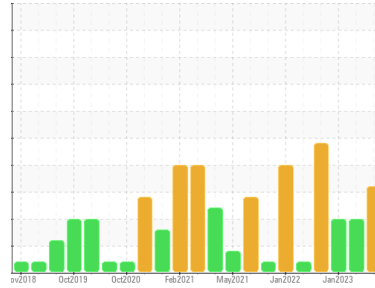

## VISCOSITY



### Machine Id **PRESS 6 LOADER NON-FLAM**

Component  
**Hydraulic System**

Fluid  
**TEXACO HYDRAULIC SAFETY FLUID (--- GAL)**

#### DIAGNOSIS

##### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### ▲ Contamination

There is a high amount of particulates present in the oil.

##### ▲ Fluid Condition

The oil viscosity is higher than normal. The pH level of this fluid is within the acceptable limits. pH is 10.0. The AN level is acceptable for this fluid.

#### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0782212</b>	WC0690889	WC0612600
Sample Date	Client Info		<b>03 Nov 2023</b>	24 Jan 2023	03 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

#### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	<1	1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	3
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

#### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>0</b>	1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	1	1
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	1	4
Phosphorus	ppm	ASTM D5185m	<b>10</b>	12	11
Zinc	ppm	ASTM D5185m	<b>12</b>	7	6
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	10

#### CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	3
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >45	<b>29.4</b>	▲ 13.4	▲ 19.4
ppm Water	ppm	ASTM D6304 >450000	<b>294000</b>	▲ 134000	▲ 194000

#### INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>1.2</b>	0.9	0.9
Nitration	Abs/cm	*ASTM D7624	<b>128.4</b>	89.5	86.6
Sulfation	Abs/.1mm	*ASTM D7415	<b>108.5</b>	122.1	97.6



# OIL ANALYSIS REPORT

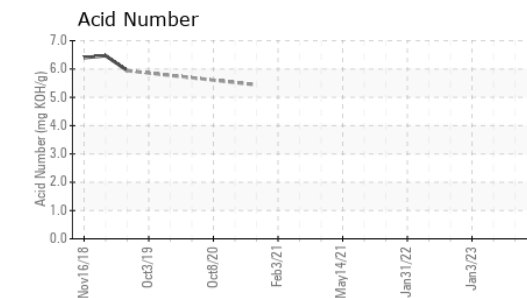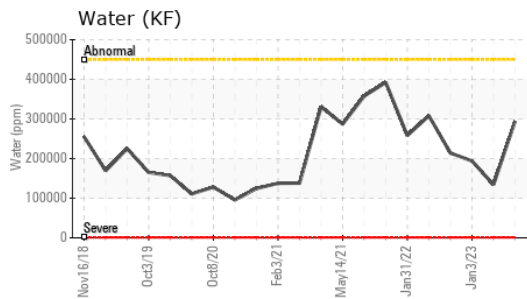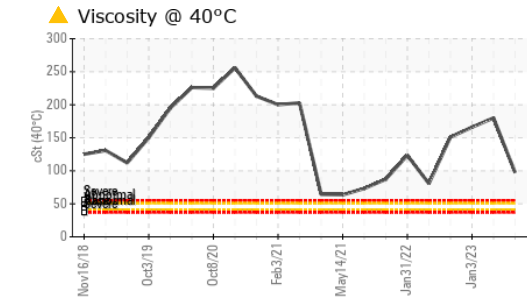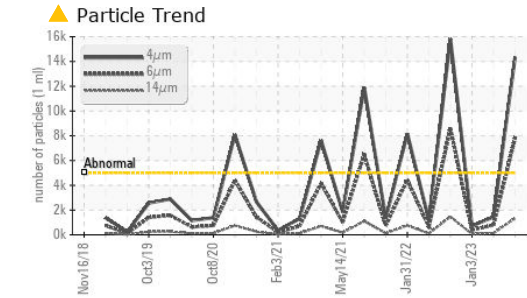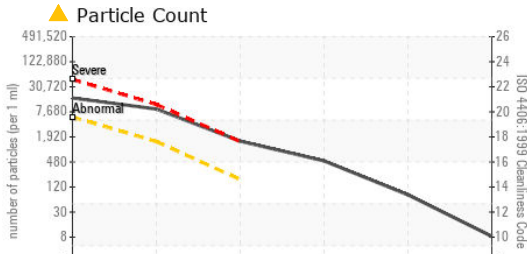

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 14346	1442	720
Particles >6µm	ASTM D7647	>1300	▲ 7815	786	392
Particles >14µm	ASTM D7647	>160	▲ 1330	134	67
Particles >21µm	ASTM D7647	>40	▲ 448	45	22
Particles >38µm	ASTM D7647	>10	▲ 69	7	3
Particles >71µm	ASTM D7647	>3	▲ 7	1	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/20/18	18/17/14	17/16/13

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm *ASTM D7414		106.6	60.1	59.6


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>45	0.2%	NEG	0.2%
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
pH	Scale 0-14 ASTM D1287		10	8.0	10.0
Visc @ 40°C	cSt ASTM D445	41	▲ 97.5	▲ 180	▲ 166

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

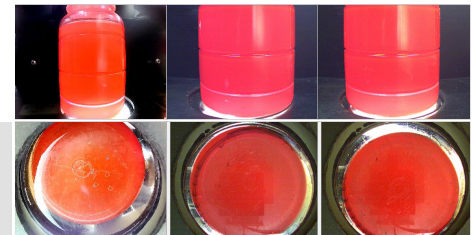

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0782212 **Received** : 07 Nov 2023  
**Lab Number** : 06001036 **Diagnosed** : 09 Nov 2023  
**Unique Number** : 10729396 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KF, pH )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**KAISER ALUMINUM**  
 1901 REYMET RD  
 NORTH CHESTERFIELD, VA  
 US 23237

Contact: Yong Quan  
 Yong.Quan@kaiseraluminum.com

T: (804)743-6485

F: