


## **PROBLEM SUMMARY**

# PRESS 2 NON-FLAM

Hydraulic System Fluid TEXACO HYDRAULIC SAFETY FLUID (--- QTS)

### COMPONENT CONDITION SUMMARY

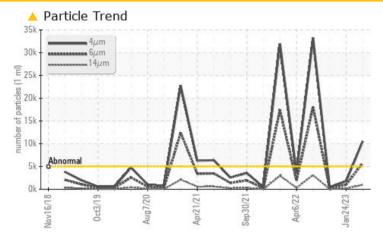

### RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

ov2018	Oct2019	Aug2020	Apr2021	Sep2021	Apr2022	Jan2023		

ISO

Sample Rating Trend

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ATTENTION	NORMAL			
Particles >4µm	ASTM D7647	>5000	<u> </u>	1810	439			
Particles >6µm	ASTM D7647	>1300	<b>6</b> 5739	986	239			
Particles >14µm	ASTM D7647	>160	<u> </u>	<b>1</b> 68	41			
Particles >21µm	ASTM D7647	>40	<u> </u>	<b>5</b> 7	14			
Particles >38µm	ASTM D7647	>10	<u> </u>	9	2			
Particles >71µm	ASTM D7647	>3	<u> </u>	1	0			
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<u> </u>	<b>1</b> 8/17/15	16/15/13			

Customer Id: KAIRICVA Sample No.: WC0782215 Lab Number: 06001037 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS								
Action	Status	Date	Done By	Description				
Change Filter			?	We recommend you service the filters on this component.				

### HISTORICAL DIAGNOSIS



24 Jan 2023 Diag: Jonathan Hester

No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The pH level of this fluid is within the acceptable limits. The condition of the oil is acceptable for the time in service. pH is 9.00.

### 03 Jan 2023 Diag: Jonathan Hester



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The pH level of this fluid is within the acceptable limits. pH 9.0. The condition of the oil is acceptable for the time in service.



#### 26 Jul 2022 Diag: Jonathan Hester

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. pH is 9.00. The pH level of this fluid is within the acceptable limits.





view report



### **OIL ANALYSIS REPORT**

# PRESS 2 NON-FLAM

Hydraulic System

TEXACO HYDRAULIC SAFETY FLUID (--- QTS)

### DIAGNOSIS

#### A Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil. pH is 9.00.

### Fluid Condition


The pH level of this fluid is within the acceptable limits.

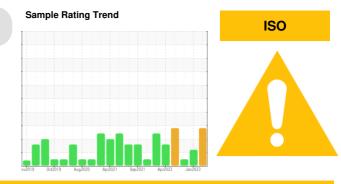


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0782215	WC0690883	WC0612598
Sample Date		Client Info		03 Nov 2023	24 Jan 2023	03 Jan 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	<1	<1
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	<1	4
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	<1	2	<1
Tin	ppm	ASTM D5185m	>20	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	1	<1
Calcium	ppm	ASTM D5185m		0	1	1
Phosphorus	ppm	ASTM D5185m		5	16	12
Zinc	ppm	ASTM D5185m		8	13	6
Sulfur	ppm	ASTM D5185m		0	8	19
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	<1
Sodium	ppm	ASTM D5185m		<1	0	2
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>45	44.2	41.2	46.9
ppm Water	ppm	ASTM D6304	>450000	442000	412000	469000
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		1.4	1.5	1.5
Nitration	Abs/cm	*ASTM D7624		143.5	137.9	131.3
Sulfation	Abs/.1mm	*ASTM D7415		102.9	99.9	93.0
					0010	00.0



## **OIL ANALYSIS REPORT**

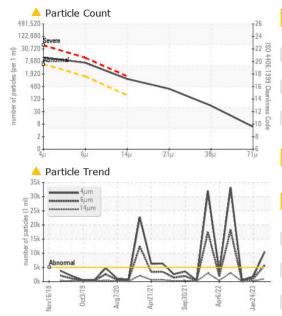




6.0

0.5.0 Number (mg KOH/g) 3.0 2.0

Acid P 0.0

> 75 70

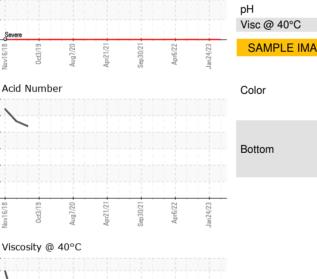

Laboratory

Sample No.

Lab Number

Unique Number

: WC0782215


Test Package : IND 2 (Additional Tests: FT-IR, KF, pH)

: 06001037

: 10729397

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.



Certificate L2367

FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>10535</b>	1810	439
Particles >6µm		ASTM D7647	>1300	<u> </u>	986	239
Particles >14µm		ASTM D7647	>160	<b>6</b> 977	<b>1</b> 68	41
Particles >21µm		ASTM D7647	>40	<mark>人</mark> 329	<b>▲</b> 57	14
Particles >38µm		ASTM D7647	>10	<b>6</b> 51	9	2
Particles >71µm		ASTM D7647	>3	<u> </u>	1	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>4</b> 21/20/17	🔺 18/17/15	16/15/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		135.3	132.8	125.5
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Scalai	visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Debris Sand/Dirt			_			
	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar scalar	*Visual *Visual	NONE	NONE	NONE	NONE

Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
рН	Scale 0-14	ASTM D1287		10.0	9.00	9.00
Visc @ 40°C	cSt	ASTM D445	41	56.5	46.9	47.9
SAMPLE IMAGES	method	limit/base	current	history1	history2	

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: 07 Nov 2023

: 09 Nov 2023

Received

Diagnosed



1901 REYMET RD NORTH CHESTERFIELD, VA Diagnostician : Jonathan Hester US 23237 Contact: Yong Quan Yong.Quan@kaiseraluminum.com T: (804)743-6485 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Submitted By: Yong Quan Page 4 of 4

**KAISER ALUMINUM**