


PROBLEM SUMMARY

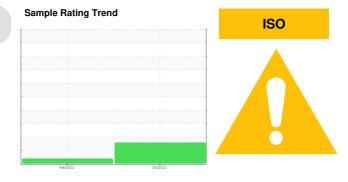

Machine Id **4952083 (S/N 1134)** Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY



RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647 >1300	<u> </u>					
Particles >14µm	ASTM D7647 >80	🔺 257					
Particles >21µm	ASTM D7647 >20	<u> </u>					
Oil Cleanliness	ISO 4406 (c) >/17/	13 🔺 21/19/15					

Customer Id: RHCALB Sample No.: KCPA007722 Lab Number: 06001040 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

24 Feb 2023 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id 4952083 (S/N 1134) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Feb 2023	0ct2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007722	KCP46218	
Sample Date		Client Info		23 Oct 2023	24 Feb 2023	
Machine Age	hrs	Client Info		50861	48064	
Oil Age	hrs	Client Info		0	6400	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
_ead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	5	14	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	6	<1	
Volybdenum	ppm	ASTM D5185m		0	0	
Vanganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	23	5	
Calcium	ppm	ASTM D5185m	2	<1	0	
Phosphorus	ppm	ASTM D5185m		6	0	
Zinc	ppm	ASTM D5185m		97	56	
Sulfur	ppm	ASTM D5185m		17261	18891	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		9	2	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
Water	%	ASTM D6304	>0.05	0.021	0.008	
opm Water	ppm	ASTM D6304	>500	218.1	85.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10557		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	🔺 257		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 21/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.32	

Contact/Location: Service Manager - RHCALB



12000

10000

8000

6000 Water 4000

2000

(B).40 HOX Ê0.30 Ê 0.20

P 0.10 0.00

12000

10000

800 6000 Water (

4000 2000

(J-46 44 (40-0) Bas

Built for a lifetime."

OIL ANALYSIS REPORT

12k -	Particle Trend	VISUAL		method	limit/b	base
10k •	4μm 6μm	White Metal	scalar	*Visual	NONE	
g 8k•		Yellow Metal	scalar	*Visual	NONE	
6k-		Precipitate	scalar	*Visual	NONE	
5 g 4k -		Silt	scalar	*Visual	NONE	
2k ·		Debris	scalar	*Visual	NONE	
0k -		Sand/Dirt	scalar	*Visual	NONE	
	Feb 24/23 0 ct23/23	Appearance	scalar	*Visual	NORM	1L
	Feb.	Odor	scalar	*Visual	NORM	1L
-	Water (KF)	Emulsified Water	scalar	*Visual	>0.05	
2000-	·····	Free Water	scalar	*Visual		
0000-	Severe	FLUID PROPERT	TIES	method	limit/b	hase
8000-	1					Jaco
6000-		Visc @ 40°C	cSt	ASTM D445	46	
4000-		SAMPLE IMAGE	S	method	limit/b	base
2000-	Aboomal					
0-	Anomal	Oslar				
	Feb 24/23 0 ct23/23	Color				
	ž 0					
	Acid Number					
0.50-	-	Bottom				
0.40	Base					
0.30-						
0.20-		GRAPHS				
0.10-		Ferrous Alloys				491,52
		8- iron				101,02
0.00-	- 123	and a second sec				122,88
	Feb 24/23	4				30,72
		2				7.00
2000-	Water (KF)	04			23 -	7,68
0000-	Severe	Feb 24/23			0ct23/23 number of particles (per 1 ml)	1,92
8000-		™ Non-ferrous Metal	c		ticles	48
6000-					of par	
4000-		copper	_		mber	12
2000-		10 tin			2	3
0-		5			_	
	Feb24/23	0				
	-B-	4/23			3/23	
	Viscosity @ 40°C	Feb24/23			0ct23/23	
52-	Abnormal	Viscosity @ 40°C				
50-		55				0.5
48 ·	Base	50 - Abnormal				HO 0.4
() 46 - (40 - 53 44 -		5 45 - Base 3 Abnormal				٤.0 الق
42.		40 - Abnormal		******	-	Punn of the second seco
40-	Abnormal	35				40.0 40.0
38-	m				3/23 -	U.U
	Feb.24/23	Feb24/23			0ct23/23	
	<u>گ</u>					



history1

NONE

NONE NONE

NONE

MODER

NONE

NORML

NORML

history1

NEG

NEG

44.1

history2

history2

0SI

1999 Cle

0ct23/23

4406

current

NONE NONE

NONE NONE

LIGHT

NONE

NORML


NORML

current

NEG

NEG

44.3

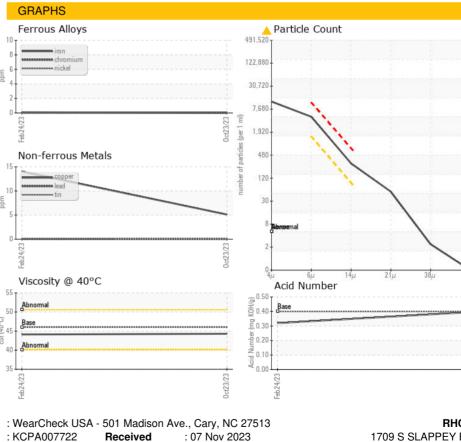

: 09 Nov 2023

Diagnostician : Don Baldridge

RHC INC 1709 S SLAPPEY BLVD ALBANY, GA US 31701 Contact: Service Manager rodm@randyhenrycontracting.com Т: F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Laboratory

Sample No.

Lab Number

Unique Number

: 06001040

: 10729400

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Diagnosed