


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER ASD 40S 4547129 (S/N 1104)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2017 N	lov2018 Jan2019 Sep20	20 Jun2021 Feb2022 Oct2022	Oct2023	
SAMPLE INFORM	//ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007710	KCP46777D	KCP40911
Sample Date		Client Info		13 Oct 2023	10 Oct 2022	10 Feb 2022
Machine Age	hrs	Client Info		21859	19745	17600
Oil Age	hrs	Client Info		0	0	3710
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	1	0
Aluminum	ppm	ASTM D5185m	>10	0	1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	3	6
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		0	1	0
Magnesium	ppm	ASTM D5185m	100	39	40	33
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	2	6
Zinc	ppm	ASTM D5185m	0	19	16	45
Sulfur	ppm	ASTM D5185m	23500	19585	22828	17659
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	3	1
Sodium	ppm	ASTM D5185m		12	18	13
Potassium	ppm	ASTM D5185m	>20	2	3	0
Water	%	ASTM D6304	>0.05	0.017	0.011	0.007
ppm Water	ppm	ASTM D6304	>500	170.0	118.2	71.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3122	139579	2793
Particles >6µm		ASTM D7647	>1300	1046	<u>▲</u> 47197	807
Particles >14μm		ASTM D7647	>80	70	<u>1220</u>	51
Particles >21µm		ASTM D7647	>20	14	<u>^</u> 76	8
Particles >38μm		ASTM D7647	>4	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	<u>4</u> 24/23/17	17/13
FLUID DEGRADA						

0.36



OIL ANALYSIS REPORT

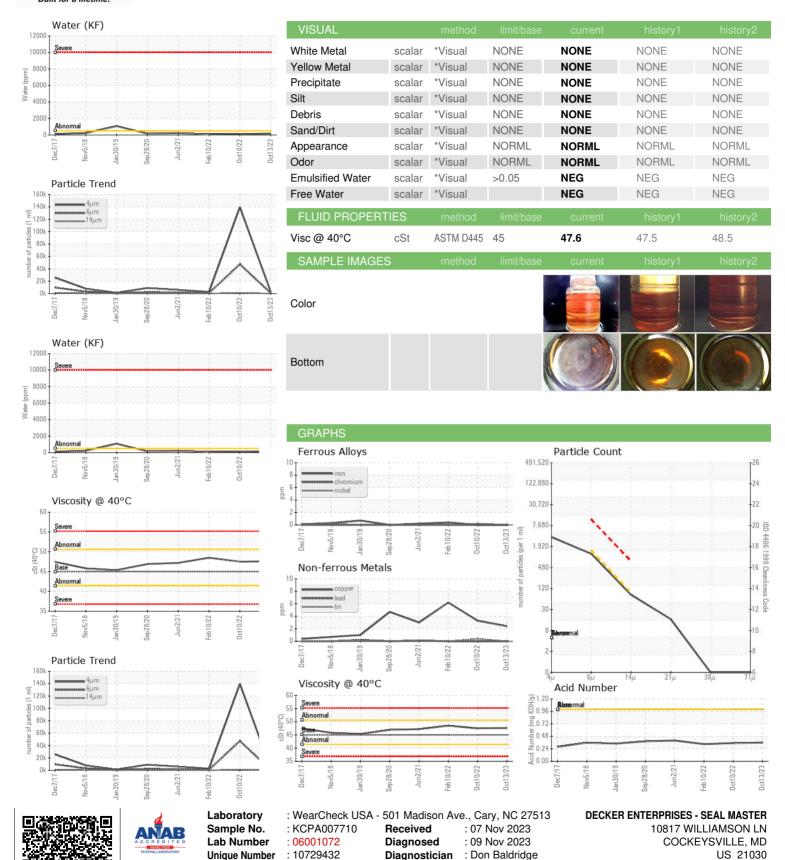


Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.



Certificate L2367

Contact/Location: R. BERG - DECCOC

RBERG@SEALMASTERDELMERCA.COM

T:

F:

Contact: R. BERG