



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER BSD 50 2445797 (S/N 1181)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

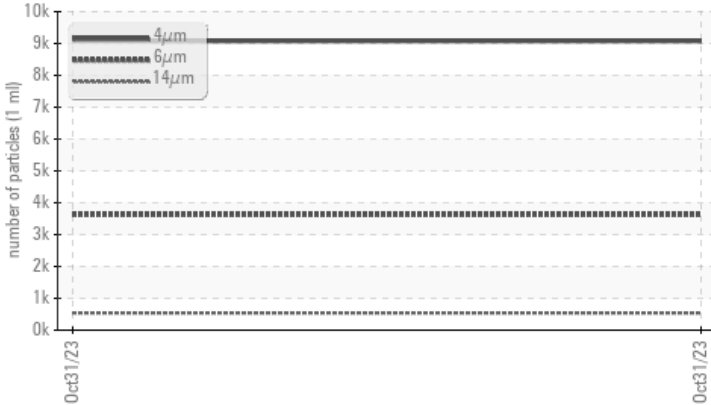

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 3627	---	---	---
Particles >14µm	ASTM D7647	>80	▲ 538	---	---	---
Particles >21µm	ASTM D7647	>20	▲ 173	---	---	---
Particles >38µm	ASTM D7647	>4	▲ 6	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/16	---	---	---

Customer Id: MAYBEL
 Sample No.: KCPA009365
 Lab Number: 06001074
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

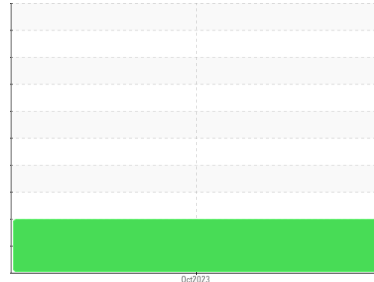

Machine Id
KAESER BSD 50 2445797 (S/N 1181)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA009365	---	---
Sample Date	Client Info	31 Oct 2023	---	---
Machine Age	hrs Client Info	41018	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	0	---	---
Chromium ppm	ASTM D5185m >10	0	---	---
Nickel ppm	ASTM D5185m >3	0	---	---
Titanium ppm	ASTM D5185m >3	0	---	---
Silver ppm	ASTM D5185m >2	0	---	---
Aluminum ppm	ASTM D5185m >10	0	---	---
Lead ppm	ASTM D5185m >10	0	---	---
Copper ppm	ASTM D5185m >50	8	---	---
Tin ppm	ASTM D5185m >10	0	---	---
Vanadium ppm	ASTM D5185m	0	---	---
Cadmium ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	---	---
Barium ppm	ASTM D5185m 90	0	---	---
Molybdenum ppm	ASTM D5185m	0	---	---
Manganese ppm	ASTM D5185m	0	---	---
Magnesium ppm	ASTM D5185m 90	6	---	---
Calcium ppm	ASTM D5185m 2	0	---	---
Phosphorus ppm	ASTM D5185m	0	---	---
Zinc ppm	ASTM D5185m	24	---	---
Sulfur ppm	ASTM D5185m	16943	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	2	---	---
Sodium ppm	ASTM D5185m	4	---	---
Potassium ppm	ASTM D5185m >20	0	---	---
Water %	ASTM D6304 >0.05	0.007	---	---
ppm Water ppm	ASTM D6304 >500	78.8	---	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	9079	---	---
Particles >6µm	ASTM D7647 >1300	▲ 3627	---	---
Particles >14µm	ASTM D7647 >80	▲ 538	---	---
Particles >21µm	ASTM D7647 >20	▲ 173	---	---
Particles >38µm	ASTM D7647 >4	▲ 6	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/19/16	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 0.4	0.39	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

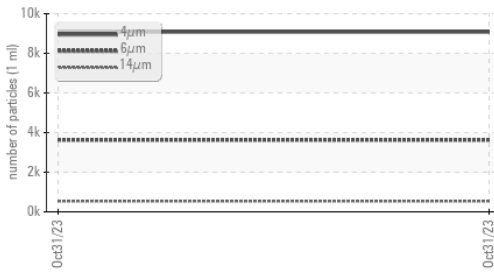


Water (KF)




Acid Number

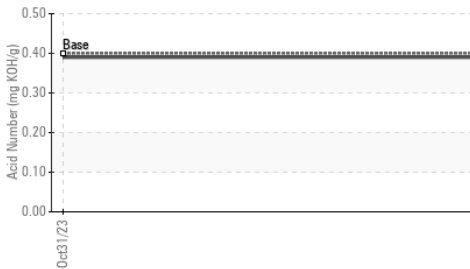

Water (KF)

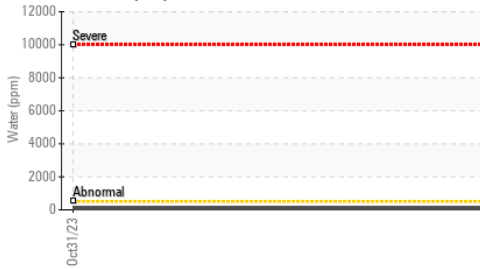

Viscosity @ 40°C

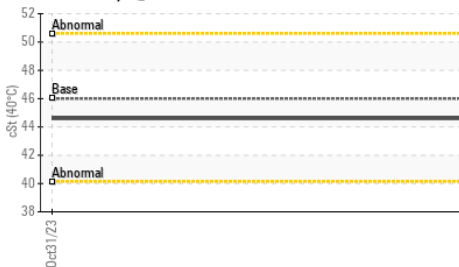

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

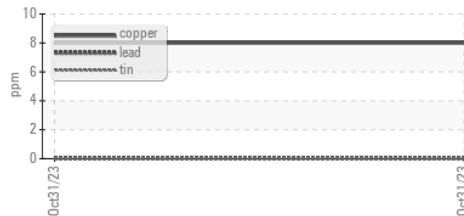

Viscosity @ 40°C

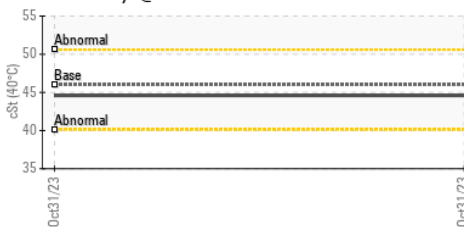

▲ Particle Count

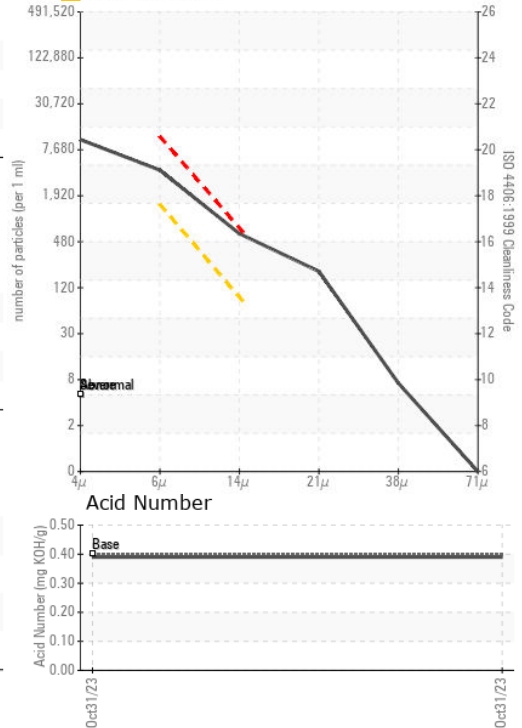

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009365 **Received** : 07 Nov 2023
Lab Number : 06001074 **Diagnosed** : 09 Nov 2023
Unique Number : 10729434 **Diagnostician** : Don Baldrige

MAYFLOWER HEALTHCARE TEXTILE SVC
 1350 BRASS MILL RD
 BELCAMP, MD
 US 21017
 Contact: J. COUNTS
 JCOUNTS@MAYFLOWERLAUNDRIES.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: