




OIL ANALYSIS REPORT

Sample Rating Trend

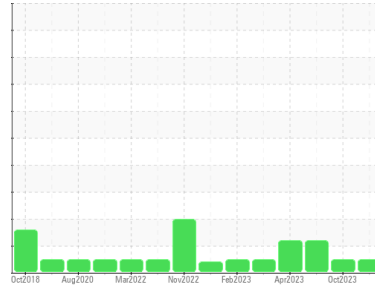

NORMAL



Area
GUAY SON [CONHER]
 Machine Id
PERKINS IBACO COZAR VII AUX-1
 Component
Diesel Engine
 Fluid
XTRA REV 15W40 (8 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0013355	KL0013313	KL0012870
Sample Date	Client Info		01 Nov 2023	17 Oct 2023	20 Sep 2023
Machine Age	hrs	Client Info	0	20291	19791
Oil Age	hrs	Client Info	20	200	5
Oil Changed	Client Info		Not Changed	Not Changed	Changed
Sample Status			NORMAL	NORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>250	65	48	12
Chromium	ppm	ASTM D5185m	>10	1	1	<1
Nickel	ppm	ASTM D5185m	>5	<1	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>35	3	3	4
Lead	ppm	ASTM D5185m	>100	<1	<1	0
Copper	ppm	ASTM D5185m	>60	4	2	<1
Tin	ppm	ASTM D5185m	>5	<1	<1	1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	<1	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		8	8	5
Calcium	ppm	ASTM D5185m		2961	2791	2647
Phosphorus	ppm	ASTM D5185m		1094	1078	1134
Zinc	ppm	ASTM D5185m		1495	1586	1404
Sulfur	ppm	ASTM D5185m		3168	3282	3853

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>35	12	12	9
Sodium	ppm	ASTM D5185m		3	1	<1
Potassium	ppm	ASTM D5185m	>20	4	4	3


INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>3	0.3	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	11.4	9.2	4.7
Sulfation	Abs./1mm	*ASTM D7415	>30	20.6	17.4	12.8




OIL ANALYSIS REPORT


Particle Trend

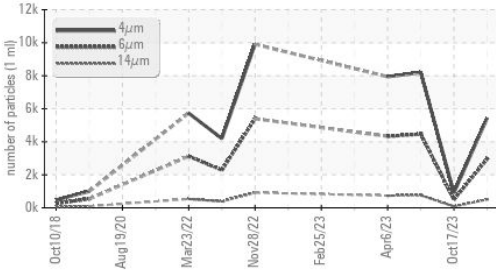


Base Number

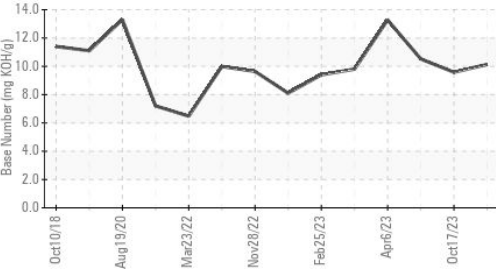

Viscosity @ 100°C

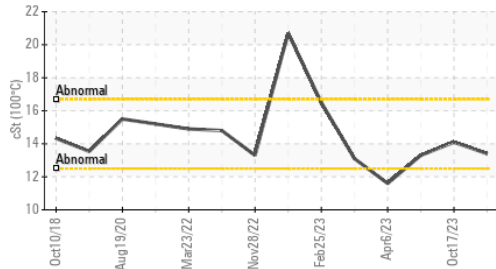

Particle Trend

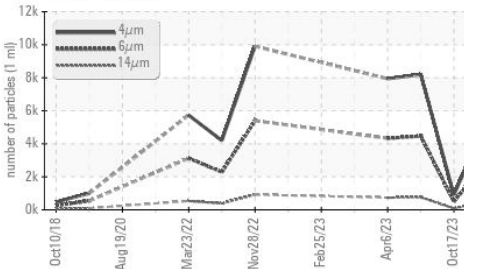

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5429	913	8195
Particles >6µm	ASTM D7647	>5000	2957	498	4464
Particles >14µm	ASTM D7647	>640	503	85	▲ 760
Particles >21µm	ASTM D7647	>160	170	29	▲ 256
Particles >38µm	ASTM D7647	>40	26	4	40
Particles >71µm	ASTM D7647	>10	3	0	4
Oil Cleanliness	ISO 4406 (c)	>19/16	19/16	16/14	▲ 19/17


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	*ASTM D7414	>25	18.1	13.5	6.9
Base Number (BN)	mg KOH/g	ASTM D2896		10.13	9.58	10.52

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445		13.4	14.1	13.3

GRAPHS


Ferrous Alloys

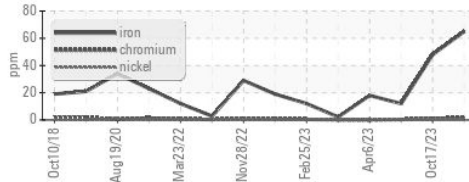


Non-ferrous Metals

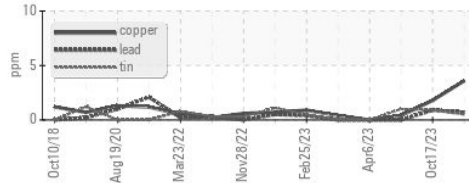


Viscosity @ 100°C

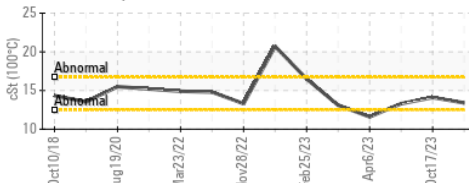

Particle Count

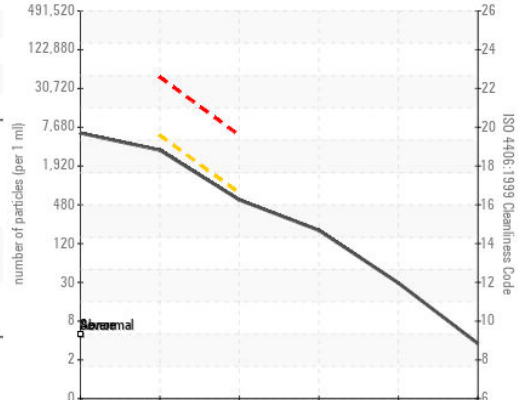

Base Number

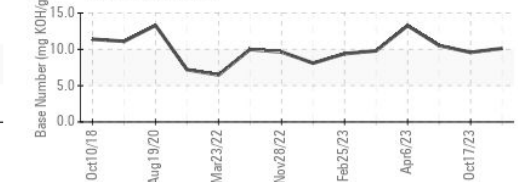

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0013355 **Received** : 07 Nov 2023
Lab Number : 06001125 **Diagnosed** : 09 Nov 2023
Unique Number : 10729485 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CONOR
 JUAREZ 348
 HERMOSILLO,
 MX 83140

Contact: EDUARDO GARCIA
 egarcia.comsa@gmail.com

T: (526)622-1581 x:81

F: x: