



# PROBLEM SUMMARY

Sample Rating Trend



ISO




Machine Id  
**46637**

Component  
**Hydraulic System**

Fluid  
**SAFETY-KLEEN PERFORMANCE PLUS HYD. AW32 (175 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

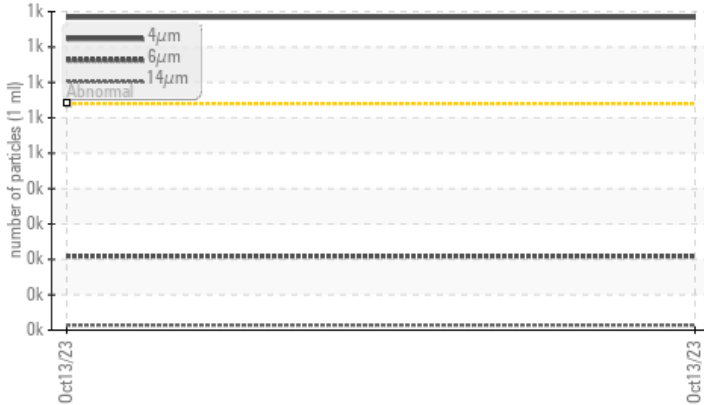


## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>640	▲ <b>884</b>	---	---
Particles >6µm	ASTM D7647	>40	▲ <b>209</b>	---	---
Particles >14µm	ASTM D7647	>10	▲ <b>14</b>	---	---
Particles >21µm	ASTM D7647	>3	▲ <b>3</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>16/12/10	▲ <b>17/15/11</b>	---	---

PrtFilter



Customer Id: BSHJACTN  
Sample No.: PH0002342  
Lab Number: 06001585  
Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

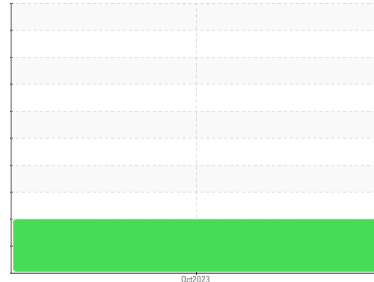

ISO



Machine Id  
**46637**

Component  
**Hydraulic System**

Fluid  
**SAFETY-KLEEN PERFORMANCE PLUS HYD. AW32 (175 GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PH0002342</b>	---	---
Sample Date	Client Info		<b>13 Oct 2023</b>	---	---
Machine Age	yrs	Client Info	<b>2</b>	---	---
Oil Age	yrs	Client Info	<b>2</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 11	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0.0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 1.2	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0.0	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m 35	<b>50</b>	---	---
Phosphorus	ppm	ASTM D5185m 324	<b>330</b>	---	---
Zinc	ppm	ASTM D5185m 400	<b>450</b>	---	---
Sulfur	ppm	ASTM D5185m 1528	<b>831</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	---	---


## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>640	<b>▲ 884</b>	---	---
Particles >6µm	ASTM D7647	>40	<b>▲ 209</b>	---	---
Particles >14µm	ASTM D7647	>10	<b>▲ 14</b>	---	---
Particles >21µm	ASTM D7647	>3	<b>▲ 3</b>	---	---
Particles >38µm	ASTM D7647	>3	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>16/12/10	<b>▲ 17/15/11</b>	---	---

## FLUID DEGRADATION





	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.34</b>	---	---

Particle Filter (Magn: 200 x)

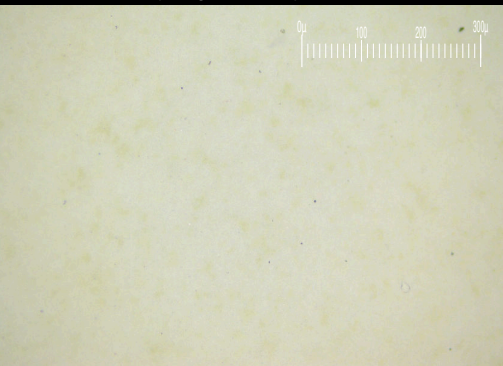



# OIL ANALYSIS REPORT

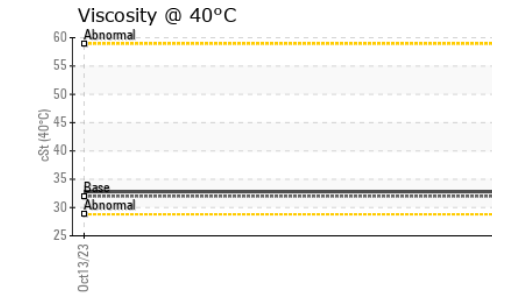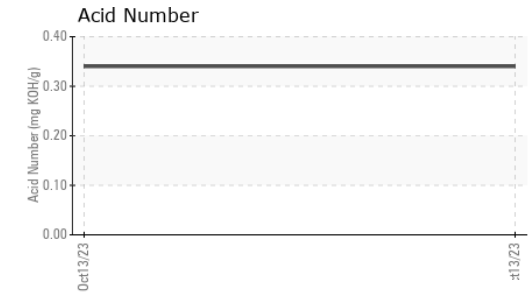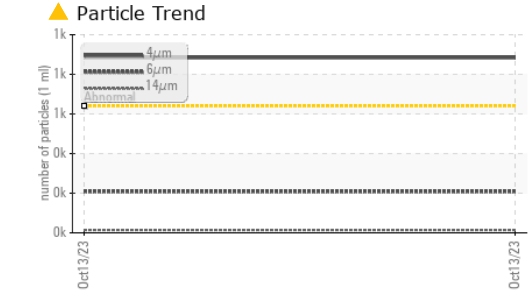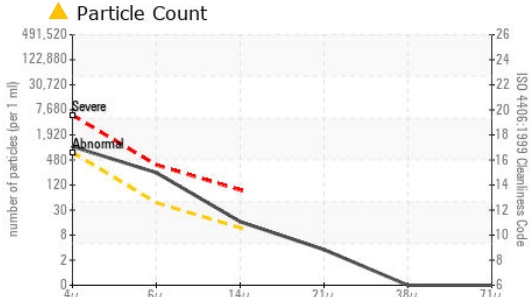

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH0002342      **Received** : 08 Nov 2023  
**Lab Number** : 06001585      **Diagnosed** : 21 Nov 2023  
**Unique Number** : 10729945      **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: PrtFilter )

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32.0	32.8	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image
PrtFilter				no image	no image

## GRAPHS

