



PROBLEM SUMMARY


Sample Rating Trend



Machine Id
KAESER 7120550
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

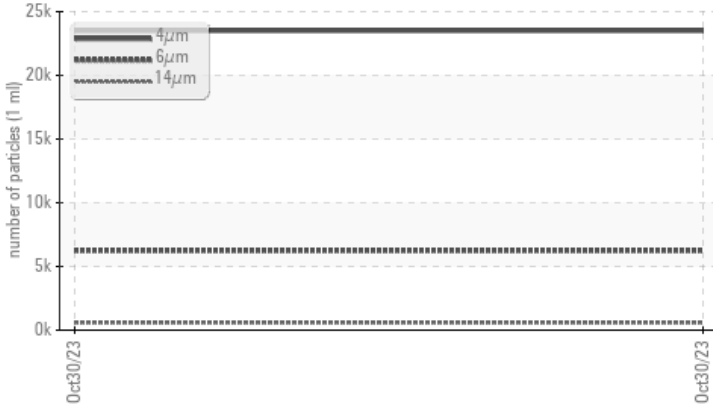

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 6242	---	---	---
Particles >14µm	ASTM D7647	>80	▲ 578	---	---	---
Particles >21µm	ASTM D7647	>20	▲ 164	---	---	---
Particles >38µm	ASTM D7647	>4	▲ 6	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	---	---	---

Customer Id: POMDEN
 Sample No.: KCPA003510
 Lab Number: 06001594
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

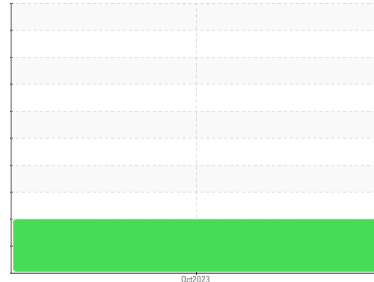

ISO



Machine Id
KAESER 7120550

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA003510	---	---
Sample Date	Client Info		30 Oct 2023	---	---
Machine Age	hrs	Client Info	21965	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	<1	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	2	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	4	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---	---
Barium	ppm	ASTM D5185m 90	<1	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 100	3	---	---
Calcium	ppm	ASTM D5185m 0	5	---	---
Phosphorus	ppm	ASTM D5185m 0	0	---	---
Zinc	ppm	ASTM D5185m 0	0	---	---
Sulfur	ppm	ASTM D5185m 23500	21154	---	---


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304 >0.05	0.011	---	---
ppm Water	ppm	ASTM D6304 >500	111.3	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		23498	---	---
Particles >6µm	ASTM D7647	>1300	▲ 6242	---	---
Particles >14µm	ASTM D7647	>80	▲ 578	---	---
Particles >21µm	ASTM D7647	>20	▲ 164	---	---
Particles >38µm	ASTM D7647	>4	▲ 6	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.48	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

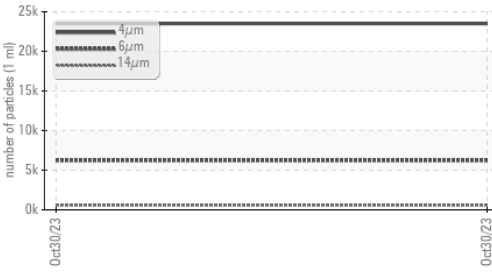


Water (KF)

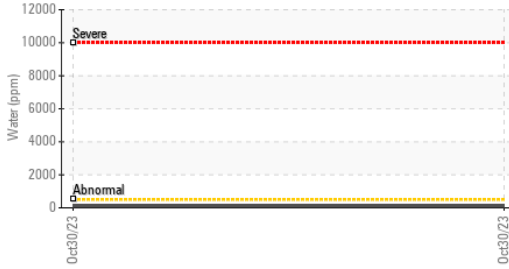

Acid Number

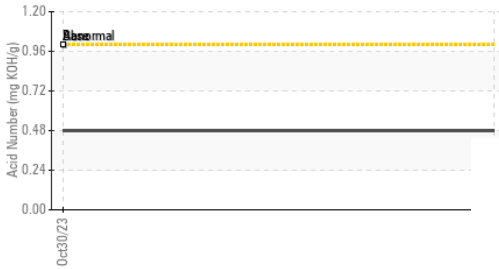

Water (KF)

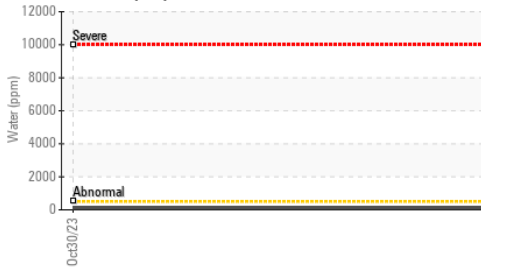

Viscosity @ 40°C



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color



no image

no image

Bottom




no image


no image

GRAPHS

Ferrous Alloys

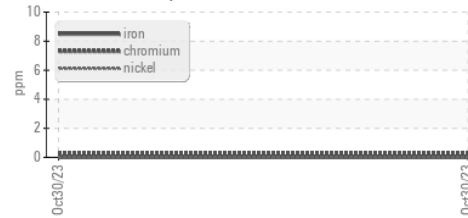


Non-ferrous Metals

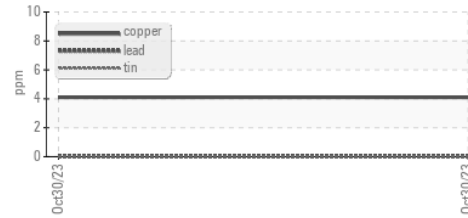

Viscosity @ 40°C



▲ Particle Count

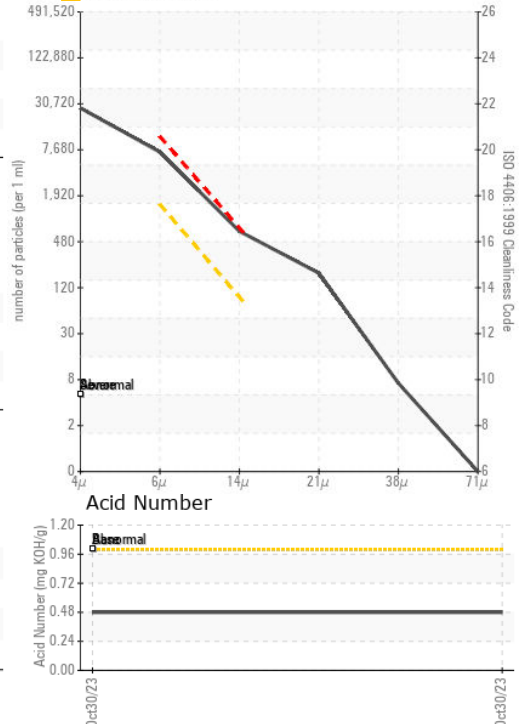

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA003510 **Received** : 08 Nov 2023
Lab Number : 06001594 **Diagnosed** : 10 Nov 2023
Unique Number : 10729954 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

POMPS TIRES
 4500 E 51ST AVE
 DENVER, CO
 US 80216
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: