

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

Machine Id KAESER SK 20 7443422 (S/N 1492)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	1711011		IIIIIIIIIII		•	· ·
Sample Number		Client Info		KC108968		
Sample Date	lawa	Client Info		24 Oct 2023		
Machine Age	hrs	Client Info		13793		
Oil Age	hrs	Client Info		O Changed		
Oil Changed Sample Status		Cilent inio		Changed NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	2		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		7		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.011		
ppm Water	ppm	ASTM D6304	>500	115.1		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3500		
Particles >6µm		ASTM D7647	>1300	828		
Particles >14µm		ASTM D7647	>80	62		
Particles >21µm		ASTM D7647	>20	23		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
	1/011/	4 OTH 4 DOG 45			<u> </u>	


0.30


Acid Number (AN)

mg KOH/g ASTM D8045 0.4



OIL ANALYSIS REPORT

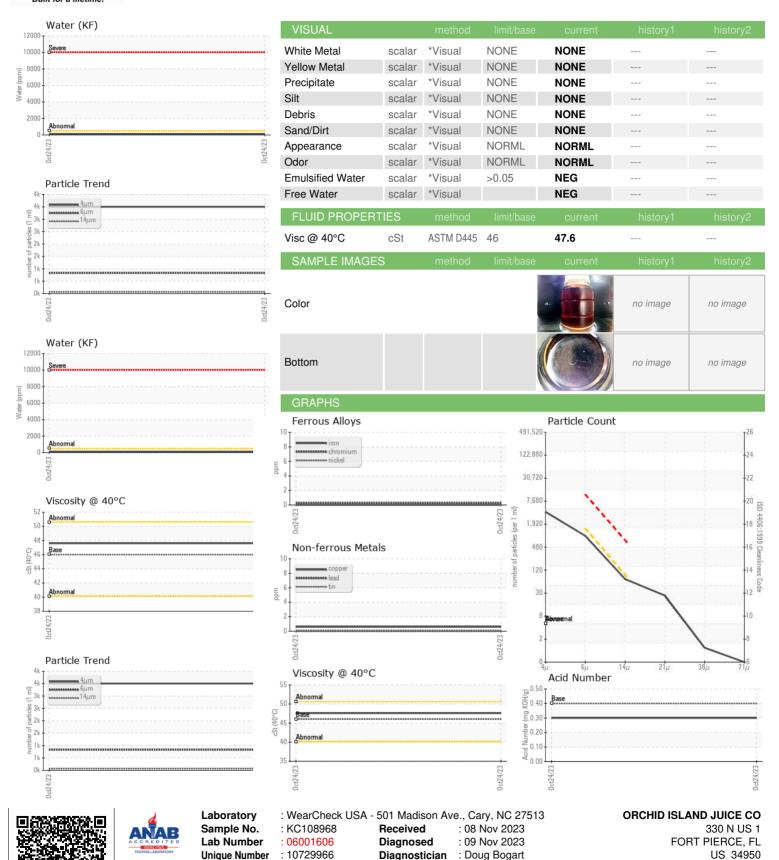



Certificate L2367

Test Package

: IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact:

T:

F: