




OIL ANALYSIS REPORT

Sample Rating Trend

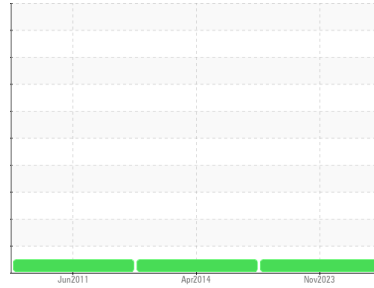

NORMAL



Machine Id
GN 0701 GN 0701

Component
Turbine
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | HLC0002623 | BPH1500578 | BPI2009336 |
| Sample Date | Client Info | | | 04 Nov 2023 | 01 Apr 2014 | 07 Jun 2011 |
| Machine Age | mths | Client Info | | 0 | 0 | 0 |
| Oil Age | mths | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >4 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Copper | ppm | ASTM D5185m | >5 | 0 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >5 | <1 | 0 | 3 |
| Antimony | ppm | ASTM D5185m | | --- | 0 | 2 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | <1 |





| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 2 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | | 47 | 46 | 49 |
| Phosphorus | ppm | ASTM D5185m | | 322 | 356 | 350 |
| Zinc | ppm | ASTM D5185m | | 413 | 447 | 419 |
| Sulfur | ppm | ASTM D5185m | | 763 | 785 | 756 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >15 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >2500 | 94 | 619 | 44 |
| Particles >6µm | | ASTM D7647 | >640 | 32 | 337 | 24 |
| Particles >14µm | | ASTM D7647 | >80 | 3 | 57 | 4 |
| Particles >21µm | | ASTM D7647 | >20 | 1 | 19 | 1 |
| Particles >38µm | | ASTM D7647 | >4 | 0 | 2 | 0 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >18/16/13 | 14/12/9 | 16/16/13 | 13/12/9 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.26 | 0.581 | 0.618 |

OIL ANALYSIS REPORT

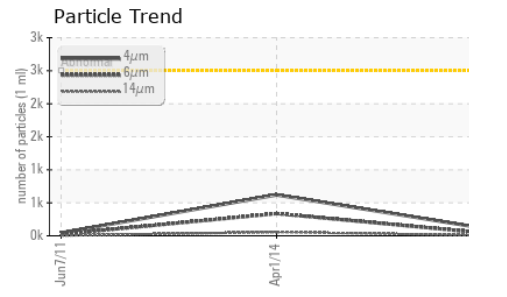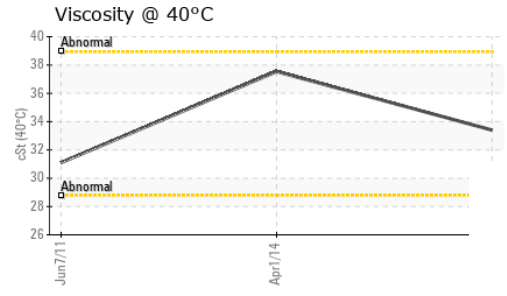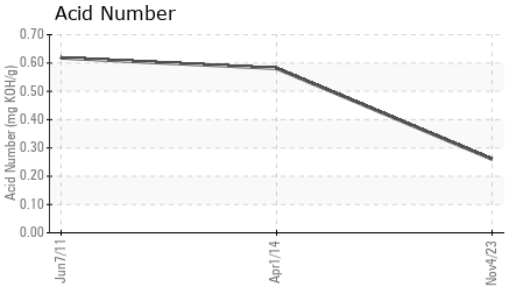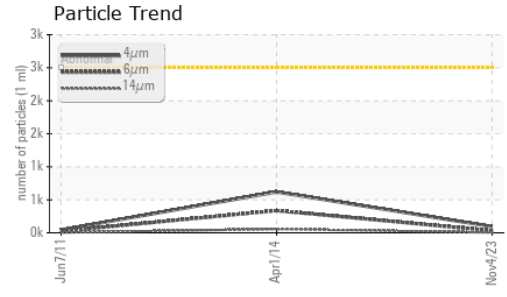

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | LIGHT |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.03 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |







| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 33.4 | 37.54 | 31.1 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color

| | | |
|--------|----------|----------|
| | no image | no image |
| Bottom | | no image |

GRAPHS

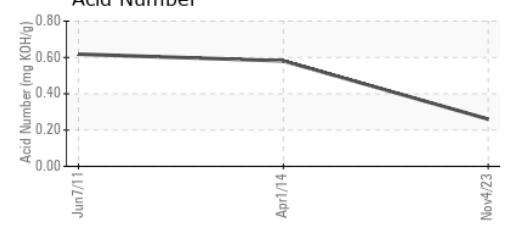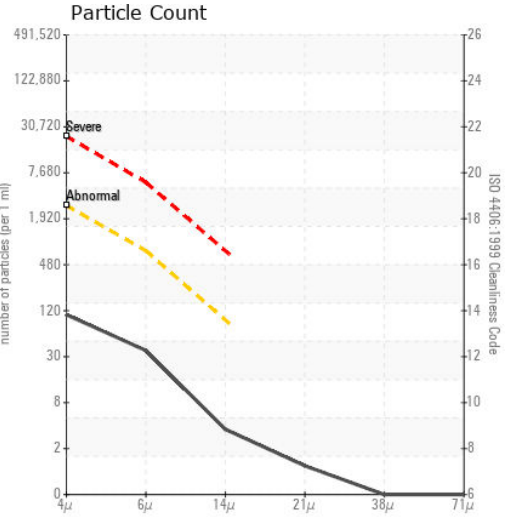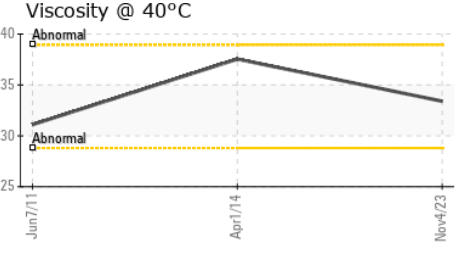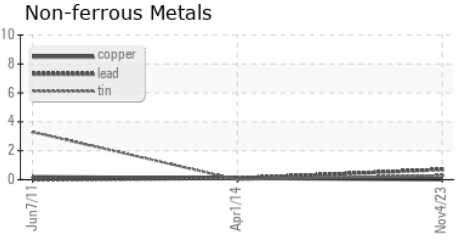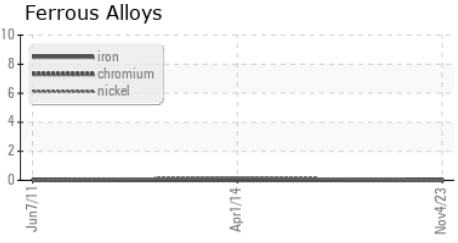

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HLC0002623 **Received** : 13 Nov 2023
Lab Number : 06006313 **Diagnosed** : 14 Nov 2023
Unique Number : 10740075 **Diagnostician** : Doug Bogart
Test Package : IND 2

HILCORP EXPLORATION ALASKA - MILNE POINT
 1000 MILNE POINT RD
 PRUDOE BAY, AK
 US 99734
 Contact: Evan Reilly
 evan.reilly@hilcorp.com
 T: (907)670-3231
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)