


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id KAESER SFC 22T 6768759 (S/N 1013)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Ju2019 Jan2020 Ju2020 Jan2021 Jun2021 Ton2021 Miny2022 Nov2022 Apr2023 Oce2023						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC82558	KC82555	KC102627
Sample Date		Client Info		30 Oct 2023	18 Apr 2023	04 Nov 2022
Machine Age	hrs	Client Info		29500	26567	23618
Oil Age	hrs	Client Info		2933	5933	2984
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	1	3	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	53	48	63
Calcium	ppm	ASTM D5185m	2	1	0	<1
Phosphorus	ppm	ASTM D5185m		1	3	2
Zinc	ppm	ASTM D5185m		0	7	8
CONTAMINANTS	}	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		17	13	21
Potassium	ppm	ASTM D5185m	>20	2	2	3
Water	%	ASTM D6304	>0.05	0.018	0.019	0.023
ppm Water	ppm	ASTM D6304	>500	184.8	197.2	230.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1501	1908	962
Particles >6µm		ASTM D7647	>1300	413	246	153
Particles >14µm		ASTM D7647	>80	41	6	10
Particles >21µm		ASTM D7647	>20	14	2	3
Particles >38µm		ASTM D7647	>4	2	0	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	18/15/10	17/14/10
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.39	0.36



OIL ANALYSIS REPORT

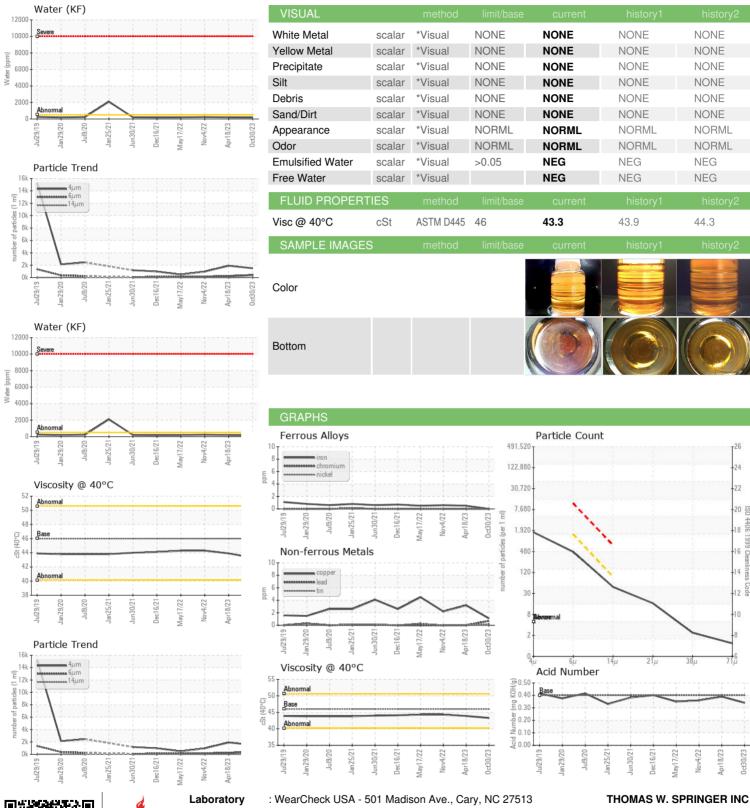





Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC82558 : 06006323

: IND 2

: 10740085

: 13 Nov 2023 Received Diagnosed

: 14 Nov 2023 Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

227 BUTTONWOOD RD

LANDENBERG, PA US 19350

Contact: DAVID BROOMELL

daveb@twspringer.com

T: F: