




PROBLEM SUMMARY

Sample Rating Trend

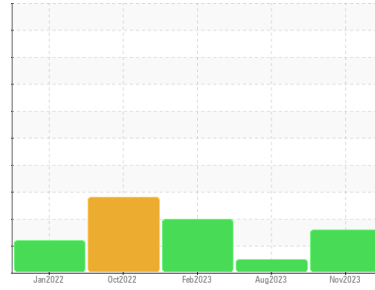

ISO




Machine Id
R 45N (S/N N52157U19103)

Component
Air Compressor

Fluid
USPI COMP CLEAN II (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

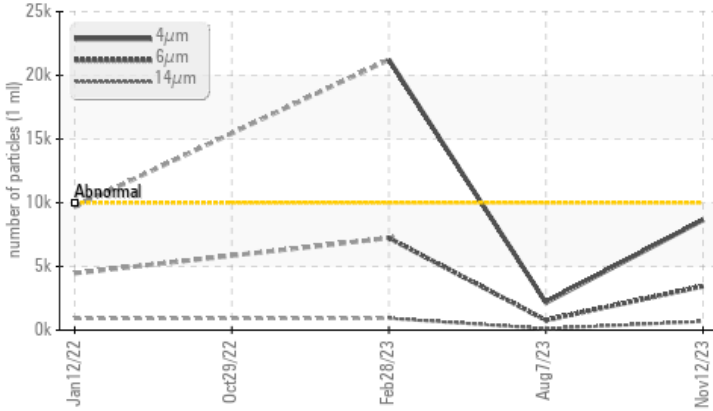

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>2500	▲ 3445	779	▲ 7233
Particles >14µm	ASTM D7647	>320	▲ 683	115	▲ 926
Particles >21µm	ASTM D7647	>80	▲ 257	23	▲ 185
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 20/19/17	18/17/14	▲ 22/20/17

Customer Id: CARNEWMIN
Sample No.: USPM27608
Lab Number: 06006363
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

07 Aug 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Feb 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



29 Oct 2022 Diag: Doug Bogart

VISUAL METAL



We recommend you service the filters on this component. We advise that you inspect for the source(s) of metal. We were unable to perform a particle count due to metal particles present in this sample. Moderate concentration of visible metal present. All component wear rates are normal. No other contaminants were detected in the oil. The oil viscosity is higher than normal. An increase in the AN level is noted. Confirmed.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

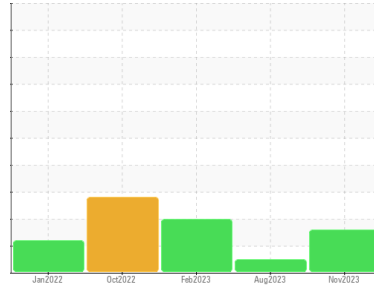

ISO



Machine Id
R 45N (S/N N52157U19103)

Component
Air Compressor

Fluid
USPI COMP CLEAN II (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM27608	USPM27607	USPM11601
Sample Date	Client Info		12 Nov 2023	07 Aug 2023	28 Feb 2023
Machine Age	hrs	Client Info	29952	22202	19715
Oil Age	hrs	Client Info	0	602	1100
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >4	0	0	<1
Nickel	ppm	ASTM D5185m >4	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	<1	<1
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >20	0	<1	0
Copper	ppm	ASTM D5185m >40	0	<1	<1
Tin	ppm	ASTM D5185m >5	0	0	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	16	43
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	<1
Calcium	ppm	ASTM D5185m	0	0	3
Phosphorus	ppm	ASTM D5185m	<1	3	8
Zinc	ppm	ASTM D5185m	0	0	2
Sulfur	ppm	ASTM D5185m	0	0	56

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	2
Sodium	ppm	ASTM D5185m	0	6	12
Potassium	ppm	ASTM D5185m >20	0	<1	1
Water	%	ASTM D6304 >0.6	0.060	0.119	0.073
ppm Water	ppm	ASTM D6304 >6000	600.6	1191.4	733.7

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	8645	2159	▲ 21234
Particles >6µm	ASTM D7647	>2500	▲ 3445	779	▲ 7233
Particles >14µm	ASTM D7647	>320	▲ 683	115	▲ 926
Particles >21µm	ASTM D7647	>80	▲ 257	23	▲ 185
Particles >38µm	ASTM D7647	>20	20	1	5
Particles >71µm	ASTM D7647	>4	1	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 20/19/17	18/17/14	▲ 22/20/17


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.12	0.15	0.30




OIL ANALYSIS REPORT


Particle Trend

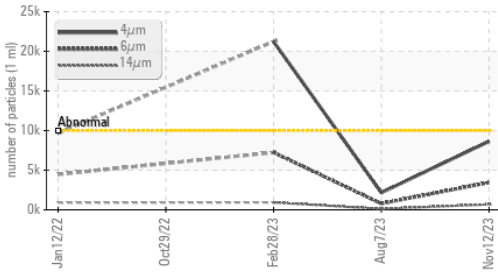


Water (KF)

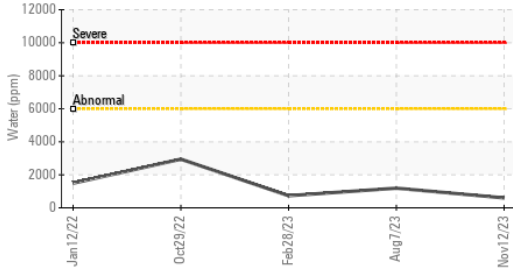


Acid Number

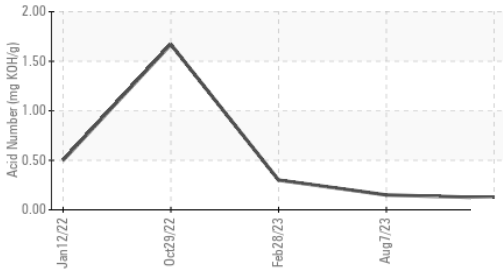

Water (KF)

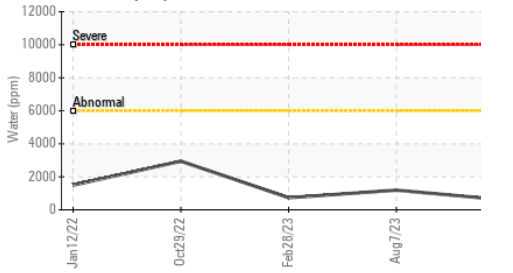

Viscosity @ 40°C

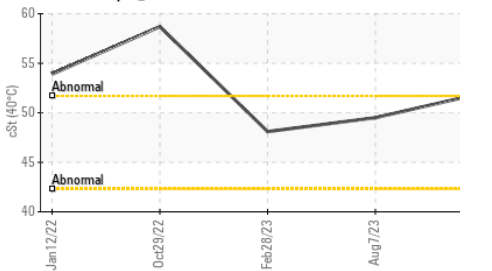


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	52.0	49.5	48.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

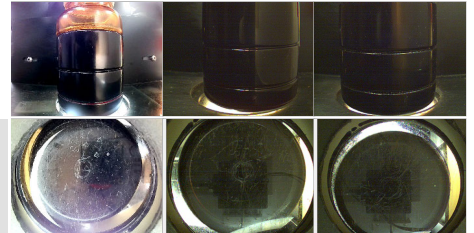


Bottom

GRAPHS


Ferrous Alloys

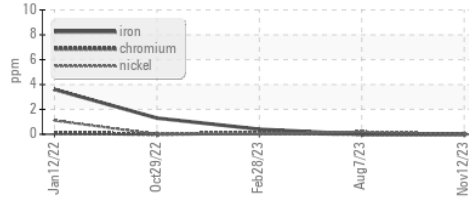


Non-ferrous Metals

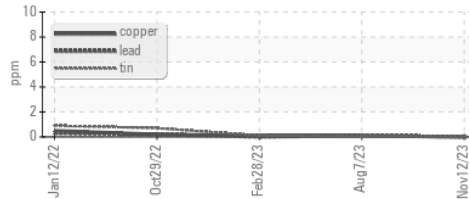


Viscosity @ 40°C

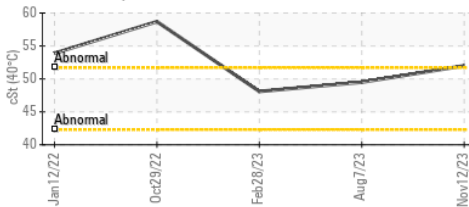

Particle Count

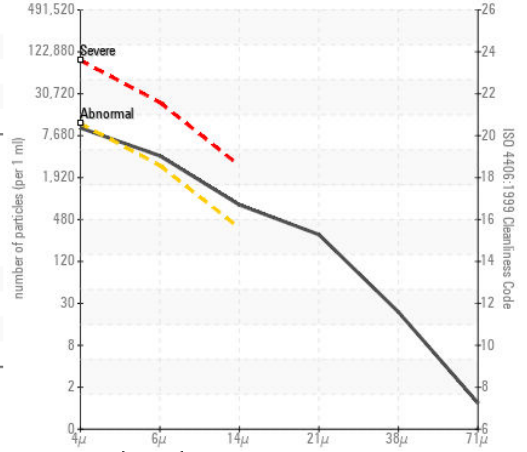

Acid Number

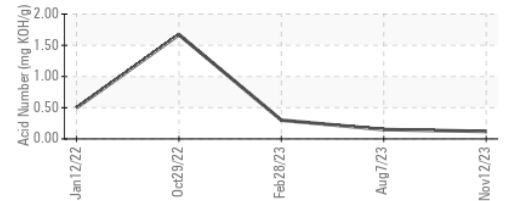

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM27608
 Lab Number : 06006363
 Unique Number : 10740125
 Test Package : IND 2

CARGILL FEED & NUTRITION - NEW RICHLAND
 21295 ST HWY 13
 NEW RICHLAND, MN
 US 56072
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (507)465-3257