

## **PROBLEM SUMMARY**

## Sample Rating Trend

w2015 Aug2018 Aug2017 Jui2018 Dec2019 And/021 Na-3/021 And/022 And/02

ISO




# SOUTH SOUTH **SOUTH LS-2 (S/N 505B)**

**Refrigeration Compressor** 

**REFRIG COMP OIL ISO 68 (--- GAL)** 

## **COMPONENT CONDITION SUMMARY**

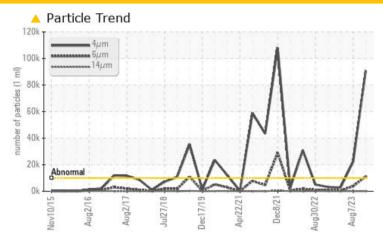

## RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status		ABNORMAL	ABNORMAL	NORMAL				
Particles >4µm	ASTM D7647 >10	000 <b>4 90805</b>	<u>^</u> 22429	2818				
Particles >6µm	ASTM D7647 >25	00 <b>A 11179</b>	<u></u> 3810	540				
Oil Cleanliness	ISO 4406 (c) >20	/18/15 🔺 <b>24/21/13</b>	<u>^</u> 22/19/12	19/16/12				

**Customer Id: TYSTAR** Sample No.: USP0003468 Lab Number: 06006391 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

## HISTORICAL DIAGNOSIS

## 07 Aug 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 09 May 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 04 Jan 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

# SOUTH SOUTH **SOUTH LS-2 (S/N 505B)**

**Refrigeration Compressor** 

**REFRIG COMP OIL ISO 68 (--- GAL)** 

Sample Rating Trend



## **DIAGNOSIS**

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0003468	USP248344	USP244234
Sample Date		Client Info		13 Nov 2023	07 Aug 2023	09 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	1	0	2
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	5	0	0	1
Calcium	ppm	ASTM D5185m	12	0	0	0
Phosphorus	ppm	ASTM D5185m	12	<1	0	0
Zinc	ppm	ASTM D5185m	12	0	0	0
Sulfur	ppm	ASTM D5185m	1000	0	0	15
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	0	<1
Sodium	ppm	ASTM D5185m		1	0	2
Potassium	ppm	ASTM D5185m	>20	0	0	2
Water	%	ASTM D6304	>0.01	0.005	0.003	0.003
ppm Water	ppm	ASTM D6304		56.5	29.3	38.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>10000	<b>90805</b>	<u>22429</u>	2818
Particles >6µm		ASTM D7647	>2500	<u> </u>	<u></u> 3810	540
Particles >14µm		ASTM D7647	>320	44	39	24
Particles >21µm		ASTM D7647	>80	10	4	6
Particles >38µm		ASTM D7647	>20	1	0	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>4</u> 24/21/13	<u>^</u> 22/19/12	19/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.10	0.027	0.015	0.029



## **OIL ANALYSIS REPORT**

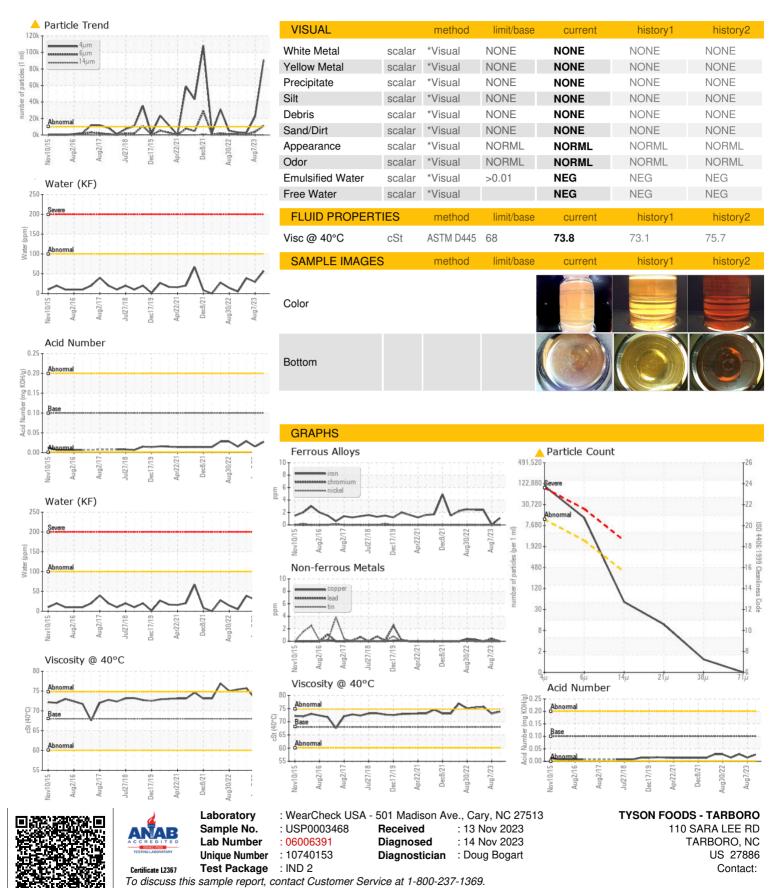

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: