




# FUEL REPORT

Sample Rating Trend

**NORMAL**

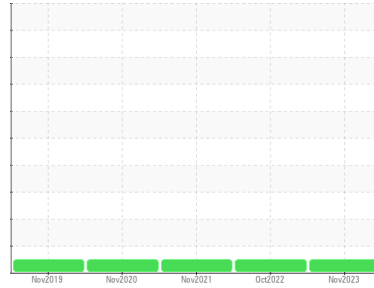

Machine Id  
**IRVINGTON PUMP STATION F020387956**

Component  
**Diesel Fuel**  
Fluid  
**NOT GIVEN (--- GAL)**

## DIAGNOSIS

### Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0834514</b>	WC0699458	WC0612481
Sample Date	Client Info			<b>02 Nov 2023</b>	20 Oct 2022	30 Nov 2021
Machine Age	hrs	Client Info		<b>235</b>	0	227
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>557</b>	679	632


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	3
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m	<0.1	<b>11</b>	6	39
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	0
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0


SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						



# FUEL REPORT

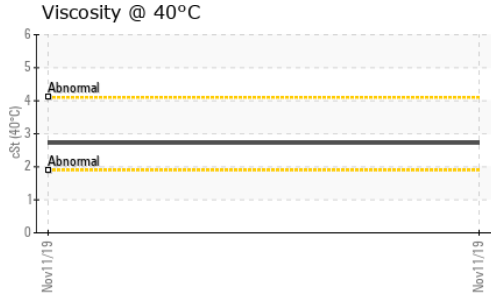

## GRAPHS

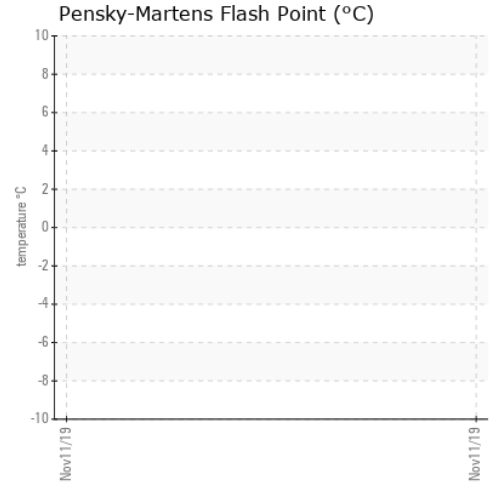

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0834514    **Received** : 13 Nov 2023  
**Lab Number** : 06006656    **Diagnosed** : 16 Nov 2023  
**Unique Number** : 10740418    **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 1

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553

Contact: CHRIS HALVORSEN  
 parts@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073