


PROBLEM SUMMARY

Sample Rating Trend

WATER




Machine Id
RAL-112B
Component
Gearbox
Fluid
SYNGEAR PG460 (--- GAL)

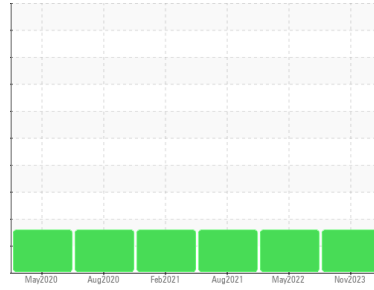

COMPONENT CONDITION SUMMARY

▲ Water (KF)

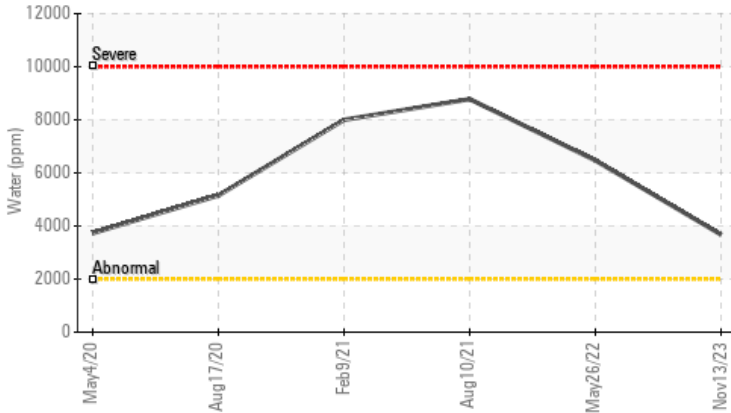

RECOMMENDATION

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.2	▲ 0.367	▲ 0.647	▲ 0.878
ppm Water	ppm	ASTM D6304	>2000	▲ 3676.0	▲ 6470	▲ 8780

Customer Id: HOLCOR
Sample No.: RP0027939
Lab Number: 06007039
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Check Water Access	---	---	?	We advise that you check for the source of water entry.

HISTORICAL DIAGNOSIS

26 May 2022 Diag: Jonathan Hester

WATER



We advise that you check for the source of water entry. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



10 Aug 2021 Diag: Don Baldrige

WATER



We advise that you check for the source of water entry. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



09 Feb 2021 Diag: Don Baldrige

WATER




We advise that you check for the source of water entry. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

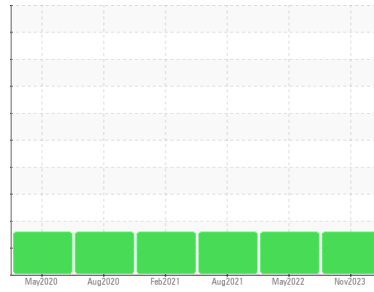

WATER



Machine Id
RAL-112B
 Component
Gearbox
 Fluid
SYNGEAR PG460 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP0027939	RP0012056	RP0011899
Sample Date	Client Info			13 Nov 2023	26 May 2022	10 Aug 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	1	1	<1
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	4	2	0
Lead	ppm	ASTM D5185m	>100	0	3	0
Copper	ppm	ASTM D5185m	>200	5	4	2
Tin	ppm	ASTM D5185m	>25	0	3	<1
Antimony	ppm	ASTM D5185m	>5	---	---	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	6	3
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	1	0
Calcium	ppm	ASTM D5185m		<1	3	0
Phosphorus	ppm	ASTM D5185m		653	629	609
Zinc	ppm	ASTM D5185m		0	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	1	4	<1
Sodium	ppm	ASTM D5185m		10	2	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.2	▲ 0.367	▲ 0.647	▲ 0.878
ppm Water	ppm	ASTM D6304	>2000	▲ 3676.0	▲ 6470	▲ 8780

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.29	0.39	0.433


OIL ANALYSIS REPORT

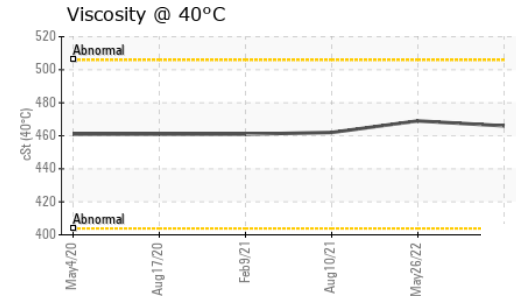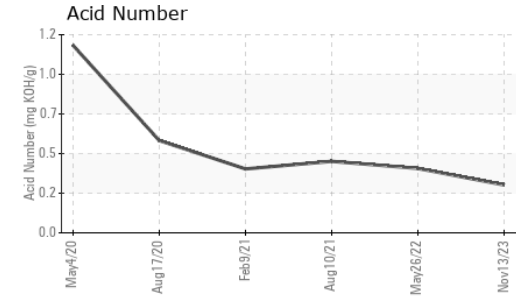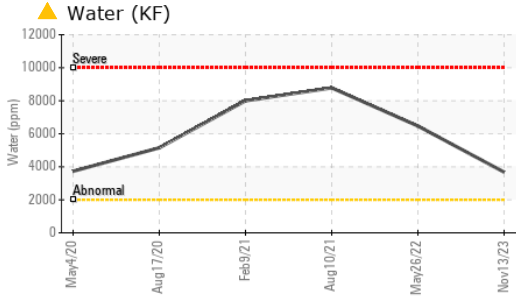





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	466	469	462

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

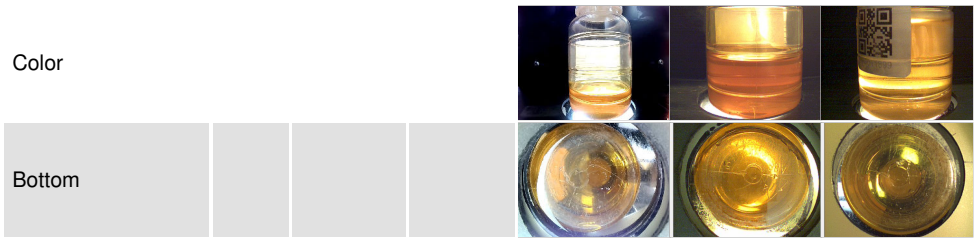

GRAPHS

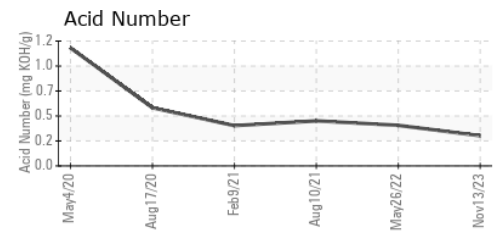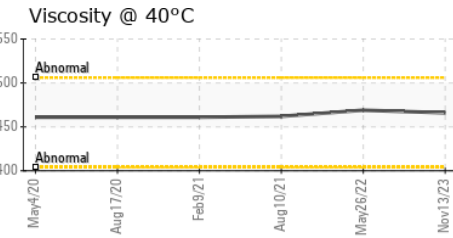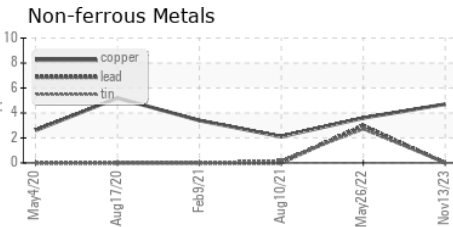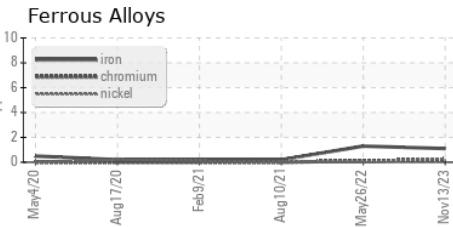

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0027939 **Received** : 14 Nov 2023
Lab Number : 06007039 **Diagnosed** : 15 Nov 2023
Unique Number : 10740801 **Diagnostician** : Doug Bogart
Test Package : IND 2

HOLLINGSWORTH & VOSE CO
 1115 SE CRYSTAL LAKE DR
 CORVALLIS, OR
 US 97333
 Contact: Jon Ayers
 jonathan.ayers@hovo.com
 T: (541)738-5399
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)