




# PROBLEM SUMMARY

Area  
**ULTRA [SVO-055658]**  
 Machine Id  
**INGERSOLL RAND VL1938U15215 - LEGRAND**  
 Component  
**Compressor**

Sample Rating Trend

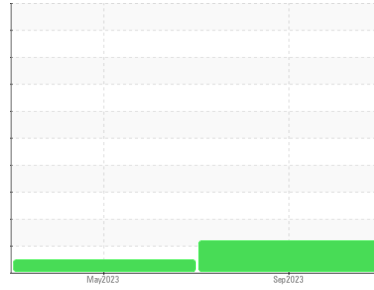


## ADDITIVES



### COMPONENT CONDITION SUMMARY

#### ▲ Additives

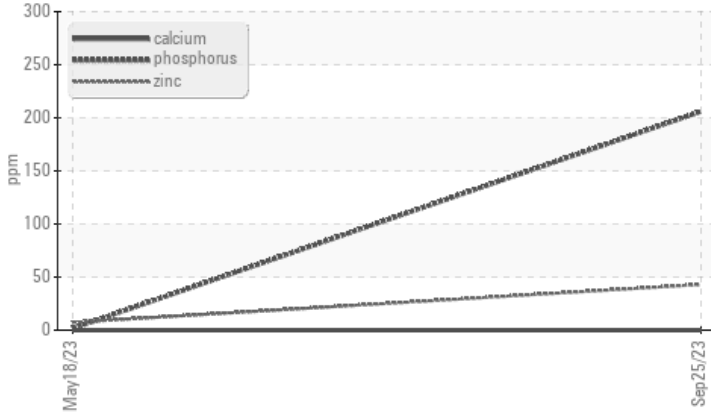

### RECOMMENDATION

Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	---
Barium	ppm	ASTM D5185m	500	▲ 0	266	---
Phosphorus	ppm	ASTM D5185m	20	▲ 206	2	---
Sulfur	ppm	ASTM D5185m	200	▲ 896	431	---

Customer Id: UCJOHSAI  
 Sample No.: UCH06007066  
 Lab Number: 06007066  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**18 May 2023 Diag: Don Baldrige**

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

ADDITIVES

Area  
**ULTRA [SVO-055658]**  
 Machine Id  
**INGERSOLL RAND VL1938U15215 - LEGRAND**  
 Component  
**Compressor**

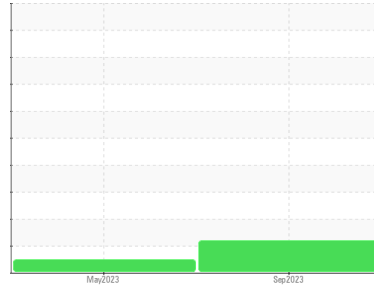

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06007066</b>	UCH05859368	---
Sample Date	Client Info		<b>25 Sep 2023</b>	18 May 2023	---
Machine Age	hrs	Client Info	<b>42991</b>	41292	---
Oil Age	hrs	Client Info	<b>0</b>	1902	---
Oil Changed	Client Info		<b>N/A</b>	Changed	---
Sample Status			<b>ATTENTION</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	0	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	1	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 500	<b>0</b>	266	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 20	<b>206</b>	2	---
Zinc	ppm	ASTM D5185m 0	<b>43</b>	7	---
Sulfur	ppm	ASTM D5185m 200	<b>896</b>	431	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	1	---
Sodium	ppm	ASTM D5185m	<b>1</b>	60	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	8	---

## FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.40</b>	0.76	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	MODER	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	NEG	---







# OIL ANALYSIS REPORT

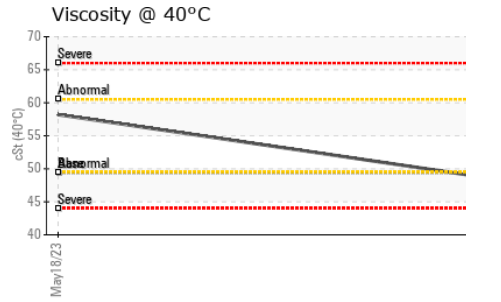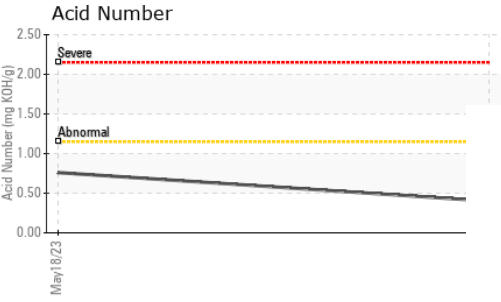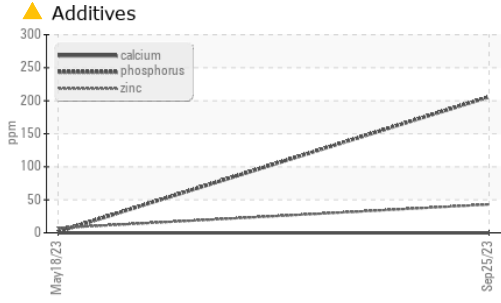

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	48.6	58.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

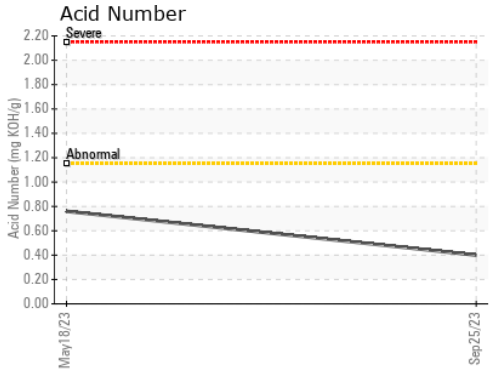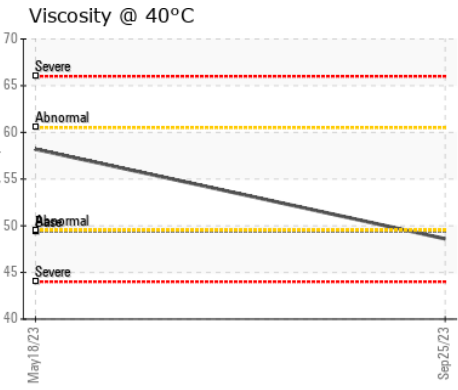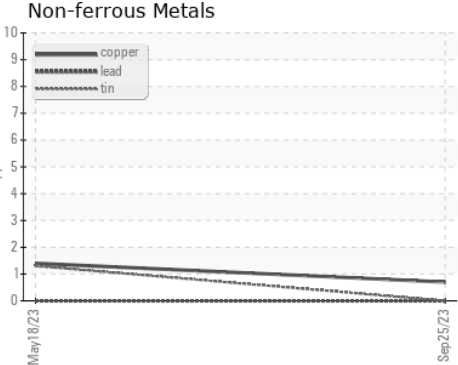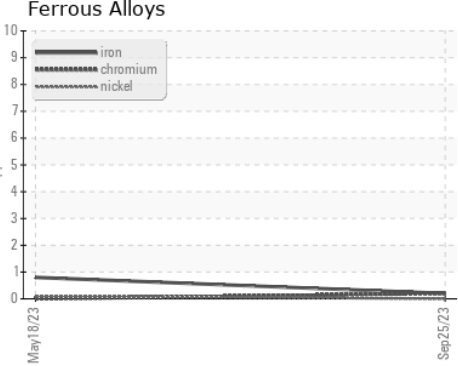

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06007066 **Received** : 14 Nov 2023  
**Lab Number** : 06007066 **Diagnosed** : 15 Nov 2023  
**Unique Number** : 10740828 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhfc.com  
 T: (314)593-1267  
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)