




OIL ANALYSIS REPORT

Sample Rating Trend

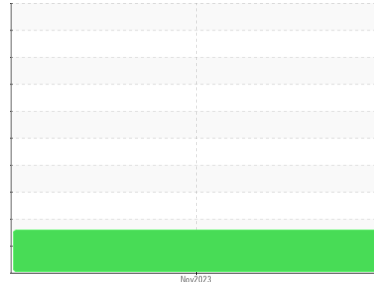

ISO



Machine Id
PERKINS DPKXL04.4NL1 (S/N BPKXL04.4NL1)

Component
Genset

Fluid
SUPER LUBE TMS 15W40 NN6690 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0690572	---	---
Sample Date	Client Info		06 Nov 2023	---	---
Machine Age	hrs	Client Info	439	---	---
Oil Age	hrs	Client Info	439	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			ATTENTION	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	39	---	---
Chromium	ppm	ASTM D5185m >4	0	---	---
Nickel	ppm	ASTM D5185m >2	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >12	<1	---	---
Lead	ppm	ASTM D5185m >17	<1	---	---
Copper	ppm	ASTM D5185m >70	13	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	61	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	1000	---	---
Calcium	ppm	ASTM D5185m	1182	---	---
Phosphorus	ppm	ASTM D5185m	1067	---	---
Zinc	ppm	ASTM D5185m	1336	---	---
Sulfur	ppm	ASTM D5185m	3053	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	---	---
Sodium	ppm	ASTM D5185m	3	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.3	---	---
Nitration	Abs/cm	*ASTM D7624 >20	10.5	---	---
Sulfation	Abs:.1mm	*ASTM D7415 >30	23.0	---	---




OIL ANALYSIS REPORT

Particle Trend

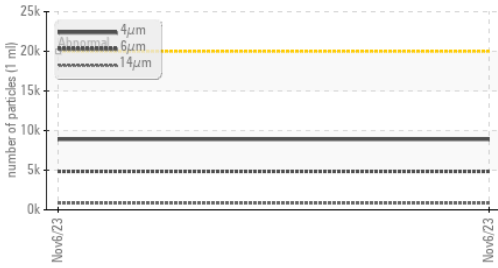

Particle Trend

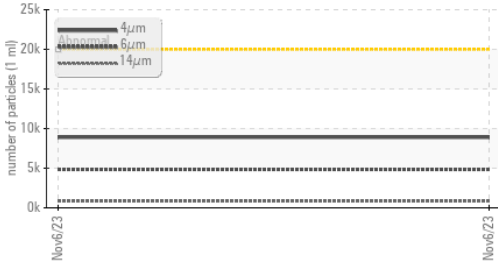

Base Number



Viscosity @ 100°C



FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	8900	---	---
Particles >6µm	ASTM D7647	>5000	4848	---	---
Particles >14µm	ASTM D7647	>640	▲ 825	---	---
Particles >21µm	ASTM D7647	>160	▲ 278	---	---
Particles >38µm	ASTM D7647	>40	▲ 43	---	---
Particles >71µm	ASTM D7647	>10	4	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 20/19/17	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	24.2	---	---
Base Number (BN)	mg KOH/g ASTM D2896		8.97	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	---	---
Yellow Metal	scalar *Visual	NONE	NONE	---	---
Precipitate	scalar *Visual	NONE	NONE	---	---
Silt	scalar *Visual	NONE	NONE	---	---
Debris	scalar *Visual	NONE	NONE	---	---
Sand/Dirt	scalar *Visual	NONE	NONE	---	---
Appearance	scalar *Visual	NORML	NORML	---	---
Odor	scalar *Visual	NORML	NORML	---	---
Emulsified Water	scalar *Visual	>0.1	NEG	---	---
Free Water	scalar *Visual		NEG	---	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445		14.2	---	---

GRAPHS


Ferrous Alloys

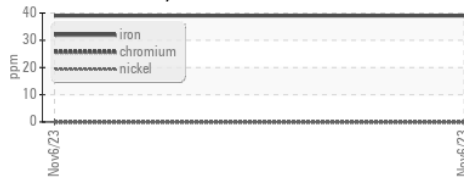


Non-ferrous Metals

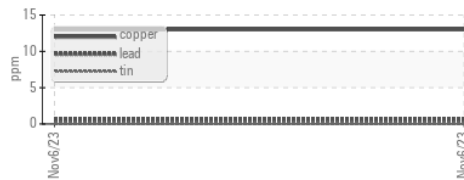

Viscosity @ 100°C

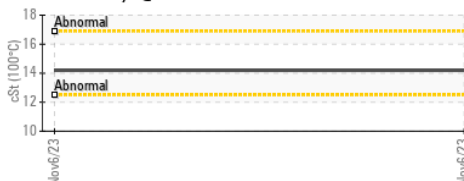

Particle Count

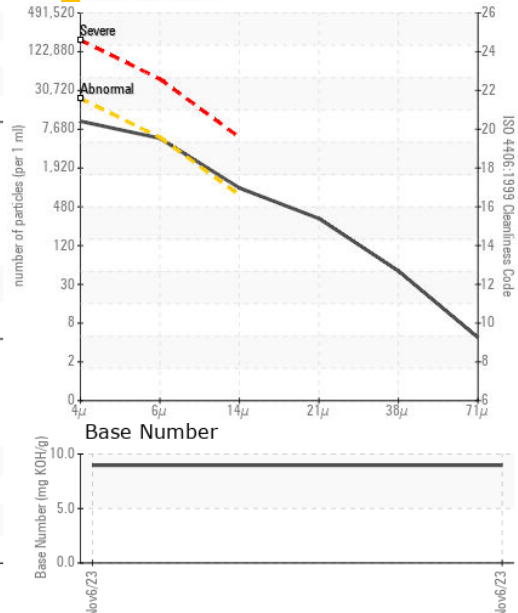

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0690572 **Received** : 14 Nov 2023
Lab Number : 06007129 **Diagnosed** : 16 Nov 2023
Unique Number : 10740891 **Diagnostician** : Don Baldrige
Test Package : MOB 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GREENER WORLD SOLUTIONS

33908 128TH ST
 WASECA, MN
 US 56093
 Contact: JEREMY PAVLIC
 JEREMY@GREENERWORLDSOLUTIONS.COM

T:
 F: