




PROBLEM SUMMARY

Machine Id
1300 CPR 003

Component
Compressor

Fluid
GARDNER DENVER AEON 9000 SP (30 GAL)

Sample Rating Trend

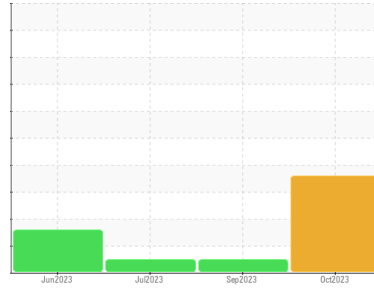


WATER




COMPONENT CONDITION SUMMARY

▲ Particle Trend

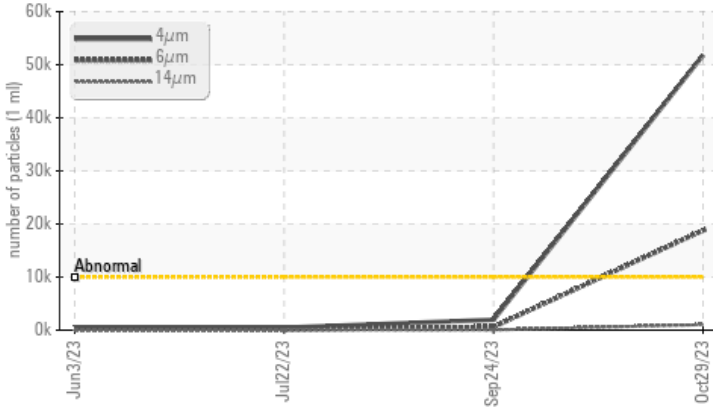

▲ Water (KF)

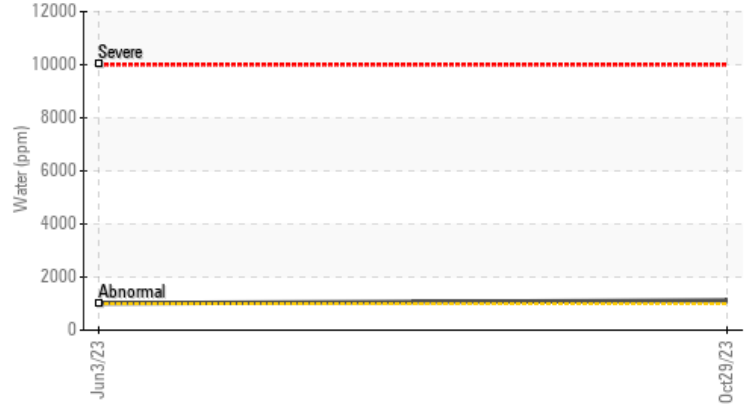


RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Water	%	ASTM D6304	>0.1	▲ 0.112	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ 1120	---	---
Particles >4µm		ASTM D7647	>10000	▲ 51786	1964	467
Particles >6µm		ASTM D7647	>2500	▲ 18796	619	122
Particles >14µm		ASTM D7647	>320	▲ 1038	41	14
Particles >21µm		ASTM D7647	>80	▲ 268	7	4
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 23/21/17	18/16/13	16/14/11

PrtFilter



Customer Id: APCFRA
Sample No.: PH0001953
Lab Number: 06007631
Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

24 Sep 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Jul 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Jun 2023 Diag: Doug Bogart

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

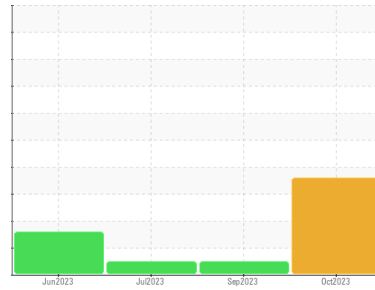

WATER



Machine Id
1300 CPR 003

Component
Compressor

Fluid
GARDNER DENVER AEON 9000 SP (30 GAL)

DIAGNOSIS

▲ Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	PH0001953	PH0001935	PH0001147	
Sample Date	Client Info	29 Oct 2023	24 Sep 2023	22 Jul 2023	
Machine Age	hrs	Client Info	51291	0	49183
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	Changed	N/A	N/A	
Sample Status		ABNORMAL	NORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	<1	0	0
Copper	ppm	ASTM D5185m	>50	0	1	0
Tin	ppm	ASTM D5185m	>15	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	<1	0	0
Barium	ppm	ASTM D5185m	0	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	0	<1	1	3
Calcium	ppm	ASTM D5185m	0	<1	<1	0
Phosphorus	ppm	ASTM D5185m	800	799	793	743
Zinc	ppm	ASTM D5185m	0	1	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	0

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	0	2	1
Sodium	ppm	ASTM D5185m		<1	3	<1
Potassium	ppm	ASTM D5185m	>20	0	1	<1
Water	%	ASTM D6304	>0.1	▲ 0.112	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ 1120	---	---


FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>10000	▲ 51786	1964	467
Particles >6µm	ASTM D7647	>2500	▲ 18796	619	122
Particles >14µm	ASTM D7647	>320	▲ 1038	41	14
Particles >21µm	ASTM D7647	>80	▲ 268	7	4
Particles >38µm	ASTM D7647	>20	13	0	0
Particles >71µm	ASTM D7647	>4	1	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/17	18/16/13	16/14/11

FLUID DEGRADATION






method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	.170	0.46	0.50	0.47

Particle Filter (Magn: 200 x)

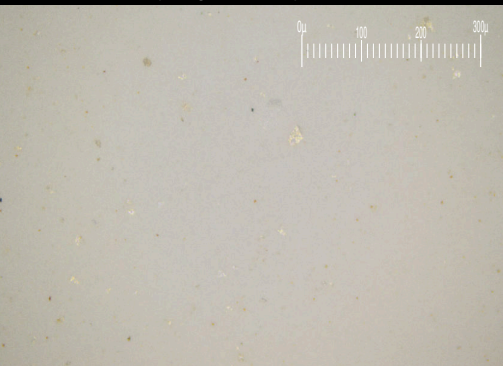




OIL ANALYSIS REPORT

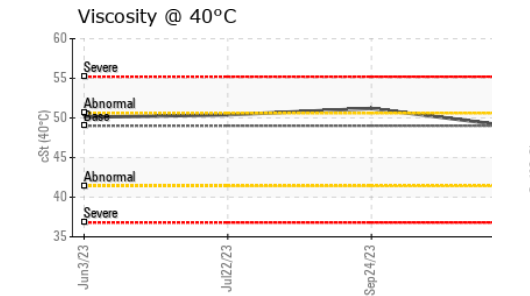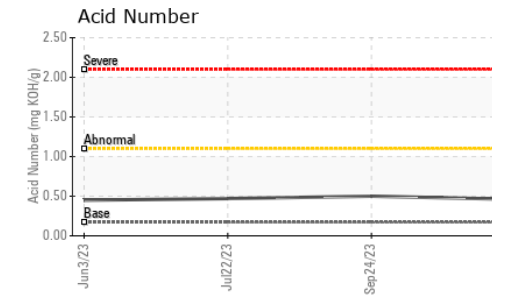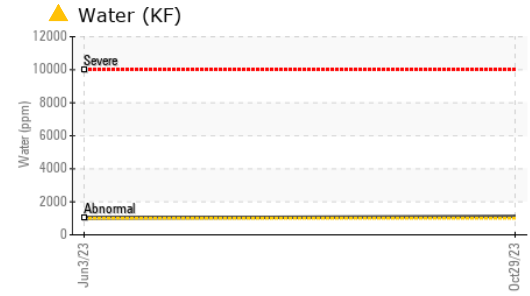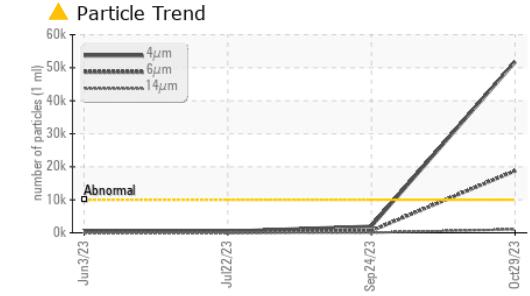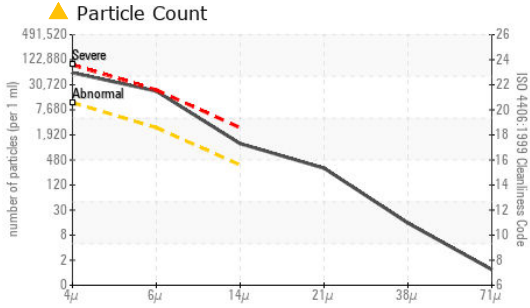






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.01	48.9	51.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

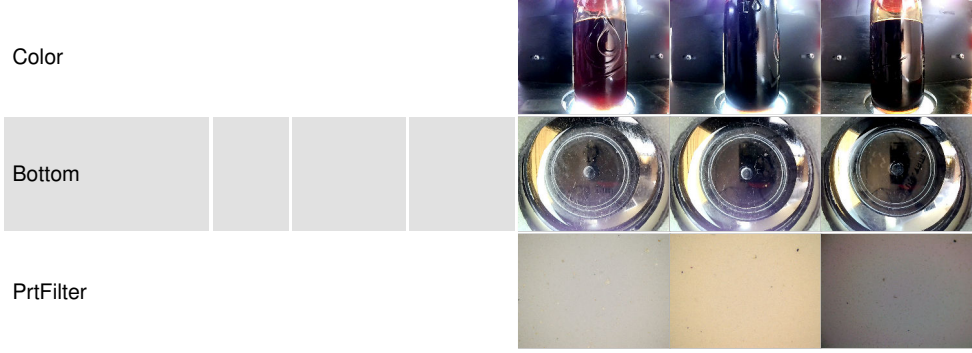

GRAPHS

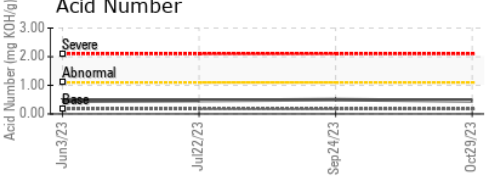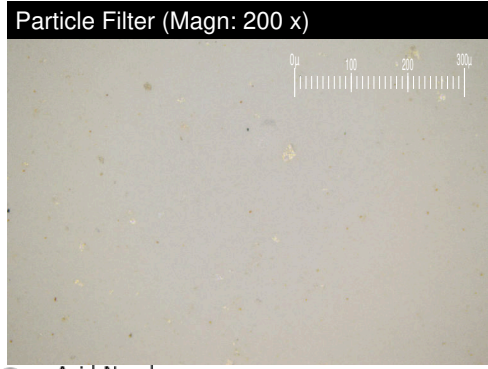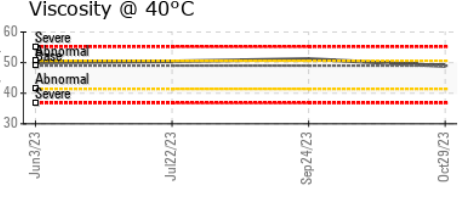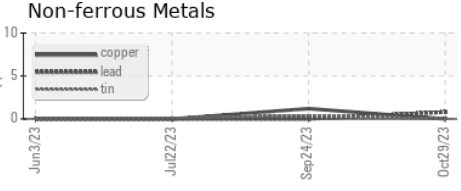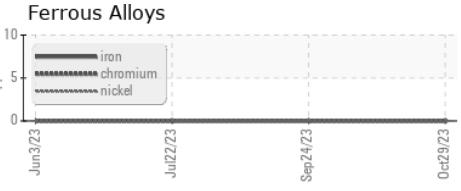

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH0001953 **Received** : 14 Nov 2023
Lab Number : 06007631 **Diagnosed** : 06 Dec 2023
Unique Number : 10741393 **Diagnostician** : Doug Bogart
Test Package : PLANT (Additional Tests: KF, PrtFilter)

APCOM
 127 SOUTHEAST PARKWAY
 FRANKLIN, TN
 US 37064
 Contact: R Filipovic
 rfilipovic@apcom.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)