



# PROBLEM SUMMARY

Sample Rating Trend

ISO



Area  
**HOTLINE/170 REVERSING MILL**  
Machine Id  
**80 SHEAR LUBE RESERVOIR 1411-004-0280**  
Component  
**Gearbox**  
Fluid  
**CITGO COMPOUND EP 320 (165 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend



## RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>20000	▲ <b>127882</b>	---	---
Particles >6µm	ASTM D7647	>5000	▲ <b>46827</b>	---	---
Particles >14µm	ASTM D7647	>640	▲ <b>1941</b>	---	---
Particles >21µm	ASTM D7647	>160	▲ <b>343</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ <b>24/23/18</b>	---	---

Customer Id: CONMUSAL  
Sample No.: KFS0004929  
Lab Number: 06007670  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

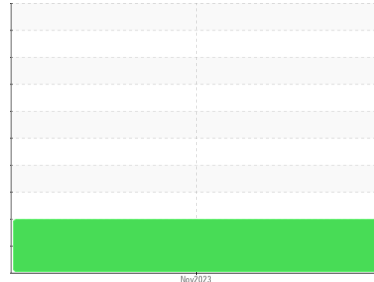

ISO



Area  
**HOTLINE/170 REVERSING MILL**  
 Machine Id  
**80 SHEAR LUBE RESERVOIR 1411-004-0280**  
 Component  
**Gearbox**  
 Fluid  
**CITGO COMPOUND EP 320 (165 GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KFS0004929</b>	---	---
Sample Date	Client Info	<b>10 Nov 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>200	<b>11</b>	---	---
Chromium ppm ASTM D5185m	>15	<b>0</b>	---	---
Nickel ppm ASTM D5185m	>15	<b>0</b>	---	---
Titanium ppm ASTM D5185m		<b>0</b>	---	---
Silver ppm ASTM D5185m		<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>25	<b>0</b>	---	---
Lead ppm ASTM D5185m	>100	<b>&lt;1</b>	---	---
Copper ppm ASTM D5185m	>200	<b>0</b>	---	---
Tin ppm ASTM D5185m	>25	<b>0</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m		<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>0</b>	---	---
Magnesium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Calcium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Phosphorus ppm ASTM D5185m		<b>121</b>	---	---
Zinc ppm ASTM D5185m		<b>&lt;1</b>	---	---
Sulfur ppm ASTM D5185m		<b>4379</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>50	<b>&lt;1</b>	---	---
Sodium ppm ASTM D5185m		<b>0</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>&lt;1</b>	---	---





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>20000	<b>▲ 127882</b>	---	---
Particles >6µm ASTM D7647	>5000	<b>▲ 46827</b>	---	---
Particles >14µm ASTM D7647	>640	<b>▲ 1941</b>	---	---
Particles >21µm ASTM D7647	>160	<b>▲ 343</b>	---	---
Particles >38µm ASTM D7647	>40	<b>5</b>	---	---
Particles >71µm ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>21/19/16	<b>▲ 24/23/18</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.38</b>	---	---

# OIL ANALYSIS REPORT

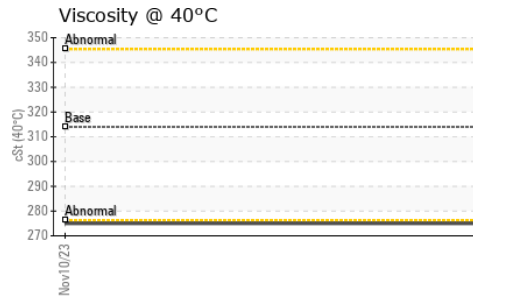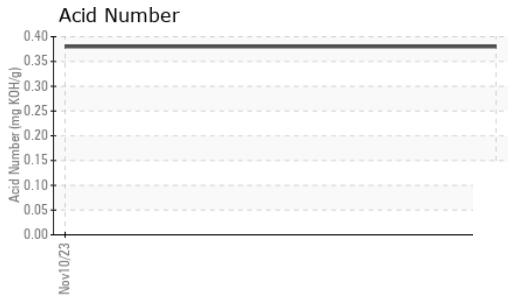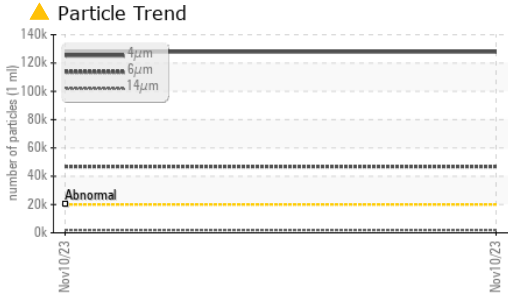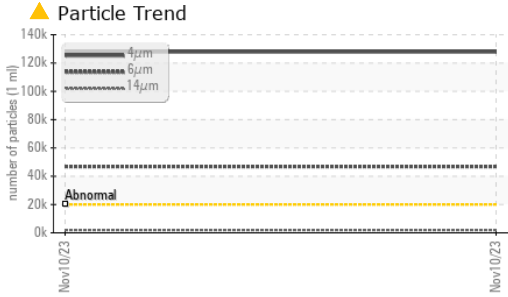





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 314	275	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

### GRAPHS

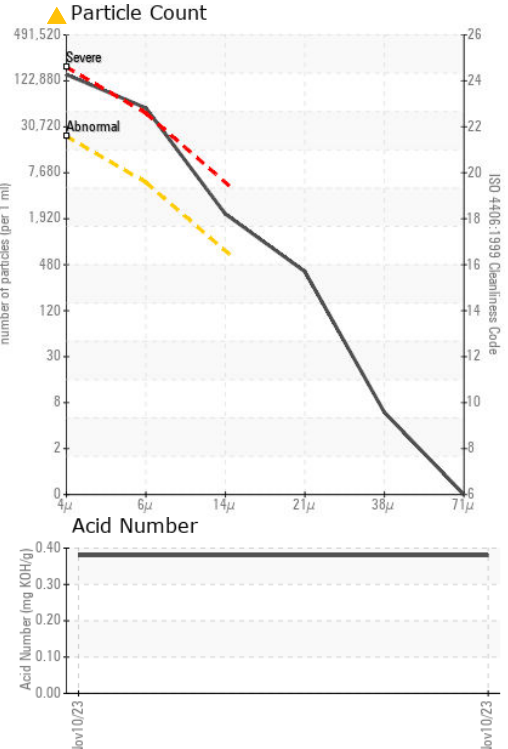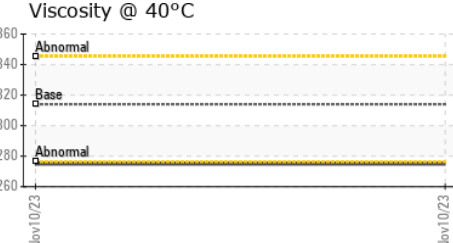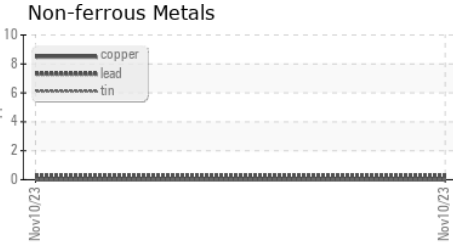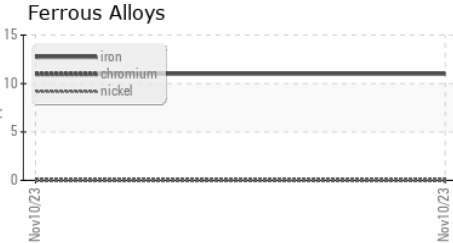

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KFS0004929 **Received** : 14 Nov 2023  
**Lab Number** : 06007670 **Diagnosed** : 16 Nov 2023  
**Unique Number** : 10741432 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**CONSTELLIUM**  
 4805 SECOND STREET  
 MUSCLE SHOALS, AL  
 US 35661  
 Contact: Joel Even  
 joel.even@constellium.com  
 T: (256)740-7490  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)