


OIL ANALYSIS REPORT

Sample Rating Trend







KAESER 7431378

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sep2021 New2021 Mad2022 Jun2022 Sep2022 Dec2022 Mad2023 Jun2023 Sep2023						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06007689	KC101474	KC101508
Sample Date		Client Info		15 Sep 2023	02 Jun 2023	22 Mar 2023
Machine Age	hrs	Client Info		8507	7623	7040
Oil Age	hrs	Client Info		0	3000	1000
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		10	0	0
Barium	ppm	ASTM D5185m	90	44	10	16
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	72	76	74
Calcium	ppm	ASTM D5185m	2	1	2	2
Phosphorus	ppm	ASTM D5185m		36	2	12
Zinc	ppm	ASTM D5185m		2	0	1
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	0	<1
Sodium	ppm	ASTM D5185m		12	16	15
Potassium	ppm	ASTM D5185m	>20	1	3	5
Water	%	ASTM D6304	>0.05	0.029	0.016	0.016
ppm Water	ppm	ASTM D6304	>500	294.4	165.3	168.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		992	519	825
Particles >6µm		ASTM D7647	>1300	360	147	239
Particles >14µm		ASTM D7647	>80	36	11	29
Particles >21µm		ASTM D7647	>20	8	4	10
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12	16/14/11	17/15/12
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.34	0.37



OIL ANALYSIS REPORT

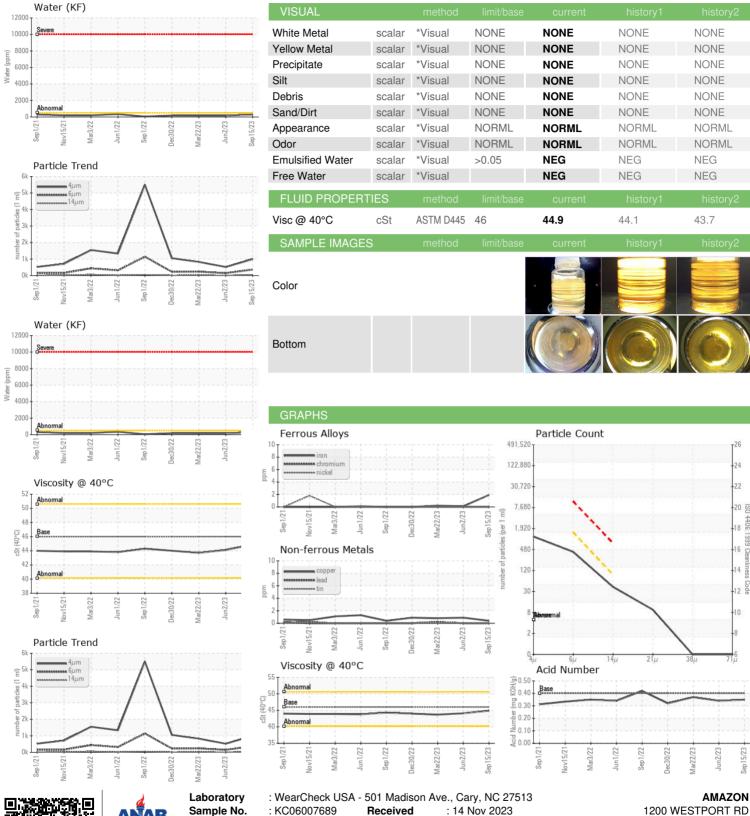





Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC06007689 : 06007689

: 10741451

Received Diagnosed

: 16 Nov 2023 Diagnostician : Don Baldridge 1200 WESTPORT RD IMPERIAL, PA US 15126

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: