


PROBLEM SUMMARY

Sample Rating Trend





WATER

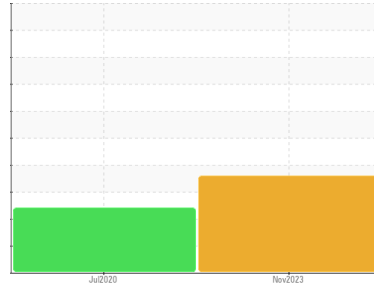

Machine Id
KAESER 6821651

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

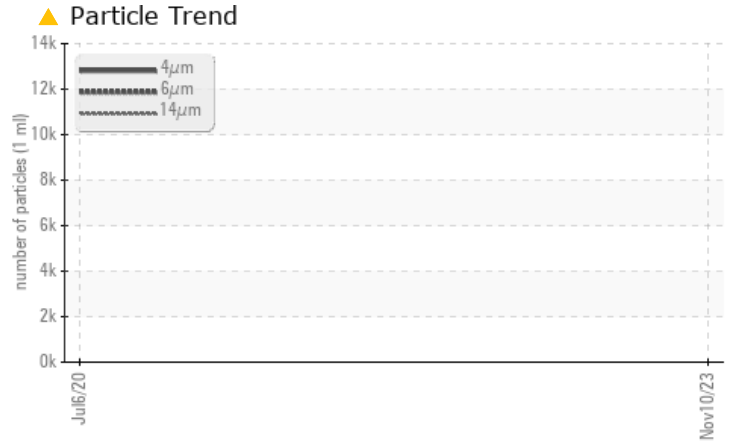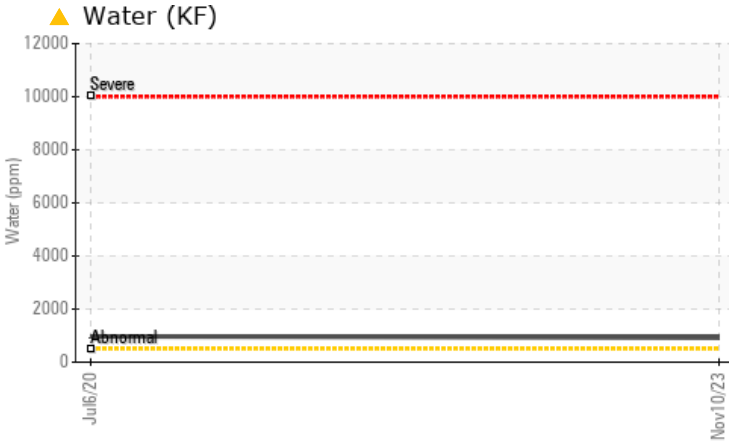

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	---
Water	%	ASTM D6304	>0.05	▲ 0.092	▲ 0.097	---
ppm Water	ppm	ASTM D6304	>500	▲ 920	▲ 970	---
Particles >6µm		ASTM D7647	>1300	▲ 2703	---	---
Particles >14µm		ASTM D7647	>80	▲ 401	---	---
Particles >21µm		ASTM D7647	>20	▲ 167	---	---
Particles >38µm		ASTM D7647	>4	▲ 20	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/16	---	---

Customer Id: ARAROCKC
Sample No.: KCPA007690
Lab Number: 06007696
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Jul 2020 Diag: Angela Borella

WATER



We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. There is a moderate amount of visible silt present in the sample. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

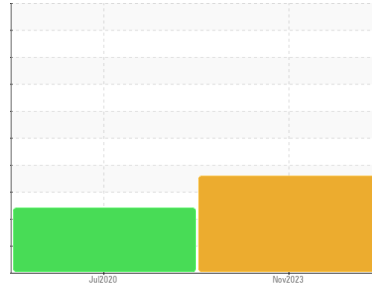

WATER



Machine Id
KAESER 6821651

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA007690	KC79342	---
Sample Date	Client Info		10 Nov 2023	06 Jul 2020	---
Machine Age	hrs	Client Info	5987	1735	---
Oil Age	hrs	Client Info	0	1735	---
Oil Changed	Client Info		N/A	Not Changd	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	2	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	<1	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	0	0	---
Lead	ppm	ASTM D5185m >10	0	<1	---
Copper	ppm	ASTM D5185m >50	12	12	---
Tin	ppm	ASTM D5185m >10	0	0	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	---
Barium	ppm	ASTM D5185m 90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 90	36	19	---
Calcium	ppm	ASTM D5185m 2	0	<1	---
Phosphorus	ppm	ASTM D5185m	0	3	---
Zinc	ppm	ASTM D5185m	66	31	---
Sulfur	ppm	ASTM D5185m	17784	15704	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	---
Sodium	ppm	ASTM D5185m	22	8	---
Potassium	ppm	ASTM D5185m >20	7	11	---
Water	%	ASTM D6304 >0.05	▲ 0.092	▲ 0.097	---
ppm Water	ppm	ASTM D6304 >500	▲ 920	▲ 970	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		12913	---	---
Particles >6µm	ASTM D7647 >1300		▲ 2703	---	---
Particles >14µm	ASTM D7647 >80		▲ 401	---	---
Particles >21µm	ASTM D7647 >20		▲ 167	---	---
Particles >38µm	ASTM D7647 >4		▲ 20	---	---
Particles >71µm	ASTM D7647 >3		1	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/19/16	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.379	---


OIL ANALYSIS REPORT

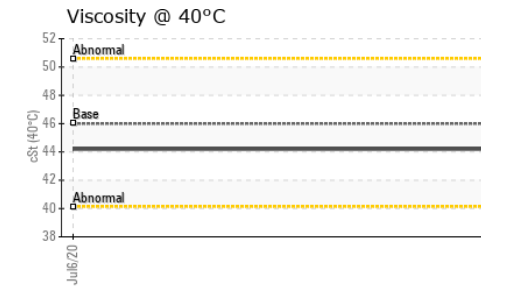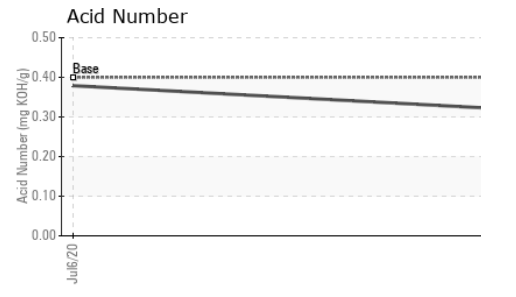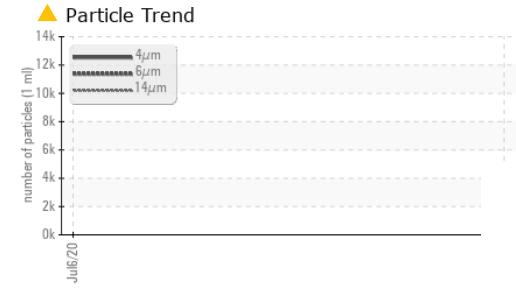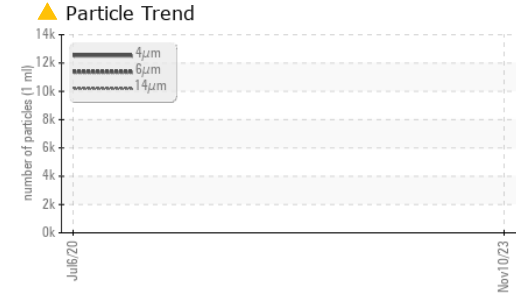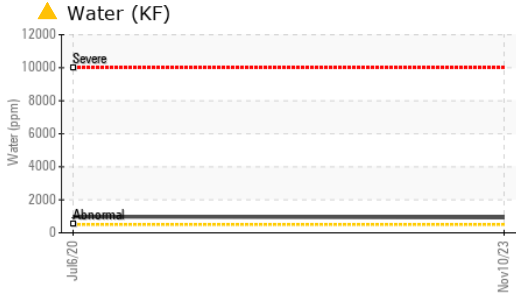





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	▲ 0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

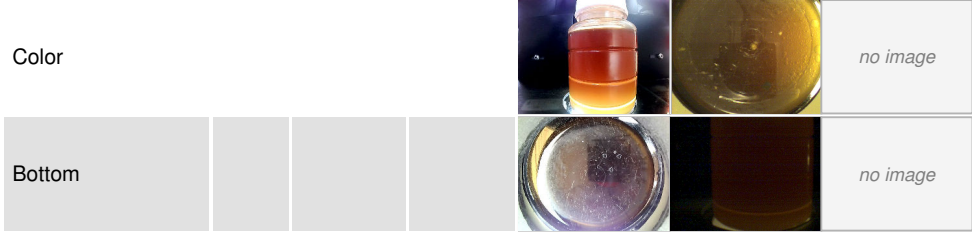

GRAPHS

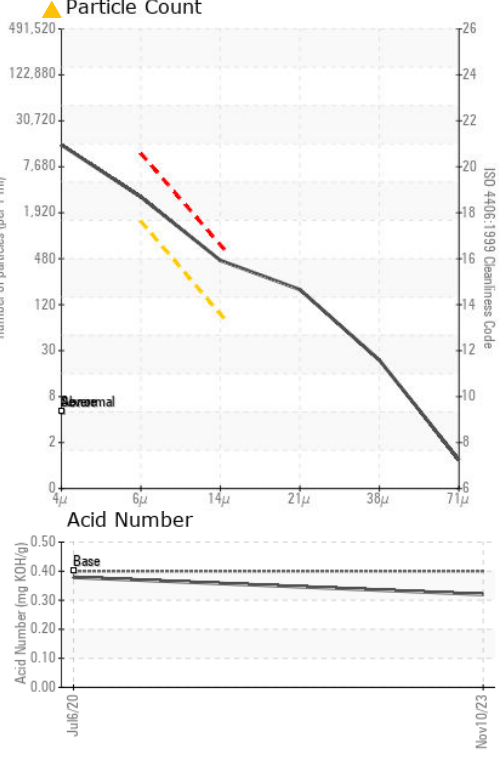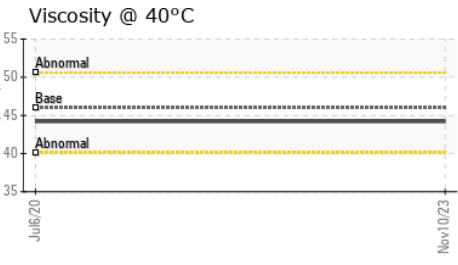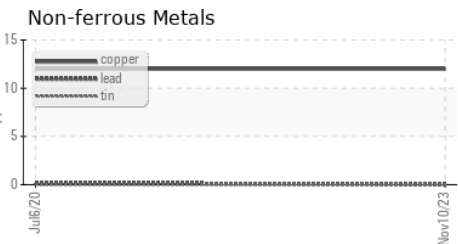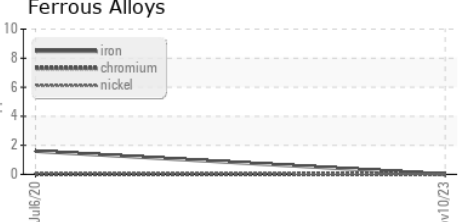

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007690 **Received** : 14 Nov 2023
Lab Number : 06007696 **Diagnosed** : 06 Dec 2023
Unique Number : 10741458 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ARAMARK
 200 TRADE CT
 ROCHESTER, NY
 US 14674
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: