

### **PROBLEM SUMMARY**


Sample Rating Trend

ISO

# KAESER AS 20T 2955341 (S/N 1283)


Compressor

AM-467C (--- GAL)





### **COMPONENT CONDITION SUMMARY**

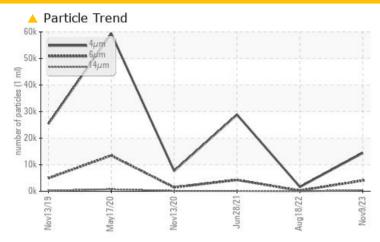

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			<b>ABNORMAL</b>	NORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	<b>4014</b>	245	<b>4266</b>				
Particles >14µm	ASTM D7647	>80	<b>4</b> 317	11	<u> </u>				
Particles >21µm	ASTM D7647	>20	<b>^</b> 96	2	<b>△</b> 31				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>21/19/15</b>	18/15/11	<u> </u>				

Customer Id: HEXMORNOR Sample No.: KCPA009059 Lab Number: 06007697 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 18 Aug 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 28 Jun 2021 Diag: Don Baldridge

150



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 13 Nov 2020 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

Sample Rating Trend



## KAESER AS 20T 2955341 (S/N 1283)

Compressor

AM-467C (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Nov2019	May2020 Nov2020	Jun2021 Aug2022	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009059	KCP49316	KCP32346
Sample Date		Client Info		09 Nov 2023	18 Aug 2022	28 Jun 2021
Machine Age	hrs	Client Info		111127	99999	95224
Oil Age	hrs	Client Info		0	4775	5000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	2
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	12
Barium	ppm	ASTM D5185m		4	5	11
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		25	37	32
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		1	6	4
Zinc	ppm	ASTM D5185m		24	22	24
Sulfur	ppm	ASTM D5185m		18086	19465	17036
CONTAMINANTS	)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		8	13	14
Potassium	ppm	ASTM D5185m	>20	0	<1	1
Water	%	ASTM D6304		0.009	0.019	0.012
ppm Water	ppm	ASTM D6304	>500	96.6	193.8	128.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14401	1649	28856
Particles >6µm		ASTM D7647	>1300	<b>4014</b>	245	<b>▲</b> 4266
Particles >14μm		ASTM D7647	>80	<u> </u>	11	<u> </u>
Particles >21µm		ASTM D7647	>20	<u>^</u> 96	2	<b>△</b> 31
Particles >38μm		ASTM D7647	>4	2	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/19/15</u>	18/15/11	<b>▲</b> 19/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
		10T11 D0015				



### **OIL ANALYSIS REPORT**

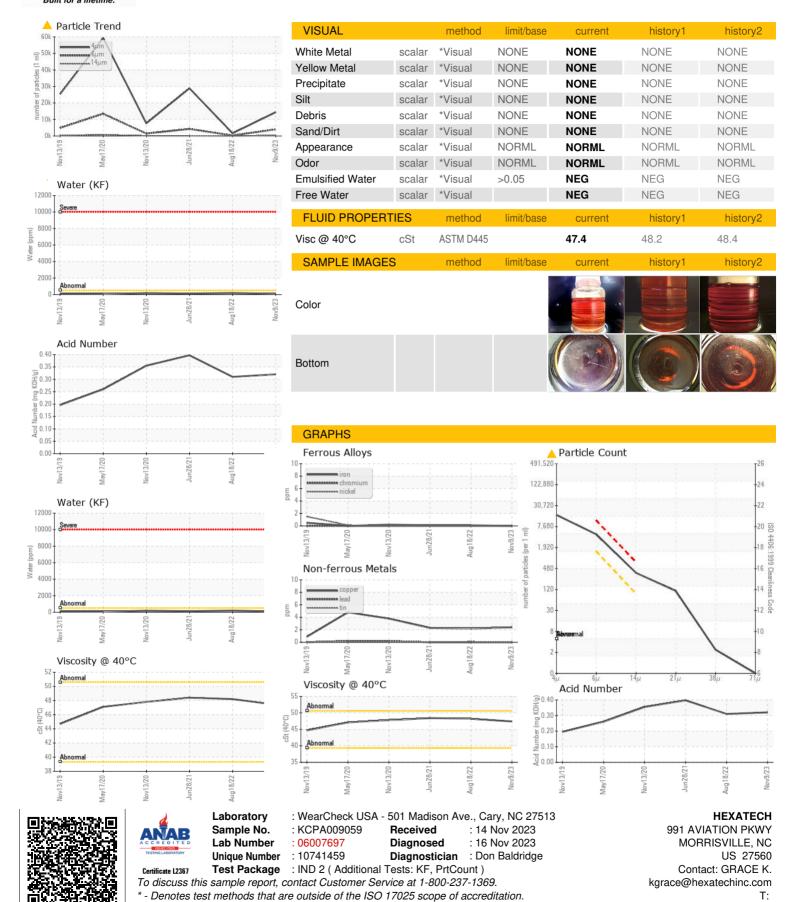

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: