


PROBLEM SUMMARY

KAESER ASD 40S 4304918 (S/N 1068)

Compressor

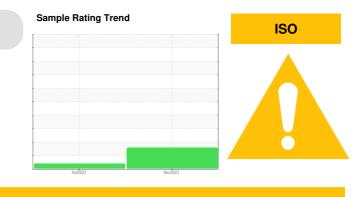

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY



RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<u> </u>						
Particles >14µm	ASTM D7647	>80	451						
Particles >21µm	ASTM D7647	>20	<u> </u>						
Oil Cleanliness	ISO 4406 (c)	>/17/13	A 22/20/16						

Customer Id: LESROS Sample No.: KC124393 Lab Number: 06007706 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED AC	RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description		
Change Filter			?	We recommend you service the filters on this component.		

HISTORICAL DIAGNOSIS

05 Oct 2022 Diag: Jonathan Hester

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

KAESER ASD 40S 4304918 (S/N 1068)

Sample Rating Trend

ISO

Component Compressor

Machine Id

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124393	KC85902	
Sample Date		Client Info		08 Nov 2023	05 Oct 2022	
Machine Age	hrs	Client Info		22260	21285	
Oil Age	hrs	Client Info		0	5700	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m		0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum		ASTM D5185m		0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
	ppm			12	15	
Copper Tin	ppm	ASTM D5185m				
	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	0	<1	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	<1	
Zinc	ppm	ASTM D5185m		0	15	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		8	0	
Potassium	ppm	ASTM D5185m	>20	0	2	
Water	%	ASTM D6304	>0.05	0.015	0.005	
ppm Water	ppm	ASTM D6304	>500	157.1	57.0	
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		23353		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	22/20/16		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.401	0.36	
	39				*	



OIL ANALYSIS REPORT





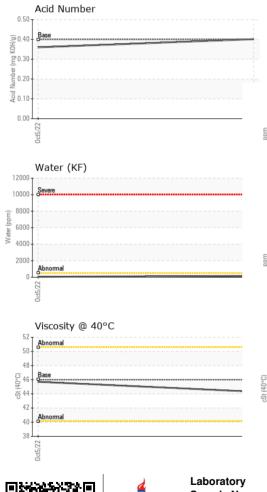


10


55

50

45

40

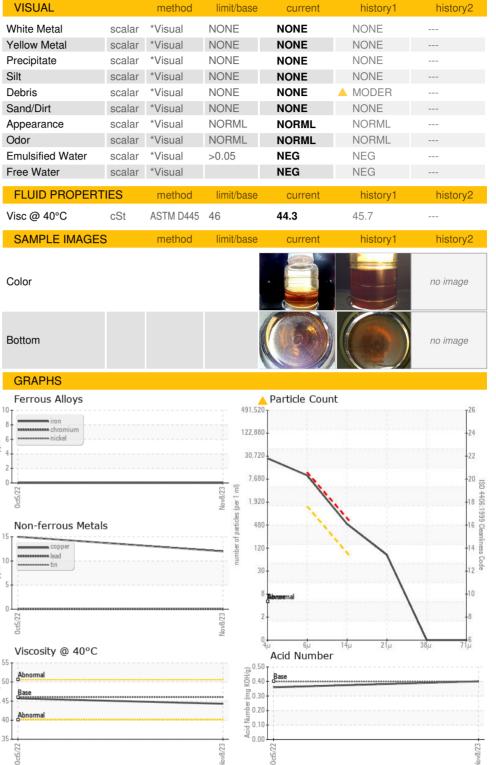



Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

鍿

Contact/Location: Service Manager - LESROS