

## **PROBLEM SUMMARY**

WATER


Machine Id

# KAESER 3546541 (S/N NOT GIVEN)


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



### **COMPONENT CONDITION SUMMARY**

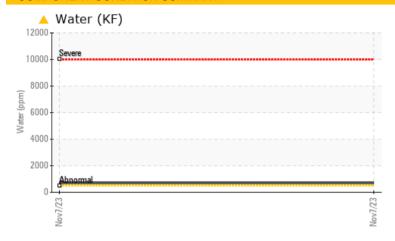

### RECOMMENDATION

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS											
Sample Status				ABNORMAL							
Water	%	ASTM D6304	>0.05	<b>△</b> 0.069							
ppm Water	mag	ASTM D6304	>500	<b>△</b> 697.1							

Customer Id: NORCAMNY Sample No.: KCPA009434 Lab Number: 06007716 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## RECOMMENDED ACTIONS

There are no recommended actions for this sample.

## HISTORICAL DIAGNOSIS



## **OIL ANALYSIS REPORT**

San

Sample Rating Trend

WATER

Machine Id

# KAESER 3546541 (S/N NOT GIVEN)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

#### Wear

All component wear rates are normal.

### Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid.

				Nov2023		
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009434		
Sample Date		Client Info		07 Nov 2023		
Machine Age	hrs	Client Info		16160		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	710	<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	ррпп	method	limit/base		hiotomid	
				current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	2		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	18685		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		15		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	<b>0.069</b>		
opm Water	ppm	ASTM D6304	>500	<u>▲</u> 697.1		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		756		
Particles >6µm		ASTM D7647	>1300	175		
Particles >14µm		ASTM D7647	>80	7		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/10		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩⊔/a	VSTM D804E	1.0	0.30		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.30



## **OIL ANALYSIS REPORT**

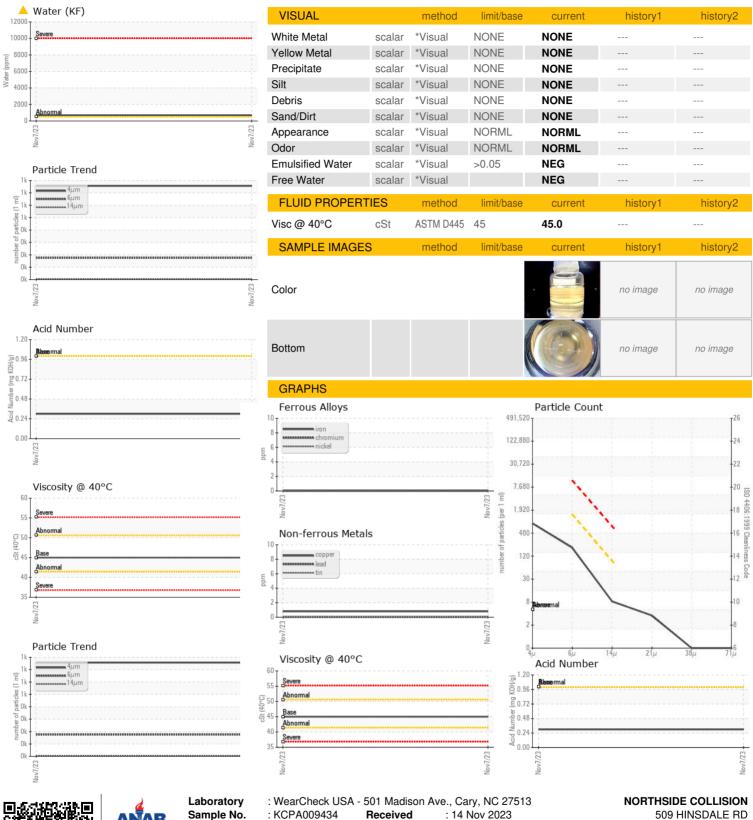





Certificate L2367

Sample No. Lab Number **Unique Number** 

: 06007716

: KCPA009434 : 10741478

Received Diagnosed

: 16 Nov 2023 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

509 HINSDALE RD CAMILLUS, NY US 13031

Contact: Service Manager

T: F: