

# PROBLEM SUMMARY

Sample Rating Trend



**WATER**





Machine Id  
**8438322 (S/N 1350)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## COMPONENT CONDITION SUMMARY

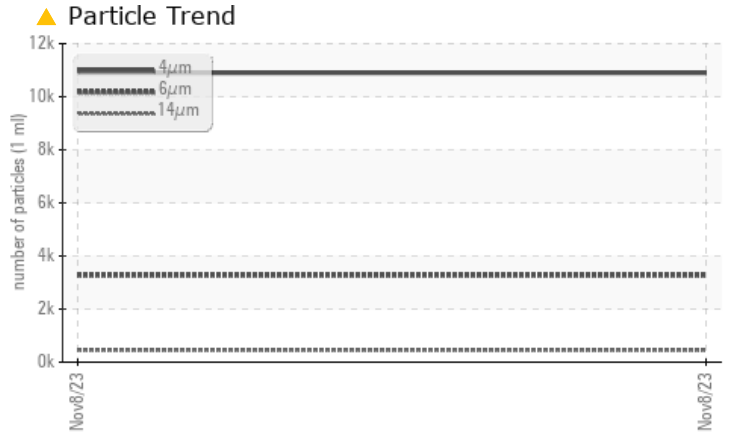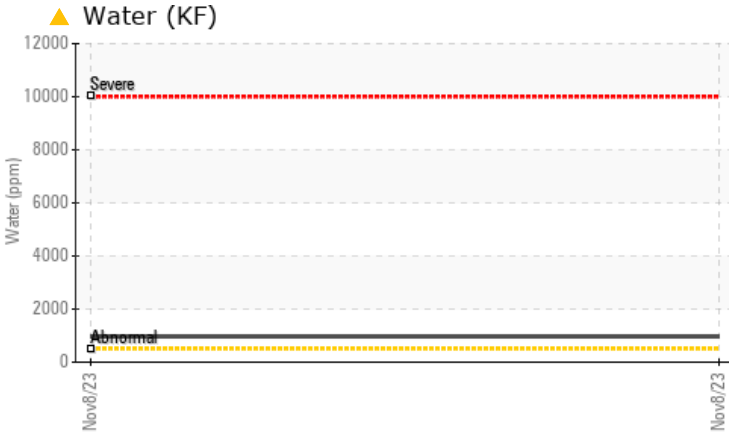

## RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Water	%	ASTM D6304	>0.05	<b>▲ 0.097</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>▲ 970</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 3274</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>▲ 451</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>▲ 177</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>▲ 12</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 21/19/16</b>	---	---

Customer Id: PRIOAK  
Sample No.: KC06007736  
Lab Number: 06007736  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)


## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

# OIL ANALYSIS REPORT

Sample Rating Trend

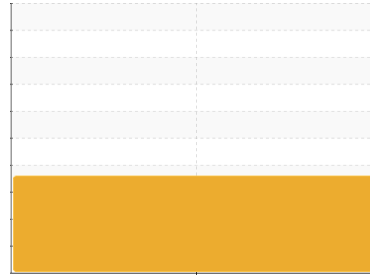

**WATER**



Machine Id  
**8438322 (S/N 1350)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC06007736</b>	---	---
Sample Date	Client Info	<b>08 Nov 2023</b>	---	---
Machine Age	hrs Client Info	<b>2961</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<b>0</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>0</b>	---	---
Nickel ppm ASTM D5185m	>3	<b>0</b>	---	---
Titanium ppm ASTM D5185m	>3	<b>&lt;1</b>	---	---
Silver ppm ASTM D5185m	>2	<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>10	<b>0</b>	---	---
Lead ppm ASTM D5185m	>10	<b>0</b>	---	---
Copper ppm ASTM D5185m	>50	<b>9</b>	---	---
Tin ppm ASTM D5185m	>10	<b>0</b>	---	---
Vanadium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m	90	<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>0</b>	---	---
Magnesium ppm ASTM D5185m	90	<b>0</b>	---	---
Calcium ppm ASTM D5185m	2	<b>0</b>	---	---
Phosphorus ppm ASTM D5185m		<b>0</b>	---	---
Zinc ppm ASTM D5185m		<b>0</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<b>0</b>	---	---
Sodium ppm ASTM D5185m		<b>10</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>7</b>	---	---
Water % ASTM D6304	>0.05	<b>▲ 0.097</b>	---	---
ppm Water ppm ASTM D6304	>500	<b>▲ 970</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		<b>10898</b>	---	---
Particles >6µm ASTM D7647	>1300	<b>▲ 3274</b>	---	---
Particles >14µm ASTM D7647	>80	<b>▲ 451</b>	---	---
Particles >21µm ASTM D7647	>20	<b>▲ 177</b>	---	---
Particles >38µm ASTM D7647	>4	<b>▲ 12</b>	---	---
Particles >71µm ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	<b>▲ 21/19/16</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	<b>0.31</b>	---	---


# OIL ANALYSIS REPORT

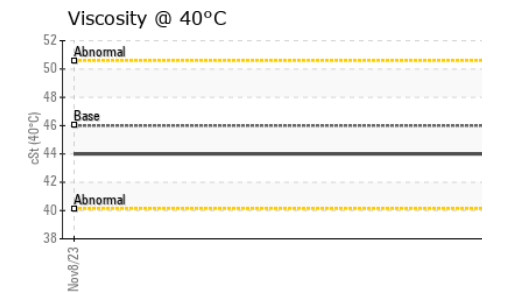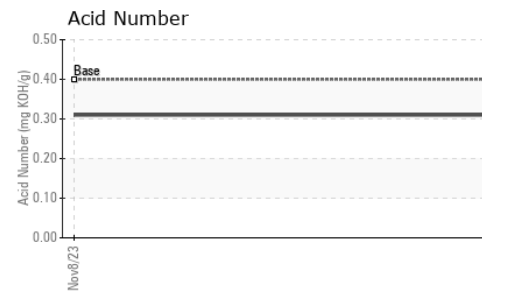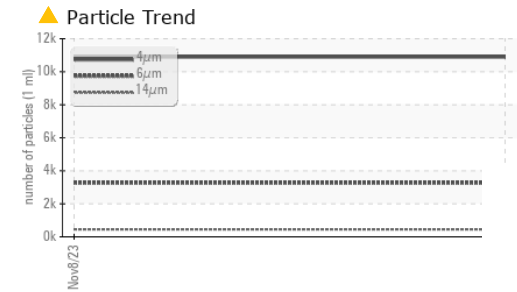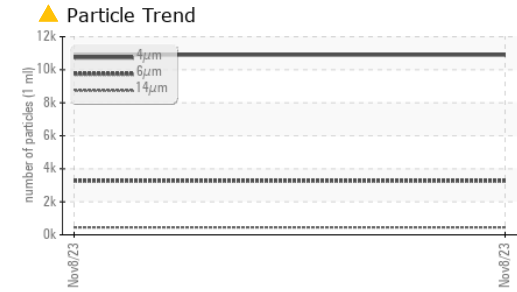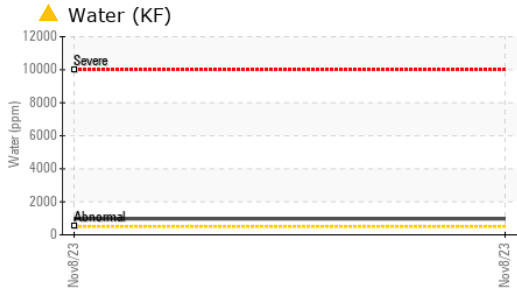





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

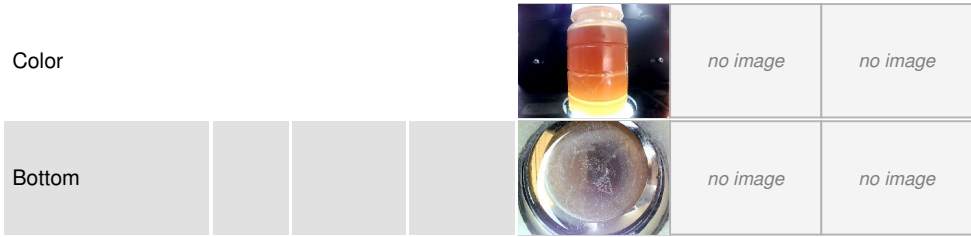

## GRAPHS

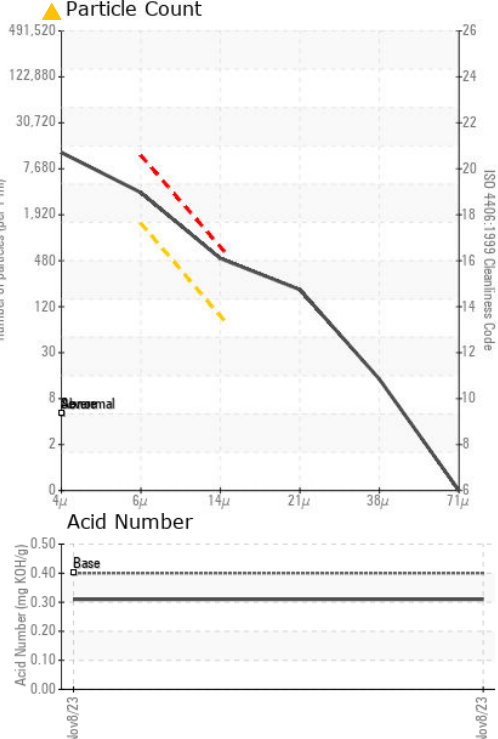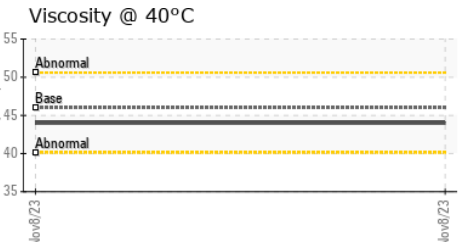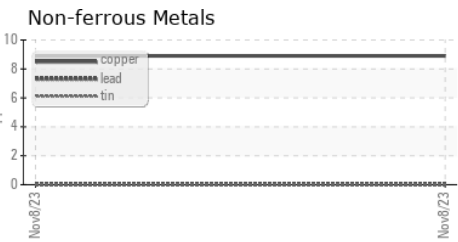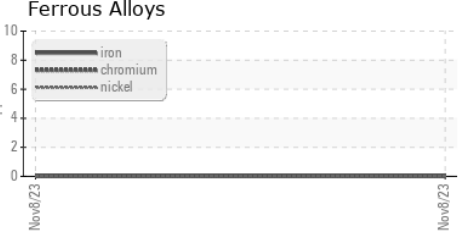

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06007736 **Received** : 14 Nov 2023  
**Lab Number** : 06007736 **Diagnosed** : 27 Nov 2023  
**Unique Number** : 10741498 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**PRIMEX PLASTICS**  
 3435 OLD OAKWOOD RD  
 OAKWOOD, GA  
 US 30566  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)