


PROBLEM SUMMARY

Sample Rating Trend



ISO

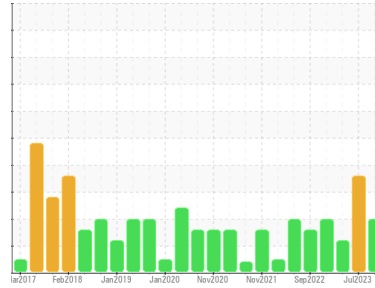


Machine Id
KAESER SK 20 5780309 (S/N 1903)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

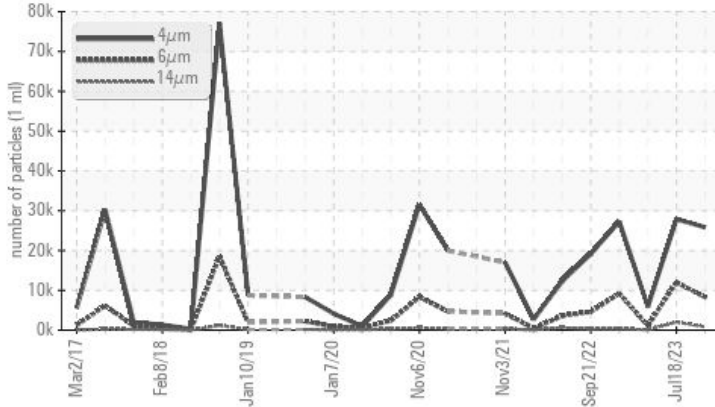

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 8298	▲ 12004	1126
Particles >14µm	ASTM D7647	>80	▲ 844	▲ 2022	▲ 89
Particles >21µm	ASTM D7647	>20	▲ 215	▲ 781	▲ 31
Particles >38µm	ASTM D7647	>4	▲ 6	▲ 55	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/17	▲ 22/21/18	▲ 20/17/14

Customer Id: AKIWIN
Sample No.: KC06007737
Lab Number: 06007737
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

18 Jul 2023 Diag: Don Baldrige

WATER



The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.

[view report](#)



17 Mar 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



08 Dec 2022 Diag: Jonathan Hester

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

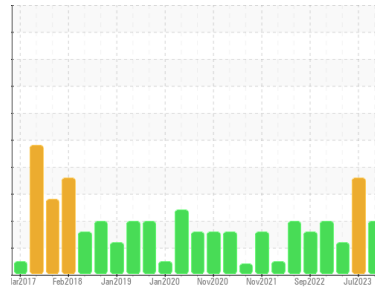

ISO



Machine Id
KAESER SK 20 5780309 (S/N 1903)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06007737	KC05909481	KC05813934
Sample Date	Client Info	31 Oct 2023	18 Jul 2023	17 Mar 2023
Machine Age	hrs	49386	47890	45372
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	4	8	12
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	0	<1	7
Calcium	ppm	ASTM D5185m 2	0	0	2
Phosphorus	ppm	ASTM D5185m	0	<1	4
Zinc	ppm	ASTM D5185m	0	0	19

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	10	<1	<1
Potassium	ppm	ASTM D5185m >20	0	1	0
Water	%	ASTM D6304 >0.05	0.011	▲ 0.113	0.009
ppm Water	ppm	ASTM D6304 >500	111.9	▲ 1131.8	98.1

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	25834	27872	5904
Particles >6µm	ASTM D7647 >1300	▲ 8298	▲ 12004	1126
Particles >14µm	ASTM D7647 >80	▲ 844	▲ 2022	▲ 89
Particles >21µm	ASTM D7647 >20	▲ 215	▲ 781	▲ 31
Particles >38µm	ASTM D7647 >4	▲ 6	▲ 55	1
Particles >71µm	ASTM D7647 >3	0	2	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/17	▲ 22/21/18	▲ 20/17/14

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.28	0.33	0.28

OIL ANALYSIS REPORT


▲ Particle Trend

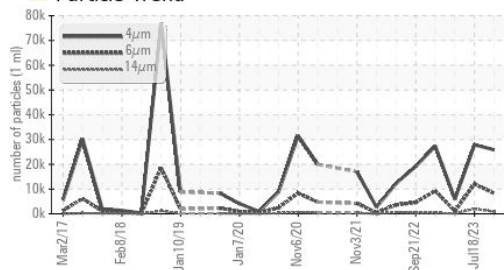


Water (KF)

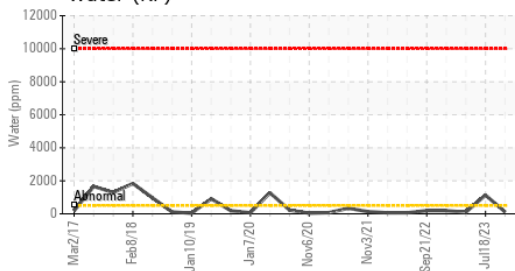


Acid Number

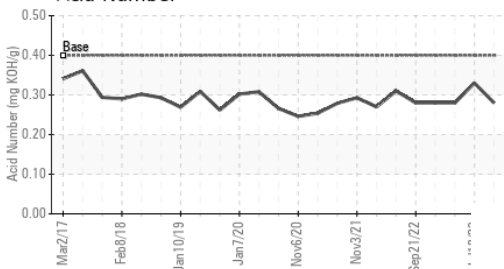

Water (KF)

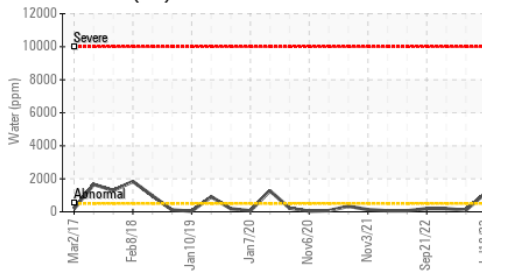

Viscosity @ 40°C

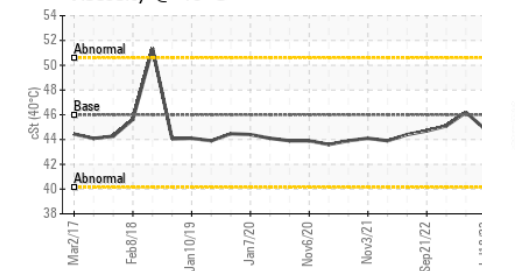


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	44.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

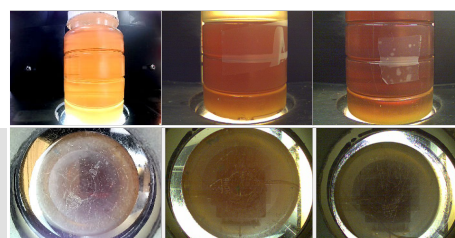


Bottom

GRAPHS


Ferrous Alloys

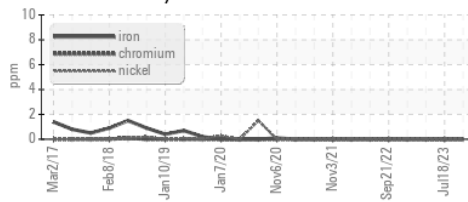


Non-ferrous Metals

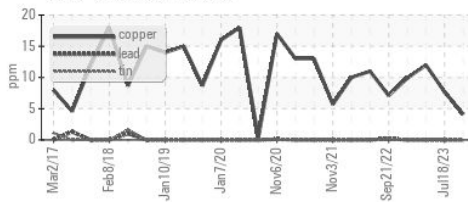


Viscosity @ 40°C

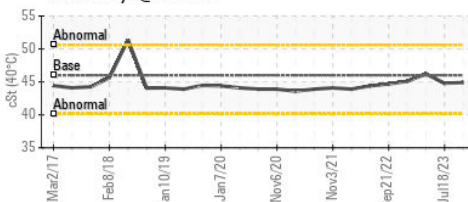

▲ Particle Count

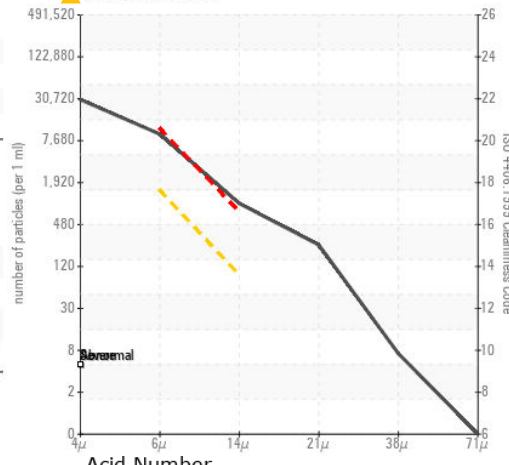

Acid Number

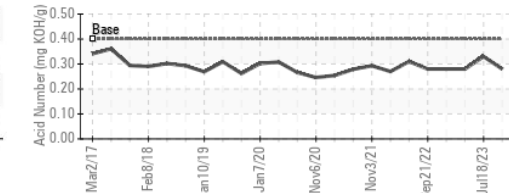

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06007737 **Received** : 14 Nov 2023
Lab Number : 06007737 **Diagnosed** : 16 Nov 2023
Unique Number : 10741499 **Diagnostician** : Don Baldrige
Test Package : IND 2

AKINS FORD
 220 W MAY ST
 WINDER, GA
 US 30680
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: