




PROBLEM SUMMARY


Sample Rating Trend

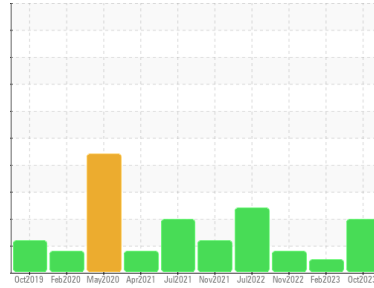

Machine Id
KAESER SK 15 3195990 (S/N 1648)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

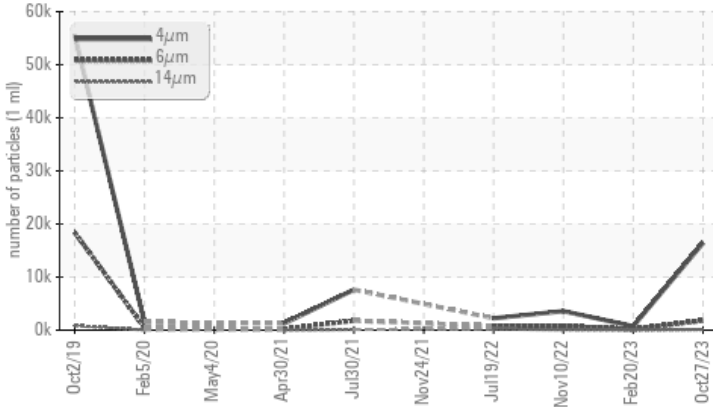

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1815	154	782
Particles >14µm	ASTM D7647	>80	▲ 112	7	76
Particles >21µm	ASTM D7647	>20	▲ 52	2	23
Particles >38µm	ASTM D7647	>4	▲ 7	0	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/18/14	17/14/10	19/17/13

Customer Id: PERBOW
 Sample No.: KC06007738
 Lab Number: 06007738
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

20 Feb 2023 Diag: Doug Bogart

NORMAL



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 Nov 2022 Diag: Angela Borella

WEAR



No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Jul 2022 Diag: Jonathan Hester

WEAR



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

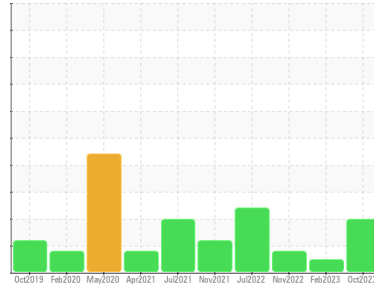

Machine Id
KAESER SK 15 3195990 (S/N 1648)

Component
Compressor
Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06007738	KC05792121	KC05700866
Sample Date	Client Info	27 Oct 2023	20 Feb 2023	10 Nov 2022
Machine Age	hrs	57953	55127	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ATTENTION	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	3	7	9
Chromium ppm	ASTM D5185m >10	0	0	0
Nickel ppm	ASTM D5185m >3	0	0	0
Titanium ppm	ASTM D5185m >3	<1	0	0
Silver ppm	ASTM D5185m >2	0	0	0
Aluminum ppm	ASTM D5185m >10	2	6	▲ 22
Lead ppm	ASTM D5185m >10	0	0	0
Copper ppm	ASTM D5185m >50	3	<1	<1
Tin ppm	ASTM D5185m >10	0	0	0
Vanadium ppm	ASTM D5185m	<1	0	0
Cadmium ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	0	0
Barium ppm	ASTM D5185m	0	0	0
Molybdenum ppm	ASTM D5185m	0	0	0
Manganese ppm	ASTM D5185m	0	0	0
Magnesium ppm	ASTM D5185m	0	0	0
Calcium ppm	ASTM D5185m	0	0	0
Phosphorus ppm	ASTM D5185m 500	195	377	481
Zinc ppm	ASTM D5185m	247	330	399

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	0	<1	0
Sodium ppm	ASTM D5185m	2	0	0
Potassium ppm	ASTM D5185m >20	0	<1	0
Water %	ASTM D6304 >0.05	0.006	0.005	0.007
ppm Water	ASTM D6304 >500	63.3	54.5	78.6






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	16429	737	3578
Particles >6µm	ASTM D7647 >1300	▲ 1815	154	782
Particles >14µm	ASTM D7647 >80	▲ 112	7	76
Particles >21µm	ASTM D7647 >20	▲ 52	2	23
Particles >38µm	ASTM D7647 >4	▲ 7	0	1
Particles >71µm	ASTM D7647 >3	▲ 1	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/18/14	17/14/10	19/17/13

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.5	0.61	1.16	1.12

OIL ANALYSIS REPORT

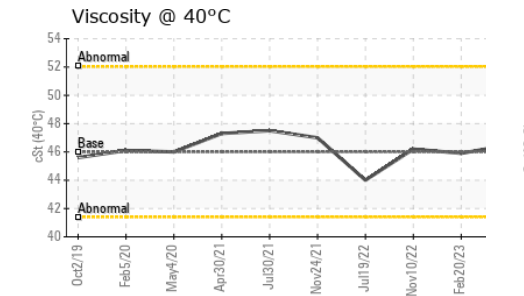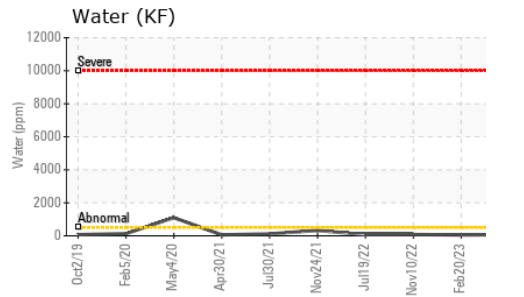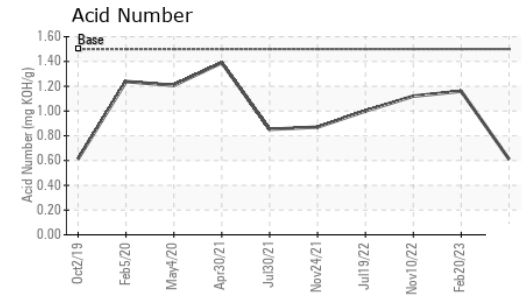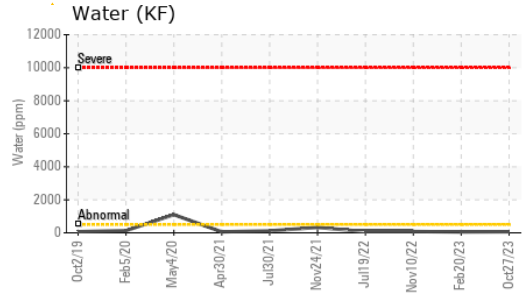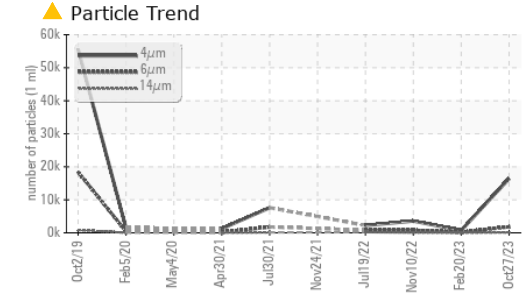





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.5	45.9	46.2

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

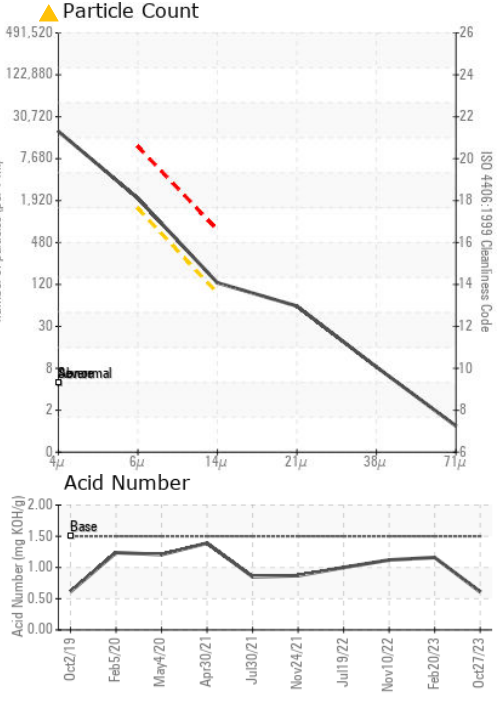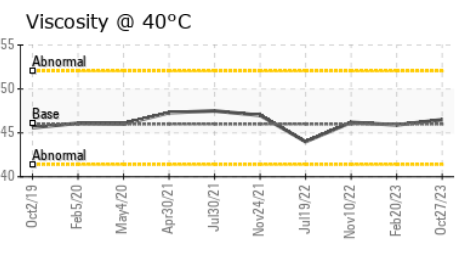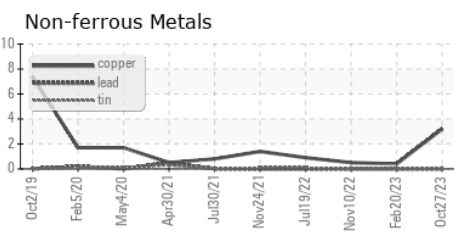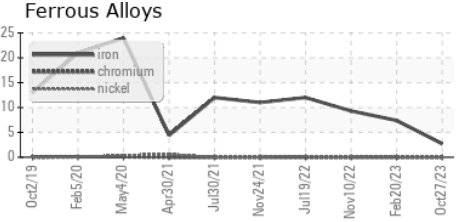

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06007738
Lab Number : 06007738
Unique Number : 10741500
Test Package : IND 2

PERDUE AGRIBUSINESS
 203 W MAIN ST
 BOWERSVILLE, GA
 US 30176
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)