




# OIL ANALYSIS REPORT

Sample Rating Trend

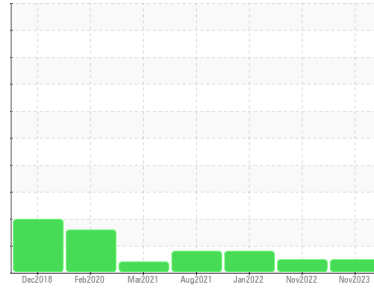

**NORMAL**



Machine Id  
**KAESER ASD 40ST 4295394 (S/N 1029)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC06007741</b>	KC05700868	KC05444095
Sample Date	Client Info			<b>02 Nov 2023</b>	14 Nov 2022	04 Jan 2022
Machine Age	hrs	Client Info		<b>56206</b>	52867	49946
Oil Age	hrs	Client Info		<b>0</b>	0	2666
Oil Changed	Client Info			<b>N/A</b>	Changed	Not Chngd
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	3
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	13	8
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>2</b>	3	8
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	12	39
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	1
Phosphorus	ppm	ASTM D5185m		<b>0</b>	9	13
Zinc	ppm	ASTM D5185m		<b>0</b>	14	19

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>18</b>	5	20
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.011	0.014
ppm Water	ppm	ASTM D6304	>500	<b>81.0</b>	117.3	141.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2165</b>	1930	6611
Particles >6µm		ASTM D7647	>1300	<b>578</b>	437	1115
Particles >14µm		ASTM D7647	>80	<b>42</b>	32	▲ 92
Particles >21µm		ASTM D7647	>20	<b>8</b>	12	▲ 26
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/13</b>	18/16/12	▲ 17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.30</b>	0.30	0.369


# OIL ANALYSIS REPORT

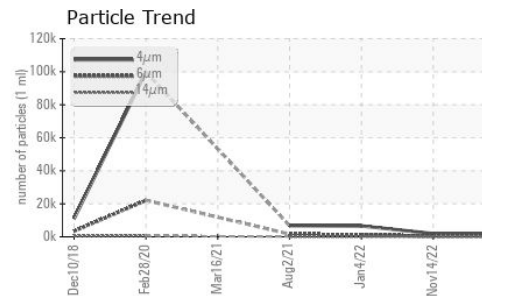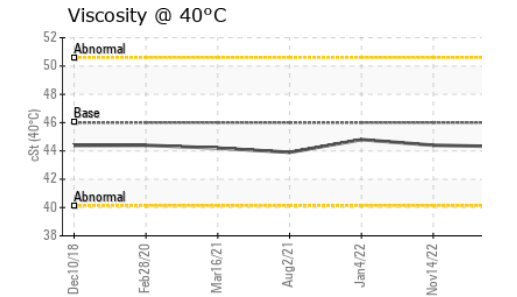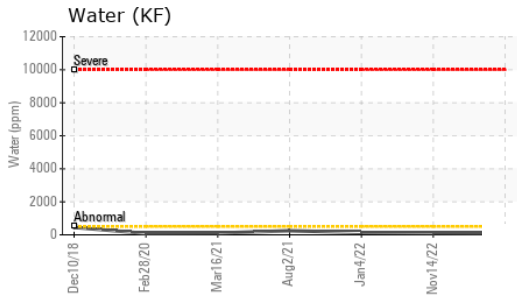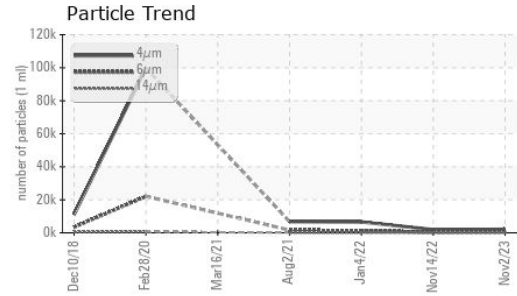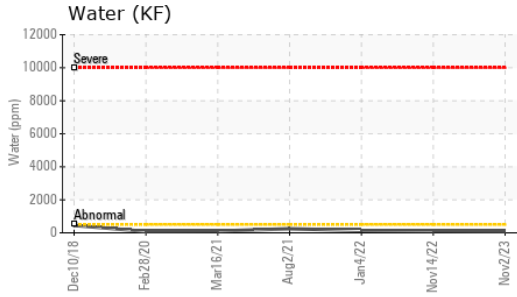






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	44.4	44.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

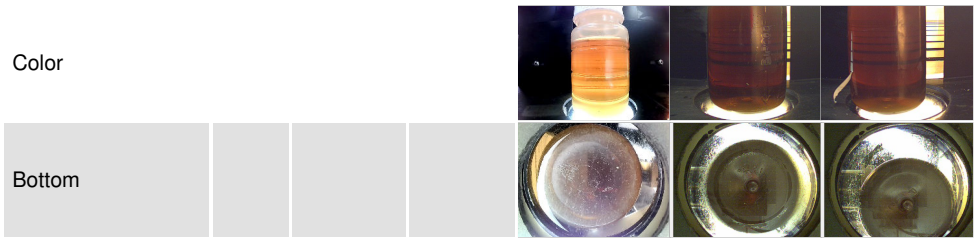

## GRAPHS

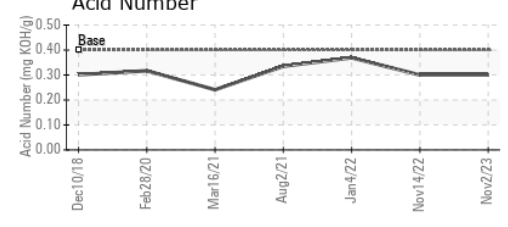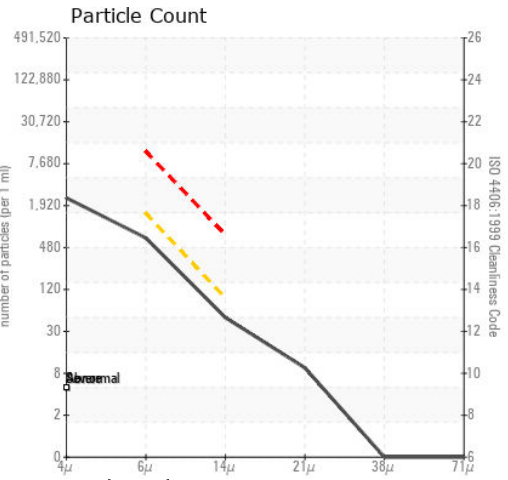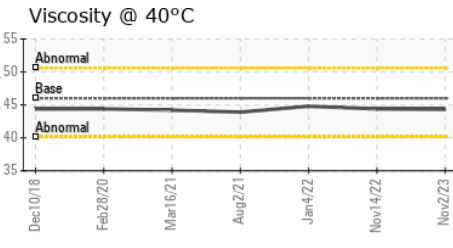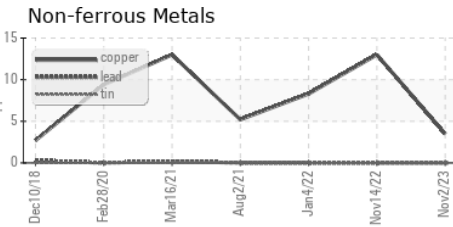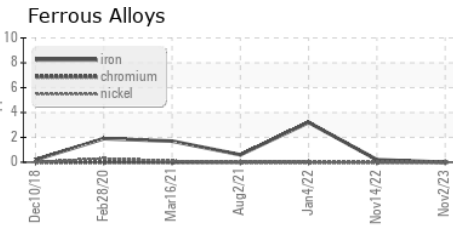

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06007741 **Received** : 14 Nov 2023  
**Lab Number** : 06007741 **Diagnosed** : 16 Nov 2023  
**Unique Number** : 10741503 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ALBAFORM**  
 5405 RAFF BANKS DR  
 FLOWERY BRANCH, GA  
 US 30542  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: