

PROBLEM SUMMARY

Sample Rating Trend


ISO

Machine Id KAESER SK 20T 5368260 (S/N 1473)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

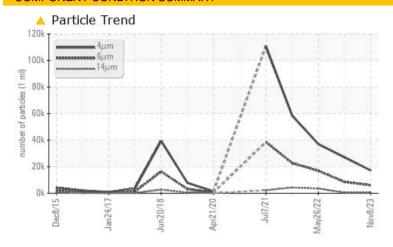

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	△ 6056	<u>▲</u> 8523	<u>▲</u> 16925				
Particles >14µm	ASTM D7647	>80	△ 526	456	<u></u> 3503				
Particles >21µm	ASTM D7647	>20	129	6 0	<u></u> 874				
Oil Cleanliness	ISO 4406 (c)	>17/13	20/16	<u>^</u> 20/16	<u>^</u> 21/19				

Customer Id: NEWARD Sample No.: KC06007746 Lab Number: 06007746 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

19 Apr 2023 Diag: Don Baldridge

WATER



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



26 May 2022 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



29 Nov 2021 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER SK 20T 5368260 (S/N 1473)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2015	Jan 2017 Jun 2018	Apr2020 Jul2021 May2022	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06007746	KC05830266	KC05592603
Sample Date		Client Info		08 Nov 2023	19 Apr 2023	26 May 2022
Machine Age	hrs	Client Info		27984	25506	21109
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m		0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m		14	20	21
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m	00	<1	2	<1
Magnesium	ppm	ASTM D5185m	90	0	14	4
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus Zinc	ppm	ASTM D5185m		0	<1 36	6 18
	ppm	ASTM D5185m		6		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		15	4	1
Potassium	ppm	ASTM D5185m		0	2	0
Water	%	ASTM D6304		0.016	△ 0.151	0.013
ppm Water	ppm	ASTM D6304		165.4	<u> 1510</u>	137.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		17187	27079	37010
Particles >6µm		ASTM D7647		<u>^</u> 6056	<u>▲</u> 8523	<u>▲</u> 16925
Particles >14μm		ASTM D7647	>80	▲ 526	<u>456</u>	▲ 3503
Particles >21µm		ASTM D7647	>20	<u>^</u> 129	<u>^</u> 60	▲ 874 ▲ 50
Particles >38µm		ASTM D7647	>4	3	1	<u></u> 50
Particles >71µm		ASTM D7647		0	0	<u>A</u> 3
Oil Cleanliness		ISO 4406 (c)	>17/13	<u>^</u> 20/16	<u>20/16</u>	<u>^</u> 21/19
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.23	0.32	0.34



OIL ANALYSIS REPORT





Certificate L2367

Sample No. Lab Number **Unique Number**

: KC06007746 : 06007746

: 10741508 : IND 2

: 14 Nov 2023 Received : 16 Nov 2023 Diagnosed

Diagnostician : Don Baldridge

Test Package To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ARDEN, NC

US 28704

Contact:

T: F: