




# OIL ANALYSIS REPORT

Sample Rating Trend

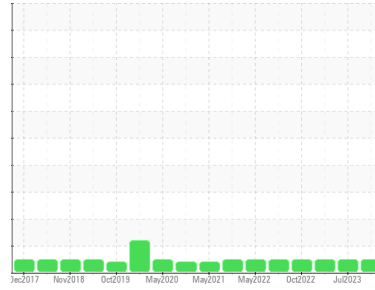

**NORMAL**



Area  
**21**  
Machine Id  
**[21] A21 R1A**  
Component  
**Agitator Gearbox**  
Fluid  
**Turbine Life 100 (1 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Particle count performed inadvertently. ( Customer Sample Comment: Turbine Life 100 )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>HPL0003004</b>	HPL0003184	HPL0002771
Sample Date	Client Info			<b>10 Nov 2023</b>	18 Jul 2023	05 May 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>20880</b>	16560	12240
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	<b>0</b>	1	3
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	1	<1
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	2
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	4
Calcium	ppm	ASTM D5185m		<b>171</b>	186	180
Phosphorus	ppm	ASTM D5185m		<b>13</b>	9	9
Zinc	ppm	ASTM D5185m		<b>9</b>	8	23
Sulfur	ppm	ASTM D5185m		<b>20474</b>	23945	19259


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>751</b>	---	---
Particles >6µm		ASTM D7647	>5000	<b>181</b>	---	---
Particles >14µm		ASTM D7647	>640	<b>15</b>	---	---
Particles >21µm		ASTM D7647	>160	<b>4</b>	---	---
Particles >38µm		ASTM D7647	>40	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>17/15/11</b>	---	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.14</b>	0.16	0.23

# OIL ANALYSIS REPORT


Particle Trend

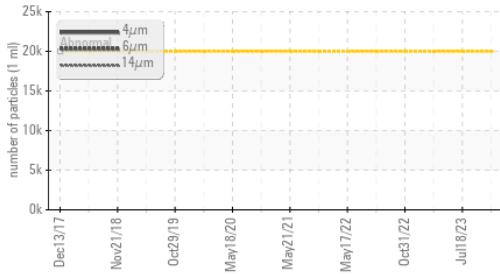


Acid Number

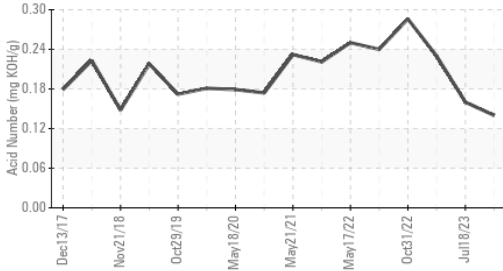

Viscosity @ 40°C

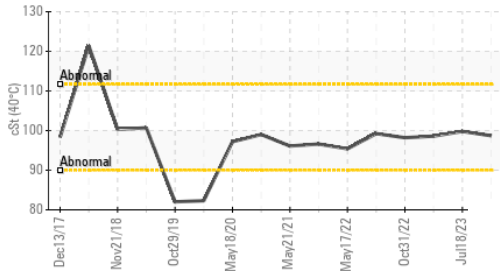


Particle Trend

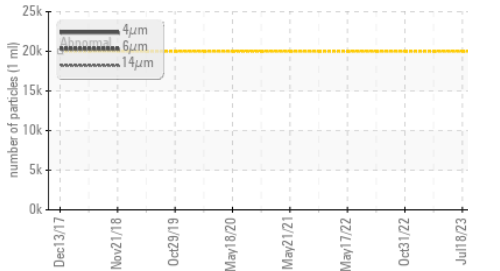






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7	99.8	98.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

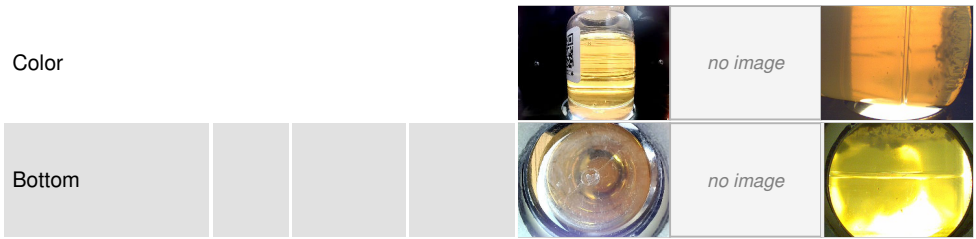

## GRAPHS

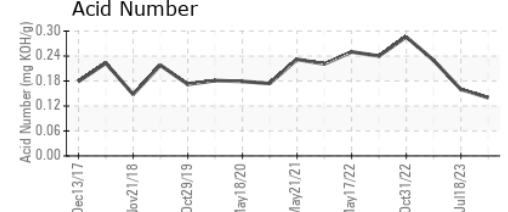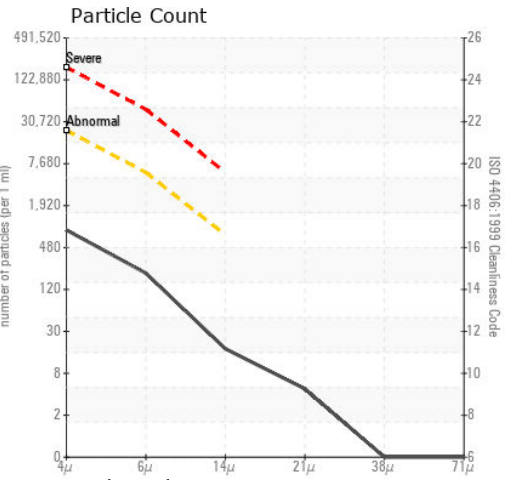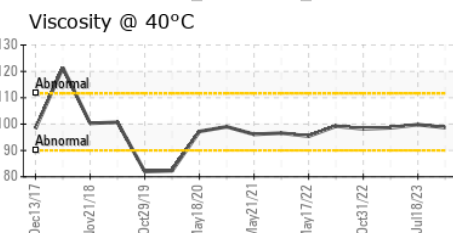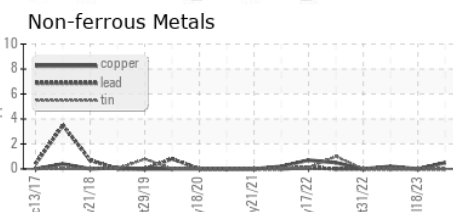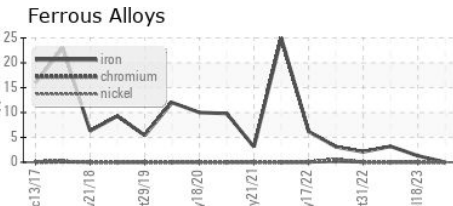

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HPL0003004 **Received** : 15 Nov 2023  
**Lab Number** : 06008295 **Diagnosed** : 29 Nov 2023  
**Unique Number** : 10742057 **Diagnostician** : Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**KENSING**  
 2525 S KENSINGTON RD  
 KANKAKEE, IL  
 US 60901  
 Contact: TIM HUBERT  
 timothy.hubert@kensingolutions.com  
 T: (815)939-8918  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)