



# PROBLEM SUMMARY

Sample Rating Trend



ISO




Machine Id  
**8668233 (S/N 1544)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

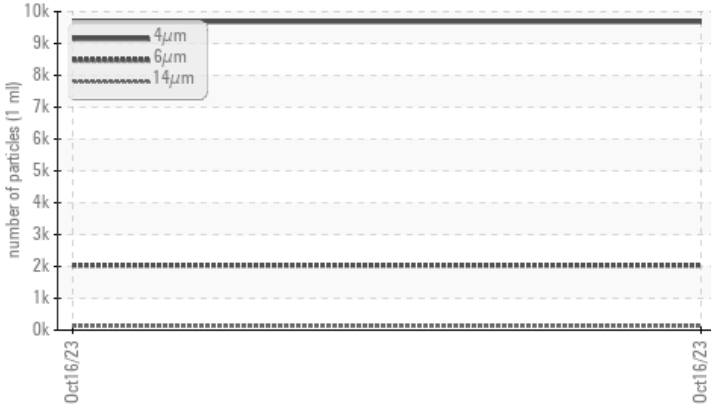

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ATTENTION</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>2034</b>	---	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>128</b>	---	---	---
Particles >21µm	ASTM D7647	>20	▲ <b>28</b>	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/18/14</b>	---	---	---

Customer Id: CAPARV  
Sample No.: KCPA000560  
Lab Number: 06008315  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**8668233 (S/N 1544)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA000560</b>	---	---
Sample Date	Client Info	<b>16 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>2312</b>	---
Oil Age	hrs	Client Info	<b>0</b>	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ATTENTION</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	90	<b>18</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	100	<b>79</b>	---	---
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>8</b>	---	---
Sulfur	ppm	ASTM D5185m	23500	<b>21688</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>11</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water	%	ASTM D6304	>0.05	<b>0.012</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>121.4</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>9684</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 2034</b>	---
Particles >14µm	ASTM D7647	>80	<b>▲ 128</b>	---
Particles >21µm	ASTM D7647	>20	<b>▲ 28</b>	---
Particles >38µm	ASTM D7647	>4	<b>1</b>	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.34</b>	---	---

# OIL ANALYSIS REPORT

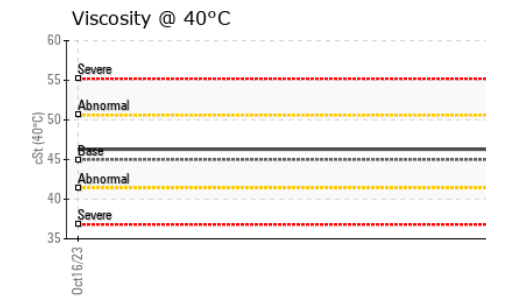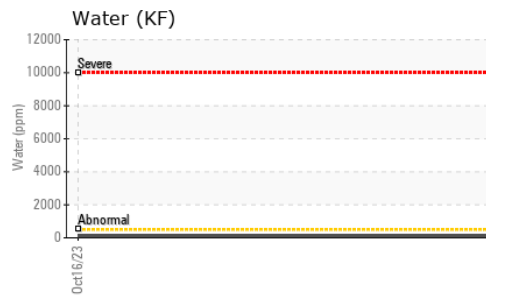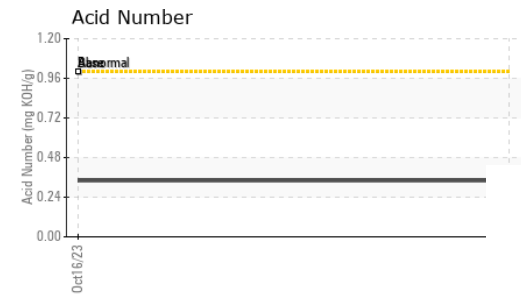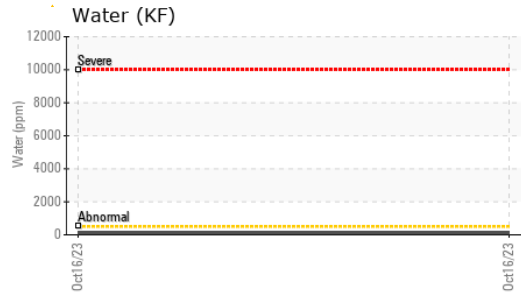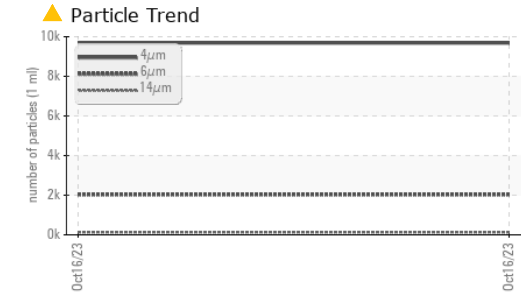





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	46.3	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

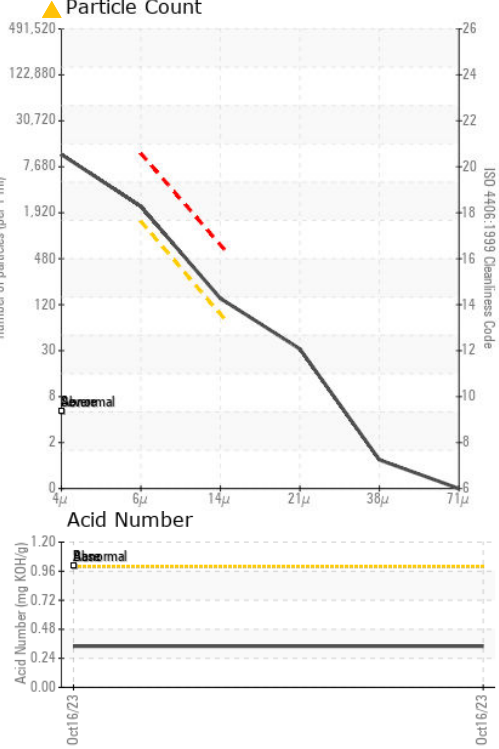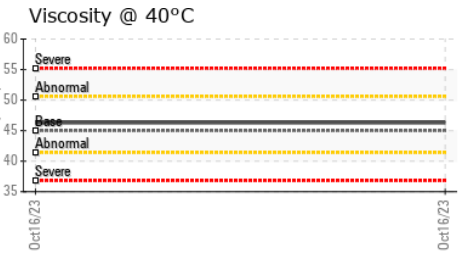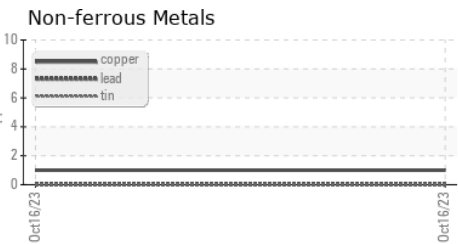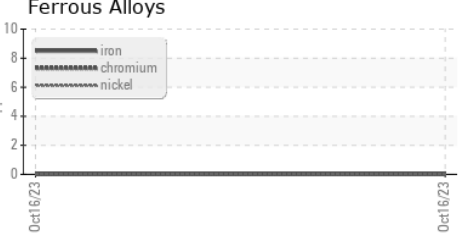

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA000560 **Received** : 15 Nov 2023  
**Lab Number** : 06008315 **Diagnosed** : 17 Nov 2023  
**Unique Number** : 10742077 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CAPPELLOS**  
 5620 KENDALL CT, UNIT C  
 ARVADA, CO  
 US 80002  
 Contact: LUIS  
 luis@cappellos.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)