




# OIL ANALYSIS REPORT

Sample Rating Trend

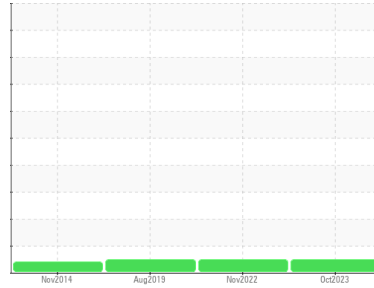

**NORMAL**



Machine Id  
**KAESER AIRCENTER SK 15 4588514 (S/N 1331)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA006568</b>	KCP28682	KCP11242
Sample Date	Client Info		<b>27 Oct 2023</b>	17 Nov 2022	19 Aug 2019
Machine Age	hrs	Client Info	<b>26759</b>	24526	15258
Oil Age	hrs	Client Info	<b>0</b>	2569	2994
Oil Changed	Client Info		<b>N/A</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>2</b>	3	3
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>14</b>	0	7
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 100	<b>82</b>	61	68
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	3	1
Zinc	ppm	ASTM D5185m 0	<b>5</b>	2	4
Sulfur	ppm	ASTM D5185m 23500	<b>21008</b>	24833	19744

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>10</b>	4	12
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	<1
Water	%	ASTM D6304 >0.05	<b>0.008</b>	0.006	0.029
ppm Water	ppm	ASTM D6304 >500	<b>80.2</b>	61.5	290






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1136</b>	4011	5670
Particles >6µm	ASTM D7647 >1300		<b>104</b>	973	967
Particles >14µm	ASTM D7647 >80		<b>8</b>	48	67
Particles >21µm	ASTM D7647 >20		<b>3</b>	10	16
Particles >38µm	ASTM D7647 >4		<b>1</b>	0	0
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>17/14/10</b>	19/17/13	17/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.33</b>	0.342	0.380


# OIL ANALYSIS REPORT

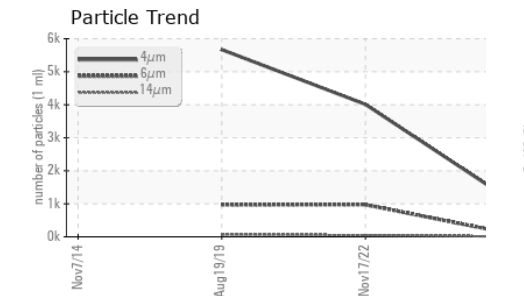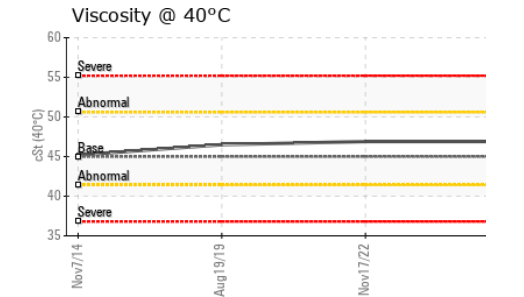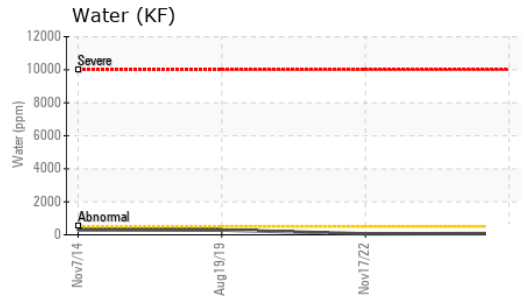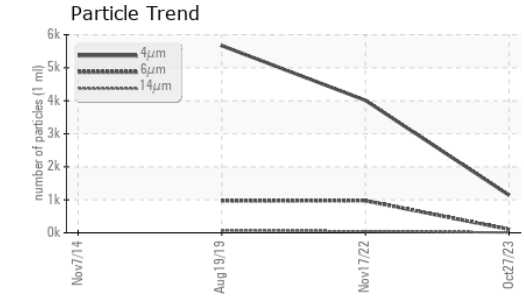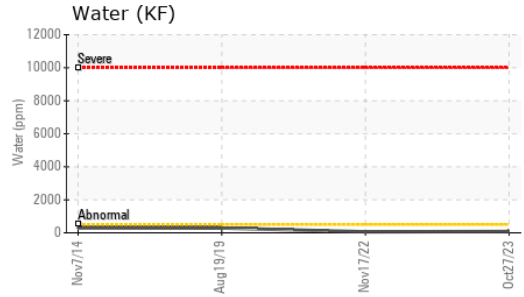






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.9	46.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

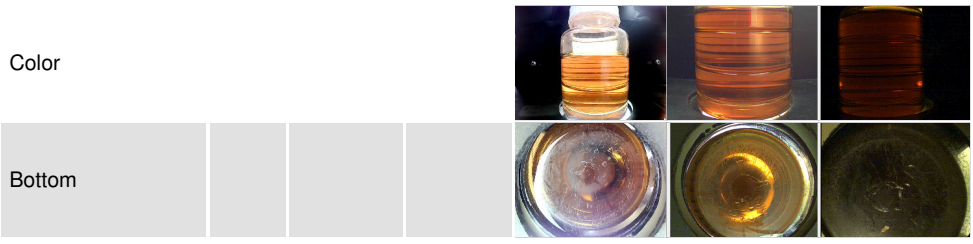

## GRAPHS

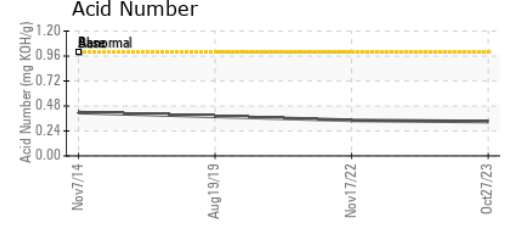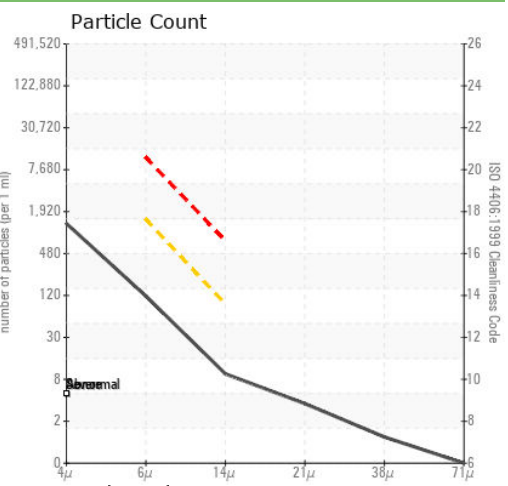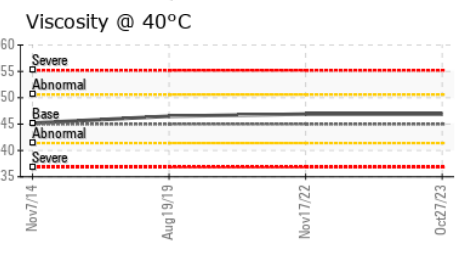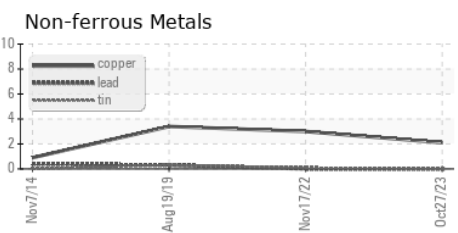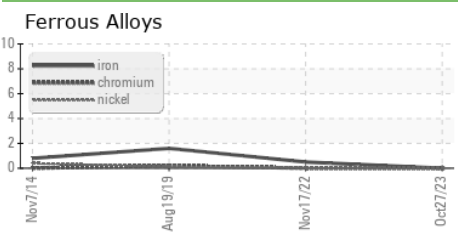

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006568 **Received** : 15 Nov 2023  
**Lab Number** : 06008316 **Diagnosed** : 30 Nov 2023  
**Unique Number** : 10742078 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**US PRECISION MOLD**  
 14700 W 66TH PLACE  
 ARVADA, CO  
 US 80004  
 Contact: JEFF  
 jeff@usprecisionmold.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)