


PROBLEM SUMMARY

KAESER SK 15 6751842 (S/N 1331) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

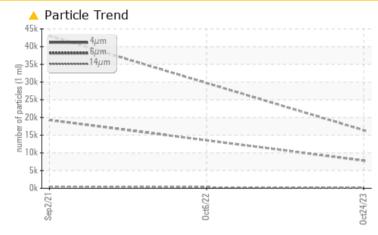

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL			
Particles >6µm	ASTM D7647 >1	300 🔺 7805		1 9281			
Particles >14µm	ASTM D7647 >8	0 🔺 194		4 57			
Oil Cleanliness	ISO 4406 (c) >	/17/13 🔺 21/20/15		1 /16			


Customer Id: SYSDEN Sample No.: KCPA006444 Lab Number: 06008332 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

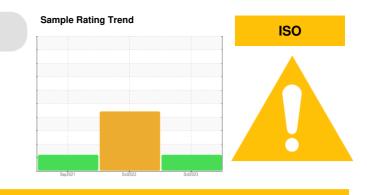

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Oct 2022 Diag: Doug Bogart



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



02 Sep 2021 Diag: Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

KAESER SK 15 6751842 (S/N 1331)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

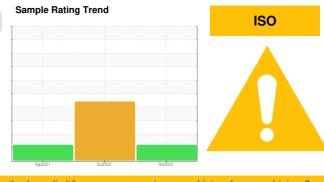

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006444	KCP50483	KCP42496
Sample Date		Client Info		24 Oct 2023	06 Oct 2022	02 Sep 2021
Machine Age	hrs	Client Info		10322	7385	4020
Oil Age	hrs	Client Info		0	735	2265
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	12	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	2
Barium	ppm	ASTM D5185m	90	2	0	7
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	49	24	65
Calcium	ppm	ASTM D5185m	0	0	<1	<1
Phosphorus	ppm	ASTM D5185m	0	<1	4	2
Zinc	ppm	ASTM D5185m	0	13	15	2
Sulfur	ppm	ASTM D5185m	23500	21113	23682	17569
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		4	0	11
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.05	0.010	▲ 0.388	0.026
ppm Water	ppm	ASTM D6304	>500	103.5	▲ 3880	260.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		16391		43059
Particles >6µm		ASTM D7647	>1300	A 7805		1 9281
Particles >14µm		ASTM D7647	>80	1 94		4 57
Particles >21µm		ASTM D7647	>20	10		4 0
Particles >38µm		ASTM D7647	>4	1		2
Particles >71µm		ASTM D7647	>3	0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 21/20/15		1 /16

FLUID DEGRADATION Acid Number (AN) mg KOH

mg KOH/g ASTM D8045 1.0

method

limit/base

0.35 0.38 0.360

history1

Report Id: SYSDEN [WUSCAR] 06008332 (Generated: 11/17/2023 11:15:23) Rev: 1


Contact/Location: Service Manager - SYSDEN


current


history2



OIL ANALYSIS REPORT






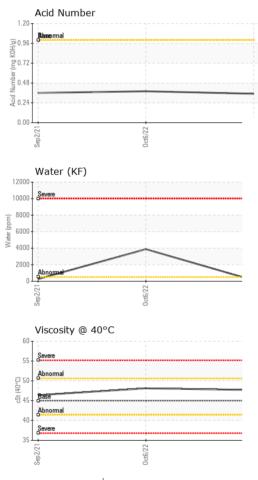

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	🔺 MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	🔺 HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%	NEG
Free Water	scalar	*Visual		NEG	▲ 1.0	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.7	48.1	46.4
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Color						
Bottom						

Bottom

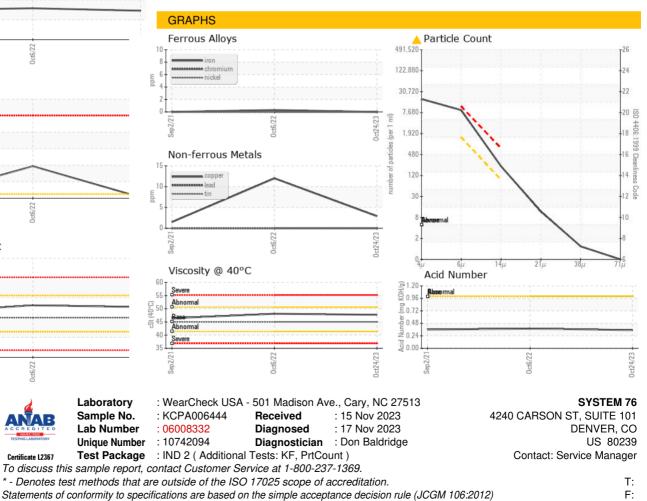

Contact/Location: Service Manager - SYSDEN