

## **OIL ANALYSIS REPORT**

#### Sample Rating Trend

# **NORMAL**

# FES BOOSTER 3 (S/N 01174-006-1-01-01)

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)





#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0003684		
Sample Date		Client Info		14 Nov 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	<1		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	14		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.01	0.001		
ppm Water	ppm	ASTM D6304	>100	7.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	921		
Particles >6µm		ASTM D7647	>2500	251		
Particles >14µm		ASTM D7647	>320	14		
Particles >21µm		ASTM D7647	>80	3		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A sid Niveshau (ANI)	ma 1/011/-	ACTM DOZ4	0.005	0.014		


Acid Number (AN)

0.014

mg KOH/g ASTM D974 0.005



### **OIL ANALYSIS REPORT**

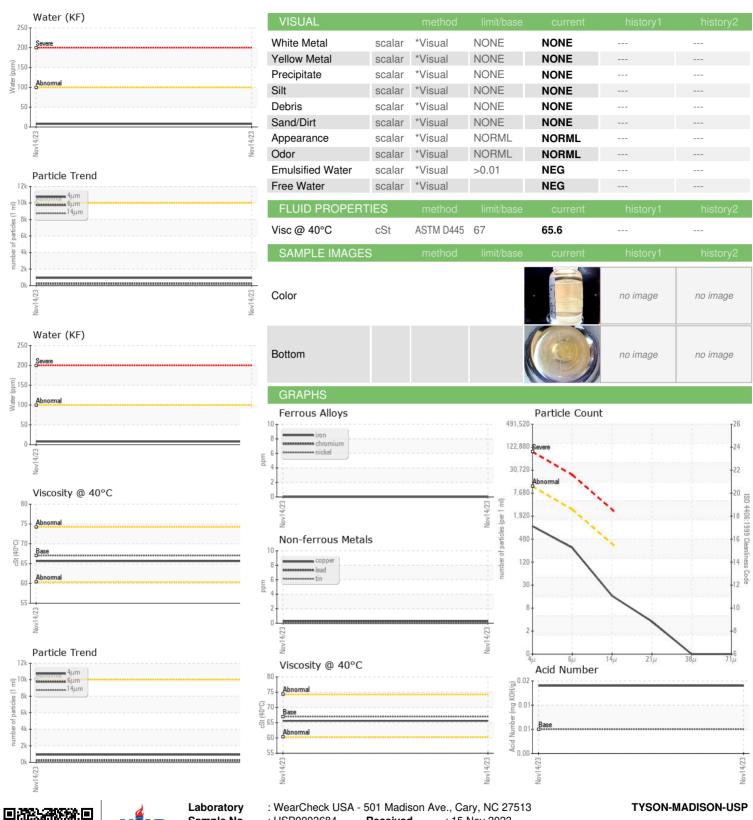



Sample No. Lab Number **Unique Number** 

: USP0003684 : 06008365

: 10742127 : IND 2

: 15 Nov 2023 Received Diagnosed : 16 Nov 2023 Diagnostician

: Doug Bogart

Test Package Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MADISON, NE US

Contact: RICK DUVAL

Contact/Location: RICK DUVAL - TYSMAD

T: (402)423-6375 F: (402)423-6661