

PROBLEM SUMMARY

Sample Rating Trend




Machine Id C-1702A WEST (S/N MK55-271)

Refrigeration Compressor

FES 4 (210 GAL)

COMPONENT CONDITION SUMMARY

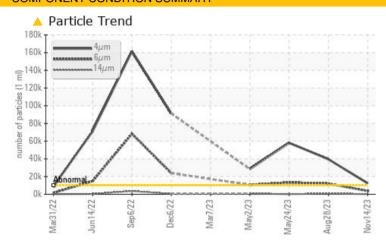

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status		ATTENTION	ABNORMAL	ABNORMAL				
Particles >4μm	ASTM D7647 >1	0000 🔺 12311	<u>▲</u> 39550	<u></u> 58146				
Particles >6µm	ASTM D7647 >2	2500 A 3669	<u> </u>	<u> </u>				
Oil Cleanliness	ISO 4406 (c) >2	20/18/15 🔺 21/19/15	<u>^</u> 22/21/17	23/21/15				

Customer Id: RECSIL_USP Sample No.: USP247263 Lab Number: 06008395 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 Aug 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



24 May 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



02 May 2023 Diag: Doug Bogart

ISO




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



C-1702A WEST (S/N MK55-271)

Refrigeration Compressor

FES 4 (210 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2022 Jur	2022 Sep2022 Dec2022	Mar2023 May2023 May2023 Aug20	023 Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP247263	USP248447	USP248450
Sample Date		Client Info		14 Nov 2023	28 Aug 2023	24 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	5	5	3
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	<1	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		<1	0	0
Sulfur	ppm	ASTM D5185m		3	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4	4	5
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	<1
Water	%	ASTM D6304	>0.01	0.005	0.005	0.002
ppm Water	ppm	ASTM D6304	>100	54.3	58.7	21.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<u> </u>	△ 39550	<u></u> 58146
Particles >6µm		ASTM D7647	>2500	△ 3669	<u>▲</u> 11980	▲ 13309
Particles >14µm		ASTM D7647	>320	211	808	172
Particles >21µm		ASTM D7647	>80	36	▲ 179	11
Particles >38μm		ASTM D7647	>20	0	3	1
Particles >71µm		ASTM D7647	>4	0	0	1
Oil Cleanliness		ISO 4406 (c)	>20/18/15	2 1/19/15	<u>△</u> 22/21/17	<u>△</u> 23/21/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014	0.014	0.015



OIL ANALYSIS REPORT



Certificate L2367

Test Package

: IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Contact: Service Manager