


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

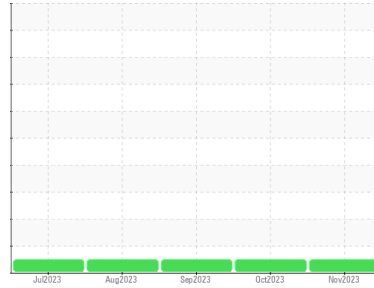

Machine Id  
**MRC-320**  
Component  
**Compressor**  
Fluid  
**NOT GIVEN (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO60001729</b>	TO60001656	TO60001425
Sample Date	Client Info			<b>04 Nov 2023</b>	12 Oct 2023	05 Sep 2023
Machine Age	hrs Client Info			<b>4684</b>	4304	2915
Oil Age	hrs Client Info			<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>97</b>	84	127
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>10</b>	16	27
Calcium	ppm	ASTM D5185m		<b>1279</b>	1237	1341
Phosphorus	ppm	ASTM D5185m		<b>315</b>	298	292
Zinc	ppm	ASTM D5185m		<b>336</b>	327	317
Sulfur	ppm	ASTM D5185m		<b>2610</b>	2227	1230

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	3	2
Sodium	ppm	ASTM D5185m		<b>3</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	2	<1
Water	%	ASTM D6304	>0.1	<b>0.019</b>	0.010	0.036
ppm Water	ppm	ASTM D6304	>1000	<b>199.0</b>	102.7	366.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>5522</b>	3056	1658
Particles >6µm		ASTM D7647	>2500	<b>1413</b>	635	304
Particles >14µm		ASTM D7647	>320	<b>53</b>	18	22
Particles >21µm		ASTM D7647	>80	<b>10</b>	4	5
Particles >38µm		ASTM D7647	>20	<b>1</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/13</b>	19/16/11	18/15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.52</b>	0.77	0.91

# OIL ANALYSIS REPORT

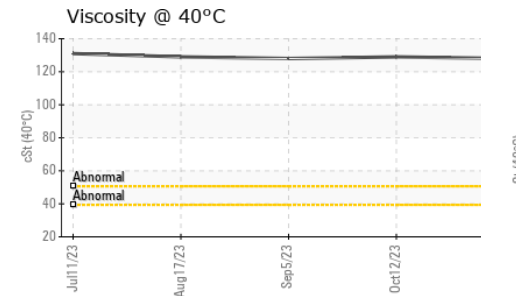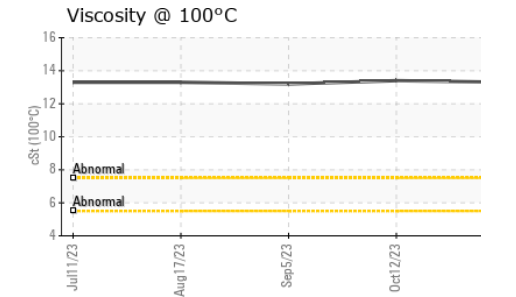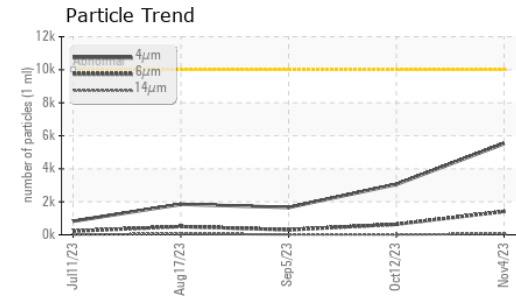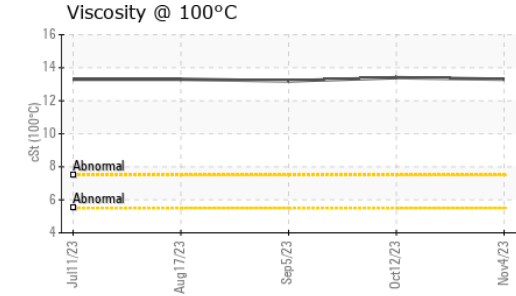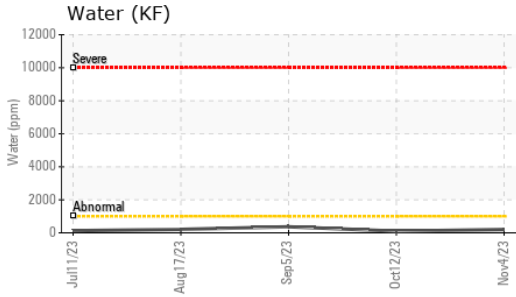






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	128	129	128
Visc @ 100°C	cSt	ASTM D445	13.3	13.4	13.2
Viscosity Index (VI)	Scale	ASTM D2270	95	98	96

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



## GRAPHS

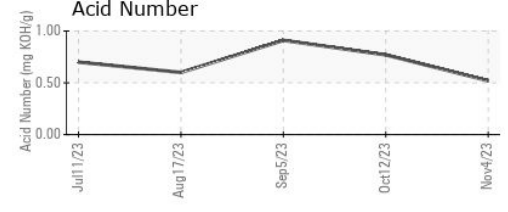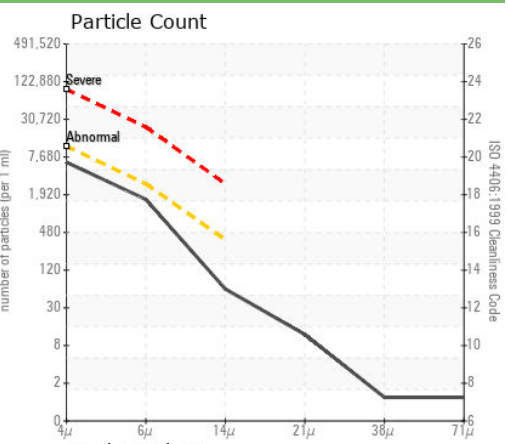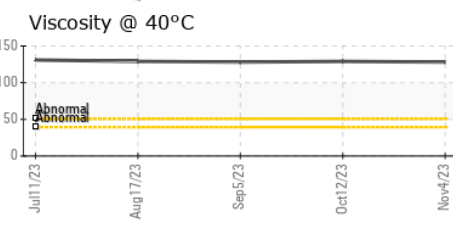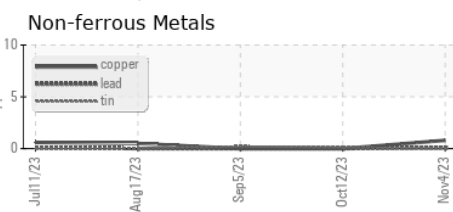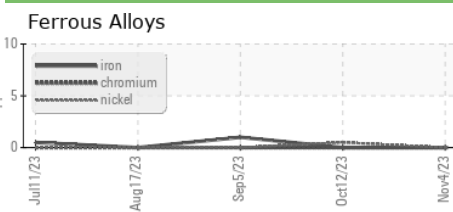

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO60001729 **Received** : 15 Nov 2023  
**Lab Number** : 06008402 **Diagnosed** : 18 Nov 2023  
**Unique Number** : 10742164 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**MIDLAND - EOG RESOURCES INC.**  
 5509 CHAMPIONS DRIVE  
 MIDLAND, TX  
 US 79706  
 Contact: HERMAN GARZA  
 herman\_garza@egoresources.com  
 T: (432)686-3600  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)