OIL ANALYSIS REPORT

Sample Rating Trend

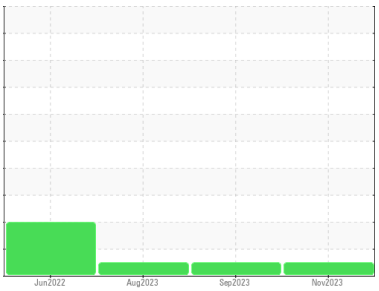

NORMAL

Area
JAL NM
Machine Id
MRC-202
Component
Compressor
Fluid
LO-ASH ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO60001646**	TO60001452	TO60001175
Sample Date		Client Info		**02 Nov 2023**	06 Sep 2023	15 Aug 2023
Machine Age	hrs	Client Info		**20877**	19547	19527
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**<1**	2	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	<1	0
Aluminum	ppm	ASTM D5185m	>25	**2**	2	1
Lead	ppm	ASTM D5185m	>25	**4**	2	2
Copper	ppm	ASTM D5185m	>50	**25**	22	23
Tin	ppm	ASTM D5185m	>15	**3**	3	3
Vanadium	ppm	ASTM D5185m		**<1**	0	<1
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	37	**40**	40	41
Barium	ppm	ASTM D5185m	12	**0**	0	0
Molybdenum	ppm	ASTM D5185m	200	**4**	3	4
Manganese	ppm	ASTM D5185m		**<1**	<1	0
Magnesium	ppm	ASTM D5185m	5	**12**	16	10
Calcium	ppm	ASTM D5185m	1600	**1303**	1286	1340
Phosphorus	ppm	ASTM D5185m	300	**332**	297	304
Zinc	ppm	ASTM D5185m	400	**390**	348	349
Sulfur	ppm	ASTM D5185m	2600	**2281**	2487	2421

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**2**	2	1
Sodium	ppm	ASTM D5185m		**2**	3	2
Potassium	ppm	ASTM D5185m	>20	**<1**	<1	0
Water	%	ASTM D6304	>0.1	**0.014**	0.025	0.011
ppm Water	ppm	ASTM D6304	>1000	**147.4**	250.6	118.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**535**	394	1705
Particles >6µm		ASTM D7647	>2500	**159**	97	577
Particles >14µm		ASTM D7647	>320	**10**	10	49
Particles >21µm		ASTM D7647	>80	**2**	2	11
Particles >38µm		ASTM D7647	>20	**0**	1	0
Particles >71µm		ASTM D7647	>4	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**16/14/10**	16/14/10	18/16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.12**	0.10	0.555

OIL ANALYSIS REPORT

Water (KF)

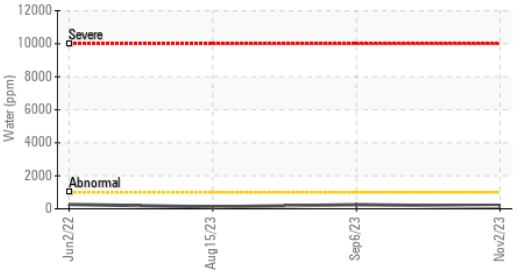

Viscosity @ 100°C

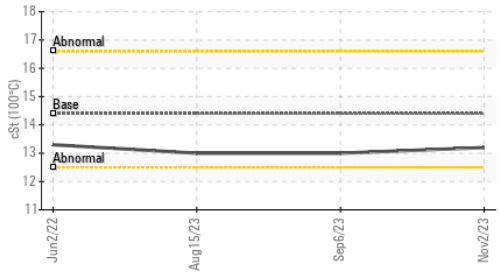

Particle Trend

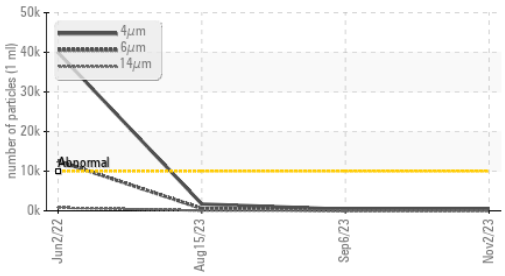

Viscosity @ 100°C

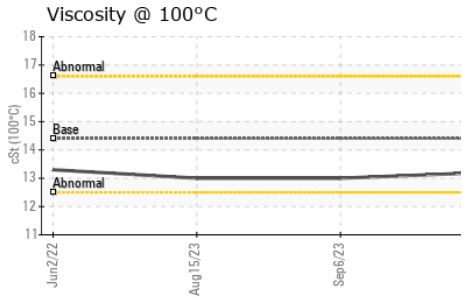

Viscosity @ 40°C

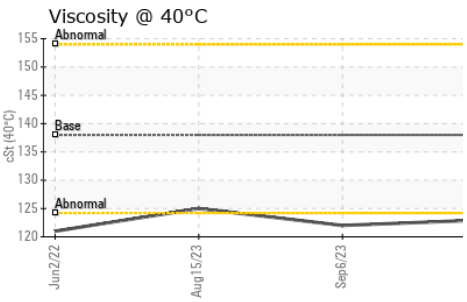

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	138	**123**	122	125
Visc @ 100°C	cSt	ASTM D445	14.4	**13.2**	13.0	13.0
Viscosity Index (VI)	Scale	ASTM D2270	102	**101**	99	96

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

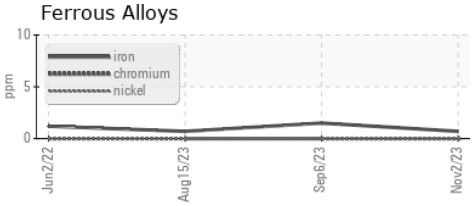

Non-ferrous Metals

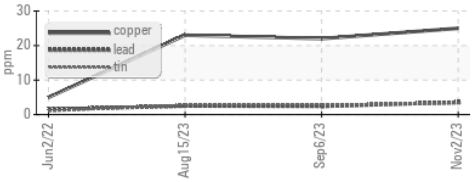

Viscosity @ 40°C

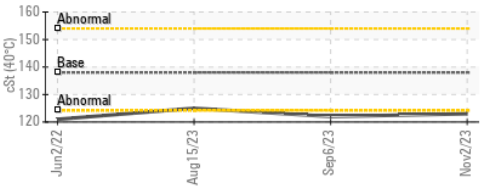

Particle Count

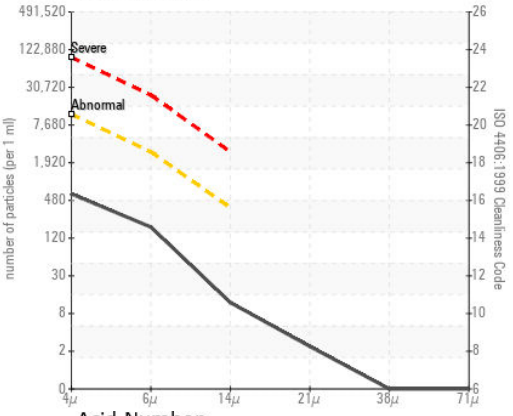

Acid Number

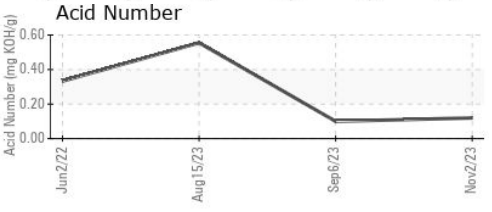

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001646 **Received** : 15 Nov 2023
Lab Number : 06008403 **Diagnosed** : 18 Nov 2023
Unique Number : 10742165 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND - EOG RESOURCES INC.
5509 CHAMPIONS DRIVE
MIDLAND, TX
US 79706
Contact: HERMAN GARZA
herman_garza@eogresources.com
T: (432)686-3600
F: