


PROBLEM SUMMARY

Sample Rating Trend

ISO




Machine Id
MRC-319
Component
Compressor
Fluid
NOT GIVEN (--- GAL)

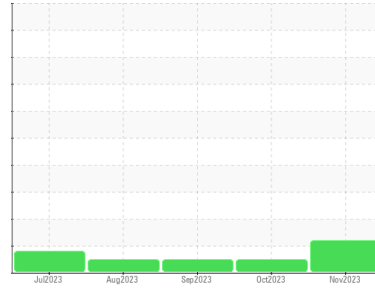

COMPONENT CONDITION SUMMARY

▲ Particle Trend

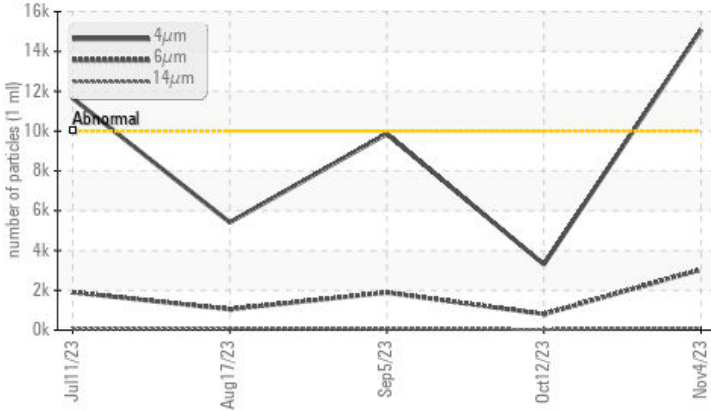

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>10000	▲ 15090	3301	9859
Particles >6µm	ASTM D7647	>2500	▲ 3045	801	1888
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 21/19/14	19/17/12	20/18/13

Customer Id: EOGMID
Sample No.: TO60001733
Lab Number: 06008410
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

12 Oct 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



05 Sep 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Aug 2023 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

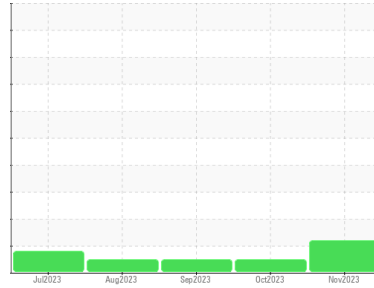

Machine Id
MRC-319
Component
Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

- Recommendation**
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.
- Fluid Condition**
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO60001733	TO60001652	TO60001427
Sample Date	Client Info		04 Nov 2023	12 Oct 2023	05 Sep 2023
Machine Age	hrs	Client Info	3259	2259	1787
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	0	1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	<1	<1
Aluminum	ppm	ASTM D5185m >25	<1	<1	0
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	<1	0	<1
Tin	ppm	ASTM D5185m >15	0	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	97	66	118
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	8	11	15
Calcium	ppm	ASTM D5185m	1280	1269	1356
Phosphorus	ppm	ASTM D5185m	318	312	286
Zinc	ppm	ASTM D5185m	336	336	307
Sulfur	ppm	ASTM D5185m	2696	2159	1391

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	8	2	2
Sodium	ppm	ASTM D5185m	4	2	2
Potassium	ppm	ASTM D5185m >20	1	3	1
Water	%	ASTM D6304 >0.1	0.017	0.009	0.034
ppm Water	ppm	ASTM D6304 >1000	174.1	92.1	342.7

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 15090	3301	9859
Particles >6µm	ASTM D7647	>2500	▲ 3045	801	1888
Particles >14µm	ASTM D7647	>320	106	35	50
Particles >21µm	ASTM D7647	>80	11	9	9
Particles >38µm	ASTM D7647	>20	0	1	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 21/19/14	19/17/12	20/18/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.68	0.76	0.75


OIL ANALYSIS REPORT

Particle Trend

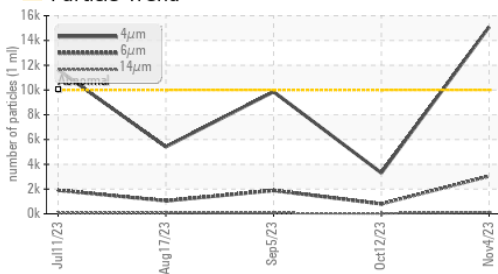


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

Water (KF)

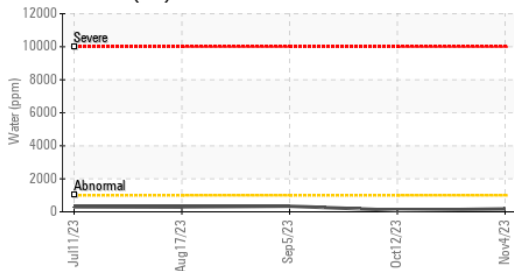


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	128	133	130
Visc @ 100°C	cSt	ASTM D445	13.2	13.6	13.2
Viscosity Index (VI)	Scale	ASTM D2270	96	97	94


Viscosity @ 100°C

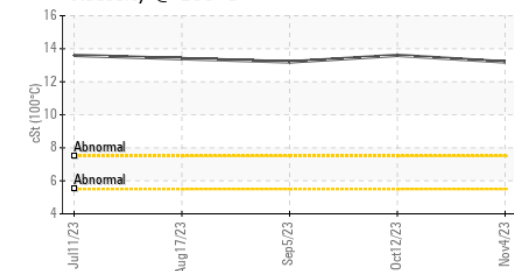


SAMPLE IMAGES

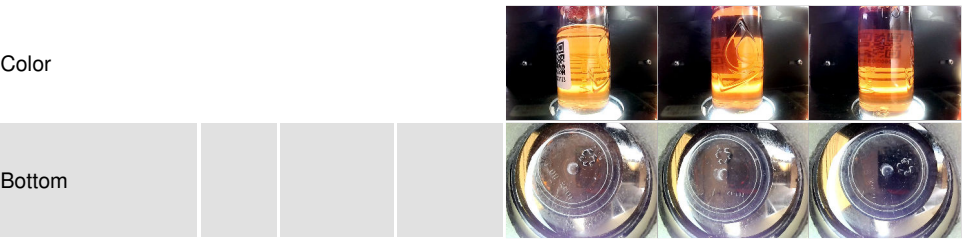


Water (KF)

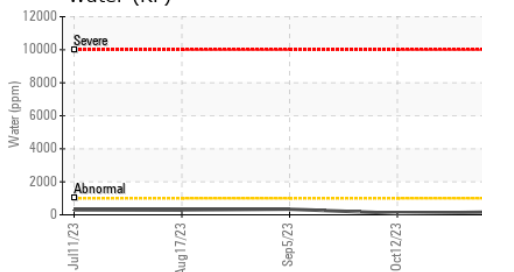


GRAPHS

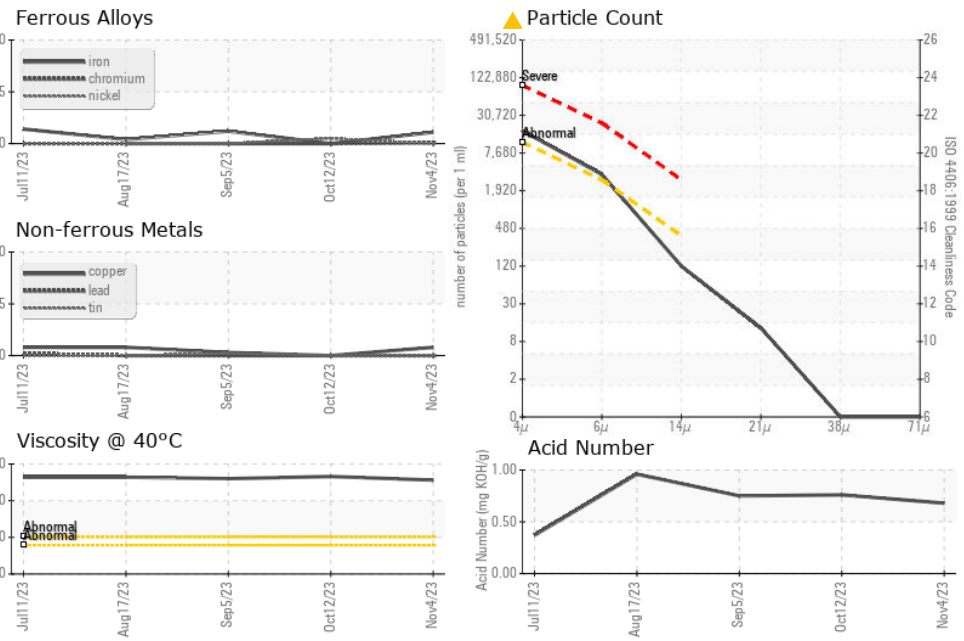

Viscosity @ 100°C

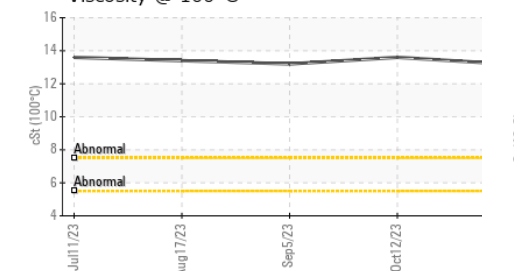

Viscosity @ 40°C

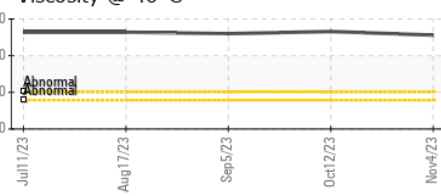

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001733 **Received** : 15 Nov 2023
Lab Number : 06008410 **Diagnosed** : 18 Nov 2023
Unique Number : 10742172 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)