PROBLEM SUMMARY

Sample Rating Trend

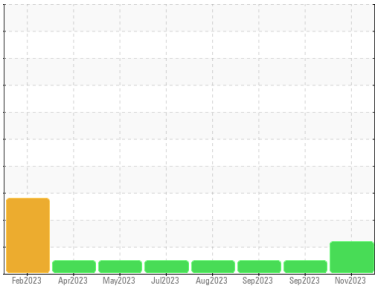

ISO

Area
GOLDEN BEAR LGL
Machine Id
MRC-284
Component
Compressor
Fluid
TULCO LUBSOIL GEO XL LOW ASH 40 (--- GAL)

COMPONENT CONDITION SUMMARY

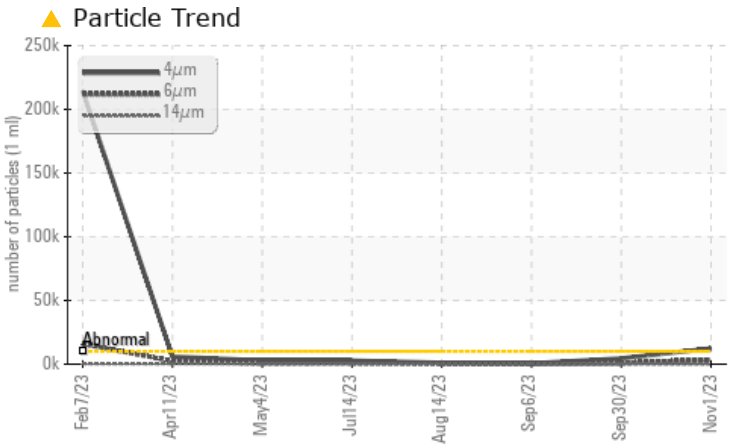

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	NORMAL
Particles >4µm		ASTM D7647	>10000	▲ **12360**	4527	589
Particles >6µm		ASTM D7647	>2500	▲ **3616**	787	146
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ **21/19/14**	19/17/12	16/14/11

Customer Id: EOGMID
Sample No.: TO60001637
Lab Number: 06008415
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

30 Sep 2023 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

06 Sep 2023 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

14 Aug 2023 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

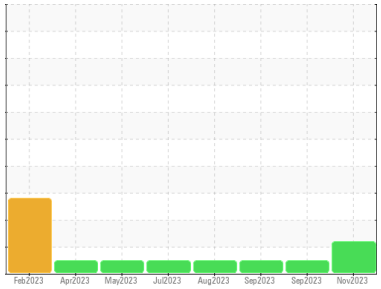

ISO

Area
GOLDEN BEAR LGL
Machine Id
MRC-284
Component
Compressor
Fluid
TULCO LUBSOIL GEO XL LOW ASH 40 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO60001637**	TO60001459	TO60001461
Sample Date		Client Info		**01 Nov 2023**	30 Sep 2023	06 Sep 2023
Machine Age	hrs	Client Info		**13348**	12585	12017
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**Not Changd**	Not Changd	Not Changd
Sample Status				**ATTENTION**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	<1	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	<1	0
Aluminum	ppm	ASTM D5185m	>25	**<1**	<1	0
Lead	ppm	ASTM D5185m	>25	**0**	<1	0
Copper	ppm	ASTM D5185m	>50	**<1**	0	0
Tin	ppm	ASTM D5185m	>15	**0**	<1	<1
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	100	**104**	86	100
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m	1	**<1**	0	<1
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m	10	**9**	14	13
Calcium	ppm	ASTM D5185m	1150	**1279**	1308	1263
Phosphorus	ppm	ASTM D5185m	290	**303**	281	281
Zinc	ppm	ASTM D5185m	272	**333**	350	300
Sulfur	ppm	ASTM D5185m	1900	**1934**	1612	1637

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**2**	3	1
Sodium	ppm	ASTM D5185m		**2**	2	3
Potassium	ppm	ASTM D5185m	>20	**1**	2	1
Water	%	ASTM D6304	>0.1	**0.020**	0.011	0.036
ppm Water	ppm	ASTM D6304	>1000	**206.6**	112.7	369.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ **12360**	4527	589
Particles >6µm		ASTM D7647	>2500	▲ **3616**	787	146
Particles >14µm		ASTM D7647	>320	**108**	22	15
Particles >21µm		ASTM D7647	>80	**13**	5	5
Particles >38µm		ASTM D7647	>20	**0**	0	1
Particles >71µm		ASTM D7647	>4	**0**	0	1
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ **21/19/14**	19/17/12	16/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**1.03**	1.074	0.60

OIL ANALYSIS REPORT

Particle Trend

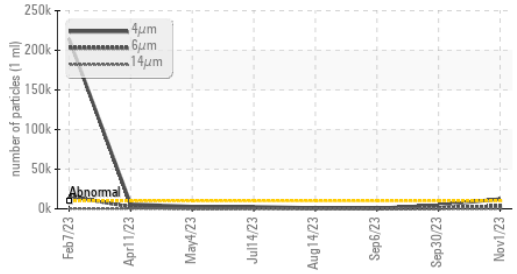

Water (KF)

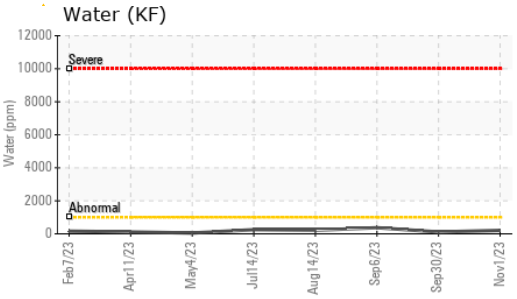

Viscosity @ 100°C

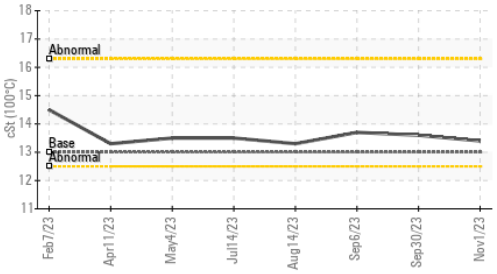

Water (KF)

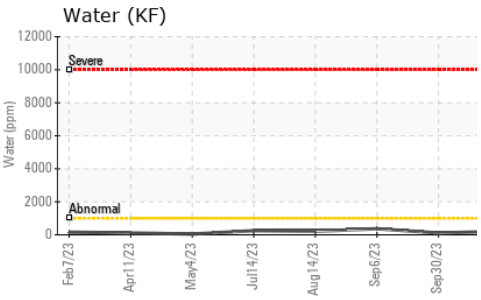

Viscosity @ 100°C

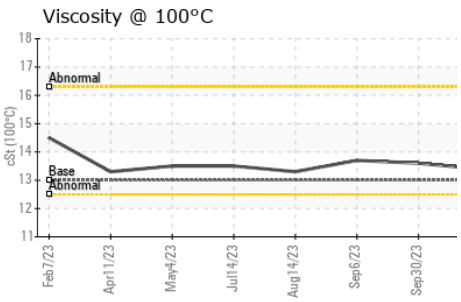

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	122	**131**	135	135
Visc @ 100°C	cSt	ASTM D445	13	**13.4**	13.6	13.7
Viscosity Index (VI)	Scale	ASTM D2270	103	**96**	95	96

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

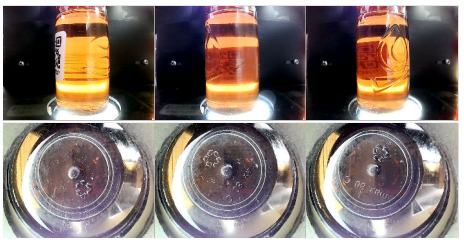

GRAPHS

Ferrous Alloys

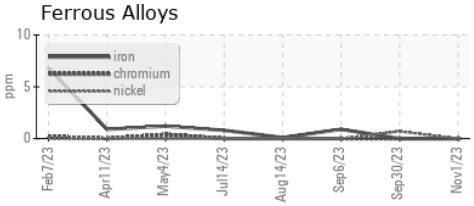

Non-ferrous Metals

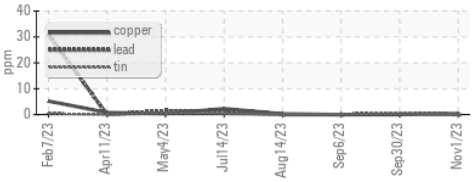

Viscosity @ 40°C

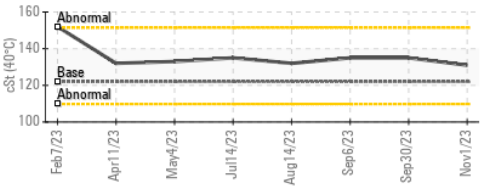

Particle Count

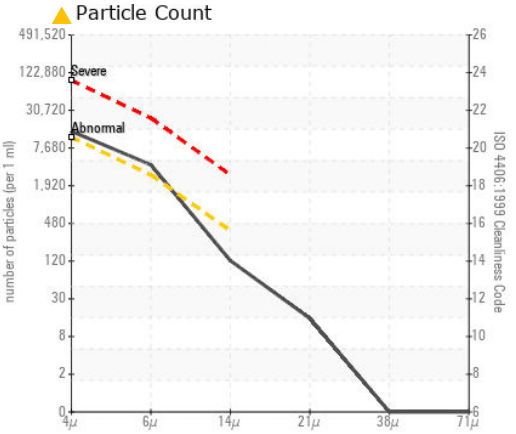

Acid Number

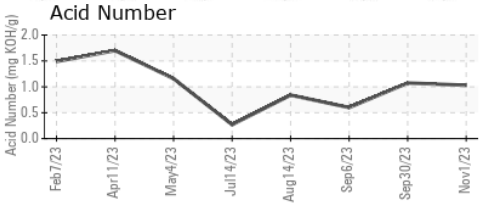

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001637 **Received** : 15 Nov 2023
Lab Number : 06008415 **Diagnosed** : 18 Nov 2023
Unique Number : 10742177 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND - EOG RESOURCES INC.
5509 CHAMPIONS DRIVE
MIDLAND, TX
US 79706
Contact: HERMAN GARZA
herman_garza@eogresources.com
T: (432)686-3600
F: