




PROBLEM SUMMARY

Sample Rating Trend

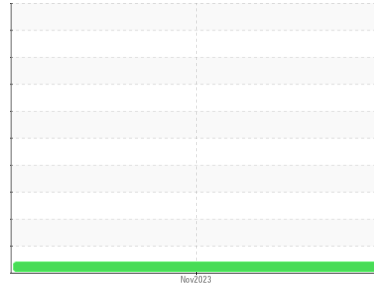

VIS DEBRIS



Area

Building 12

Machine Id

Conveyor 7

Component

Drive End Conveyor Gearbox

Fluid

SCHAEFFER 293A SUPREME GEAR LUBE NO TACK 220 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Debris	scalar	*Visual	NONE	▲ MODER	---	---

Customer Id: THRPIT
 Sample No.: WC0853769
 Lab Number: 06008463
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT


Sample Rating Trend

VIS DEBRIS

Area
Building 12
Machine Id
Conveyor 7

Component
Drive End Conveyor Gearbox

Fluid
SCHAEFFER 293A SUPREME GEAR LUBE NO TACK 220 (--- GAL)

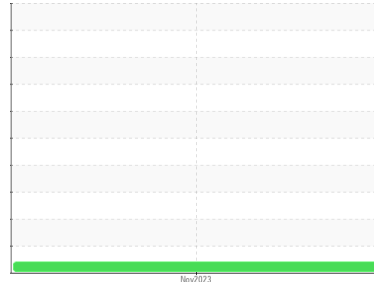

DIAGNOSIS

▲ Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0853769	---	---
Sample Date	Client Info	13 Nov 2023	---	---
Machine Age	hrs	Client Info	0	---
Oil Age	hrs	Client Info	5610	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>200	6	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>10	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m		4	---	---
Lead	ppm	ASTM D5185m		0	---	---
Copper	ppm	ASTM D5185m		<1	---	---
Tin	ppm	ASTM D5185m		0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		17	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		324	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		2	---	---
Calcium	ppm	ASTM D5185m		6	---	---
Phosphorus	ppm	ASTM D5185m		657	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		19201	---	---

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m		16	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---

FLUID DEGRADATION



method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045		1.63	---	---

VISUAL

method	limit/base	current	history1	history2		
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	▲ MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---



OIL ANALYSIS REPORT



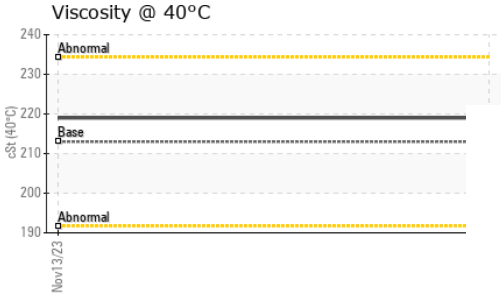
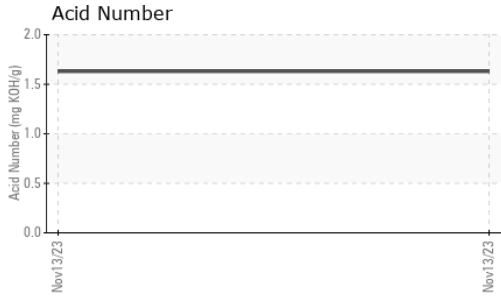


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 213	219	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

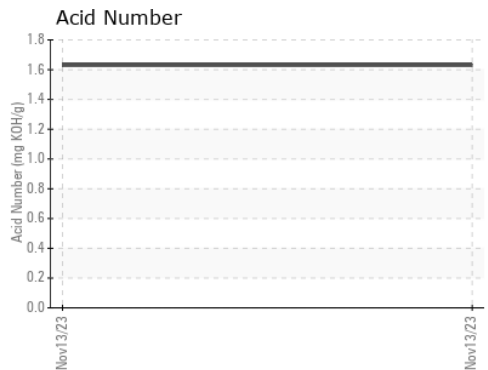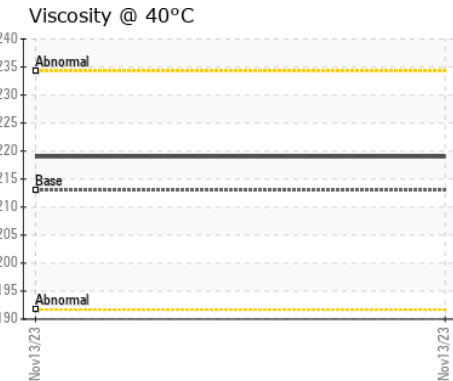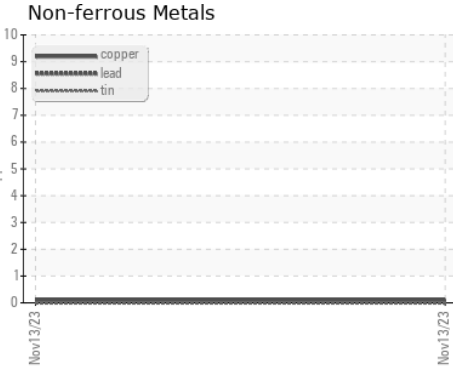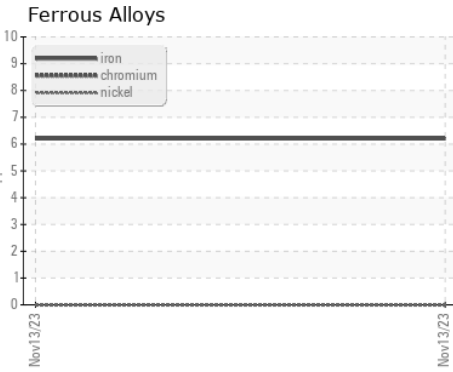

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0853769 Received : 15 Nov 2023
 Lab Number : 06008463 Diagnosed : 17 Nov 2023
 Unique Number : 10742225 Diagnostician : Don Baldrige
 Test Package : IND 2

3M - PITTSBORO
 4191 NC 87 S
 MONCURE, NC
 US 27559

Contact: CHARLES JARRELL
 cjarrell@mmm.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: