


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

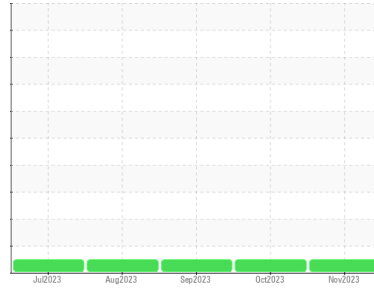

Machine Id
MRC-326
 Component
Natural Gas Engine
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO60001710	TO60001675	TO60001443
Sample Date	Client Info			05 Nov 2023	12 Oct 2023	05 Sep 2023
Machine Age	hrs	Client Info		4418	4021	3711
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	<1	6
Chromium	ppm	ASTM D5185m	>4	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	0	<1
Lead	ppm	ASTM D5185m	>30	14	0	10
Copper	ppm	ASTM D5185m	>35	3	1	2
Tin	ppm	ASTM D5185m	>4	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		70	111	82
Barium	ppm	ASTM D5185m		0	0	1
Molybdenum	ppm	ASTM D5185m		<1	<1	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		11	12	14
Calcium	ppm	ASTM D5185m		1240	1263	1373
Phosphorus	ppm	ASTM D5185m		198	271	284
Zinc	ppm	ASTM D5185m		291	288	314
Sulfur	ppm	ASTM D5185m		1241	912	1606

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	2	2	2
Sodium	ppm	ASTM D5185m		2	<1	4
Potassium	ppm	ASTM D5185m	>20	0	0	1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	9.5	7.7	10.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.1	13.7	21.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	20.2	8.8	22.0
Acid Number (AN)	mg KOH/g	ASTM D8045		1.24	0.98	1.32
Base Number (BN)	mg KOH/g	ASTM D2896		3.34	5.47	2.89





OIL ANALYSIS REPORT

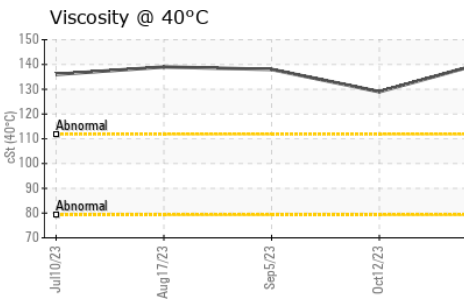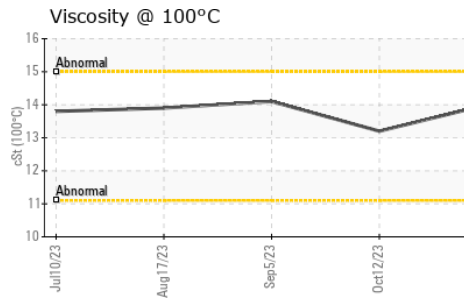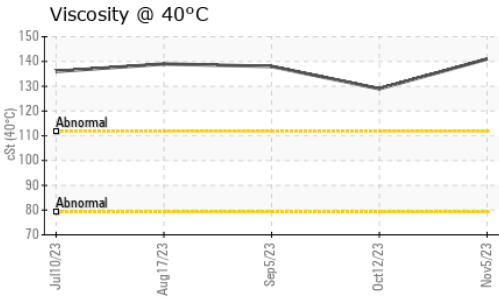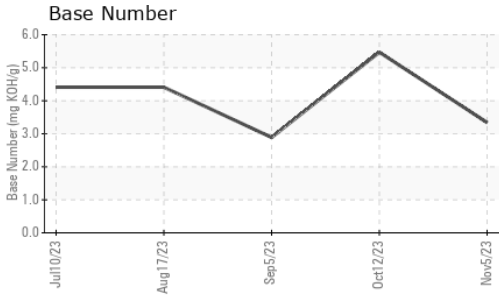

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	141	129	138
Visc @ 100°C	cSt	ASTM D445	14.0	13.2	14.1
Viscosity Index (VI)	Scale	ASTM D2270	95	95	99

GRAPHS

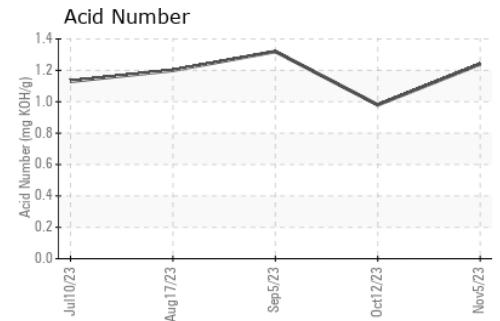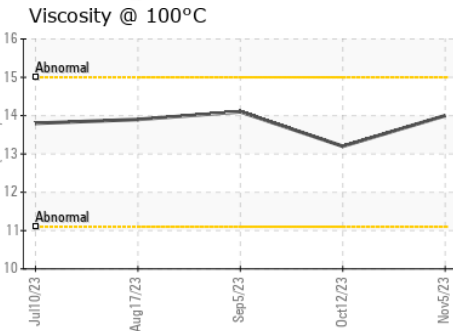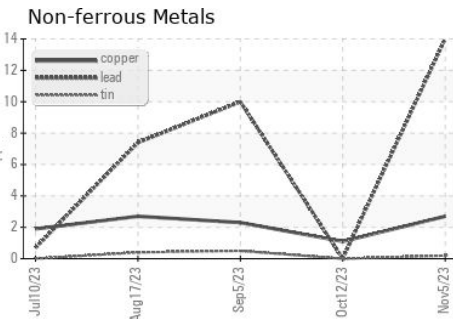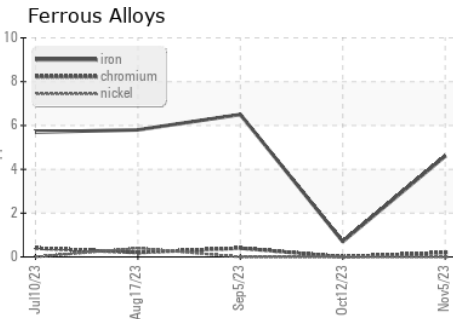

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001710 **Received** : 15 Nov 2023
Lab Number : **06008531** **Diagnosed** : 29 Nov 2023
Unique Number : 10742293 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: FT-IR, KV40, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)