


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
351
Component
Natural Gas Engine
Fluid
NOT GIVEN (--- GAL)

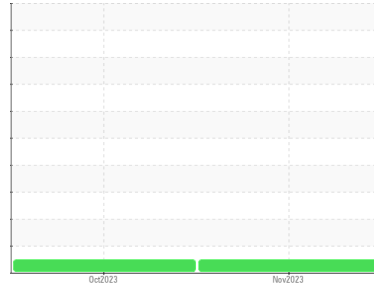

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO60001707	TO60001657	---
Sample Date	Client Info			05 Nov 2023	12 Oct 2023	---
Machine Age	hrs	Client Info		707	185	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	---
Chromium	ppm	ASTM D5185m	>4	0	0	---
Nickel	ppm	ASTM D5185m	>2	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>9	<1	0	---
Lead	ppm	ASTM D5185m	>30	0	0	---
Copper	ppm	ASTM D5185m	>35	1	1	---
Tin	ppm	ASTM D5185m	>4	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		97	108	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	1	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		12	18	---
Calcium	ppm	ASTM D5185m		1184	1268	---
Phosphorus	ppm	ASTM D5185m		188	278	---
Zinc	ppm	ASTM D5185m		273	298	---
Sulfur	ppm	ASTM D5185m		921	940	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	2	2	---
Sodium	ppm	ASTM D5185m		<1	<1	---
Potassium	ppm	ASTM D5185m	>20	0	0	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	---
Nitration	Abs/cm	*ASTM D7624	>20	8.8	7.8	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	14.7	13.7	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	10.6	8.8	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.77	0.89	---
Base Number (BN)	mg KOH/g	ASTM D2896		5.00	5.49	---





OIL ANALYSIS REPORT

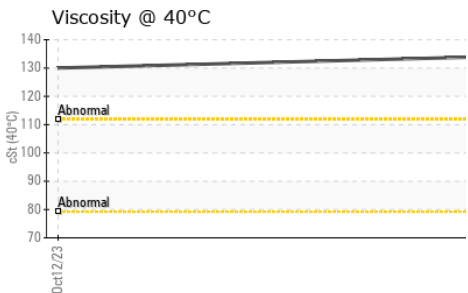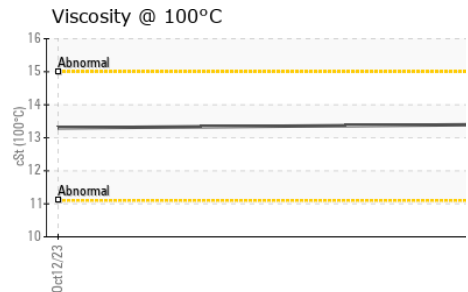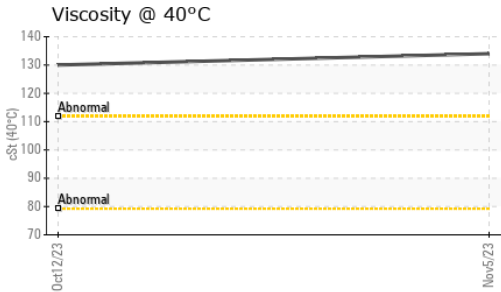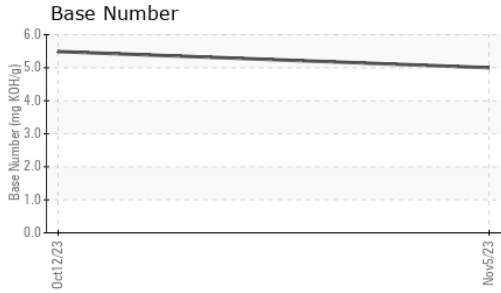

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	134	130	---
Visc @ 100°C	cSt	ASTM D445	13.4	13.3	---
Viscosity Index (VI)	Scale	ASTM D2270	94	96	---

GRAPHS

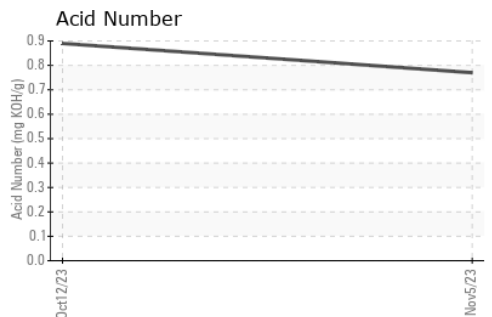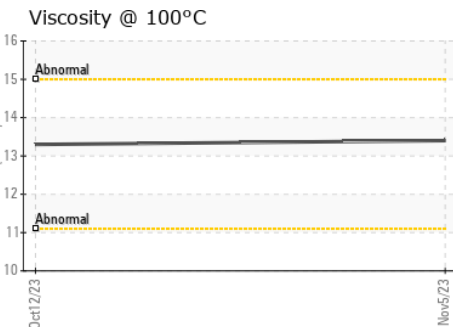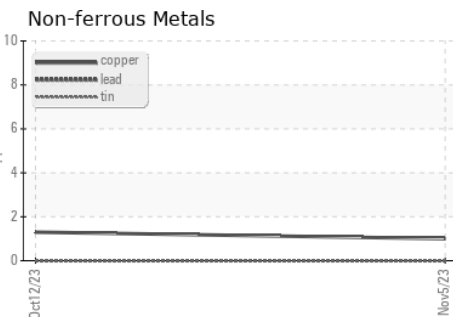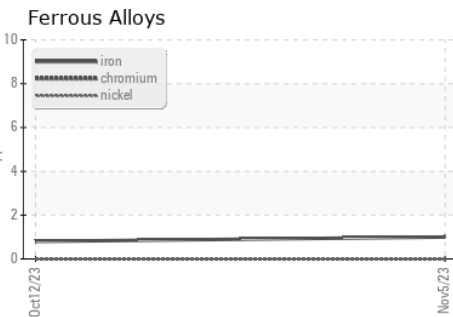

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001707 **Received** : 15 Nov 2023
Lab Number : **06008532** **Diagnosed** : 17 Nov 2023
Unique Number : 10742294 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: FT-IR, KV40, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)