




OIL ANALYSIS REPORT



Area
Cincinnati
Machine Id
[Cincinnati] Oil - Starboard Genset
Component
Starboard Genset
Fluid
DIESEL ENGINE OIL 10W40 (--- GAL)

Sample Rating Trend

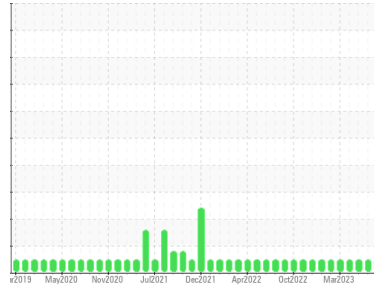

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0805537	WC0769213	WC0769254
Sample Date	Client Info		08 Nov 2023	15 Aug 2023	18 May 2023
Machine Age	hrs	Client Info	18499	18499	17347
Oil Age	hrs	Client Info	18499	18499	1817
Oil Changed	Client Info		Filtered	Filtered	Oil Added
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	21	24	22
Chromium	ppm	ASTM D5185m >4	<1	1	1
Nickel	ppm	ASTM D5185m >2	0	0	<1
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m >5	0	0	<1
Aluminum	ppm	ASTM D5185m >12	1	<1	2
Lead	ppm	ASTM D5185m >17	<1	3	2
Copper	ppm	ASTM D5185m >70	1	3	2
Tin	ppm	ASTM D5185m >15	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	8	7	10
Barium	ppm	ASTM D5185m 10	0	0	0
Molybdenum	ppm	ASTM D5185m 100	60	67	61
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 450	1583	1838	1573
Calcium	ppm	ASTM D5185m 3000	1084	1285	1164
Phosphorus	ppm	ASTM D5185m 1150	1026	1189	1017
Zinc	ppm	ASTM D5185m 1350	1325	1545	1257
Sulfur	ppm	ASTM D5185m 4250	3126	4321	3403

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	6	7
Sodium	ppm	ASTM D5185m	1	2	2
Potassium	ppm	ASTM D5185m >20	0	3	1

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.3	0.3	0.3
Nitration	Abs/cm	*ASTM D7624 >20	11.7	12.6	11.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	21.8	21.9	21.5

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	21.1	21.5	20.4
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	9.92	12.61	13.31







OIL ANALYSIS REPORT

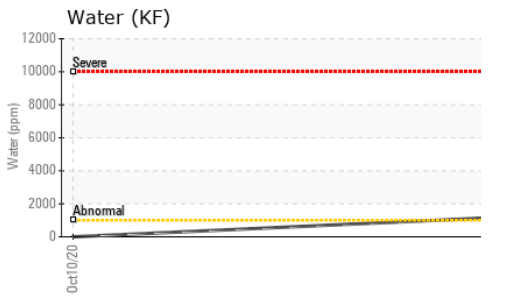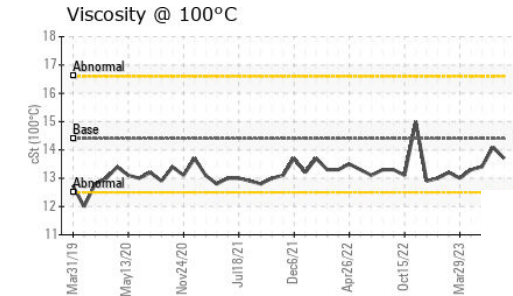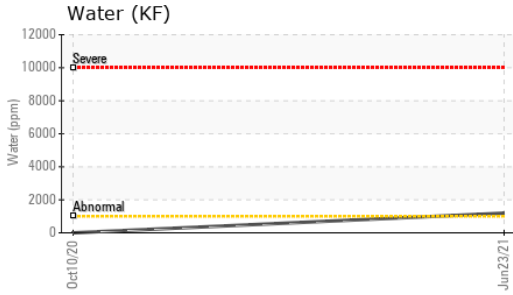

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	13.7	14.1	13.4

GRAPHS

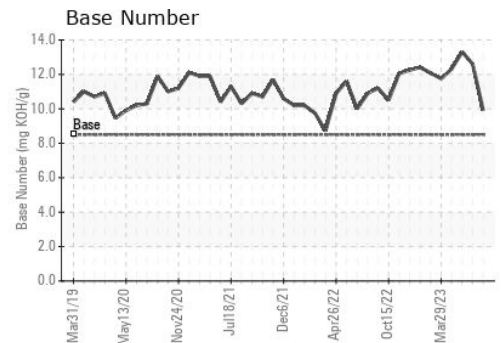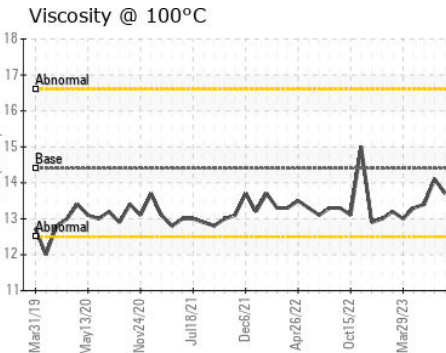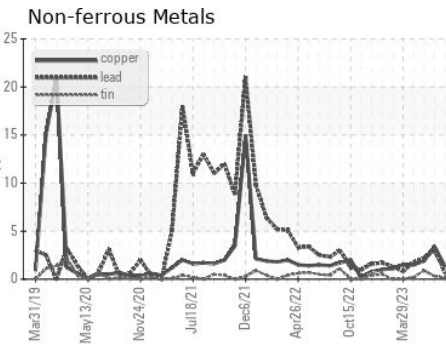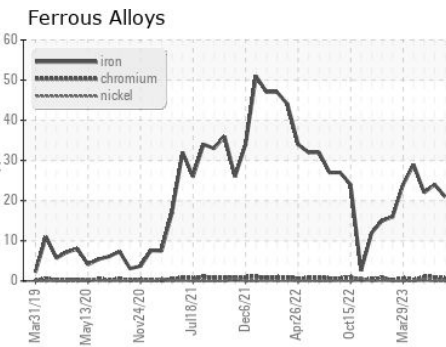

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0805537 Received : 15 Nov 2023
 Lab Number : 06008550 Diagnosed : 17 Nov 2023
 Unique Number : 10742312 Diagnostician : Sean Felton
 Test Package : IND 2 (Additional Tests: KF)

MARATHON PETROLEUM CO.
 101 12TH ST
 CATLETTSBURG, KY
 US 41169
 Contact: M/V CINCINNATI
 mvcincinnati@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: