




FUEL REPORT

Sample Rating Trend

NORMAL



Machine Id
J102-01550081 FM-14FPXL06.7DGS 3005004997 - CAMERON NURSING & REHAB
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (1000 GAL)

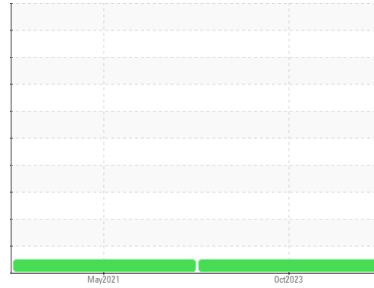

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no Bacteria, Yeast and/or Fungus indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0029144	WCDF03893	---
Sample Date	Client Info			24 Oct 2023	06 May 2021	---
Machine Age	hrs	Client Info		308	78	---
Sample Status				NORMAL	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L5.0	L5.5	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.3	2.3	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	4	0	---
Sulfur (UVF)	ppm	ASTM D5453		5	<1	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	41.2	38.4	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	0	---
Sodium	ppm	ASTM D5185m	<0.1	2	0	---
Potassium	ppm	ASTM D5185m	<0.1	10	<1	---
Water	%	ASTM D6304	<0.05	0.003	0.002	---
ppm Water	ppm	ASTM D6304	<500	26.4	17.3	---
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	0.0	---


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	2	0	---
Nickel	ppm	ASTM D5185m	<0.1	0	0	---
Lead	ppm	ASTM D5185m	<0.1	0	0	---
Vanadium	ppm	ASTM D5185m	<0.1	<1	0	---
Iron	ppm	ASTM D5185m	<0.1	0	0	---
Calcium	ppm	ASTM D5185m	<0.1	<1	0	---
Magnesium	ppm	ASTM D5185m	<0.1	2	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	---
Zinc	ppm	ASTM D5185m	<0.1	0	0	---

SAMPLE IMAGES



method	limit/base	current	history1	history2	
Color					no image
Bottom					no image



FUEL REPORT

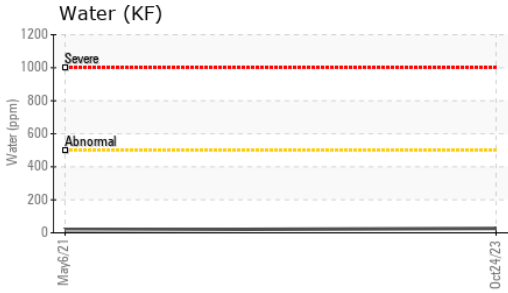

GRAPHS

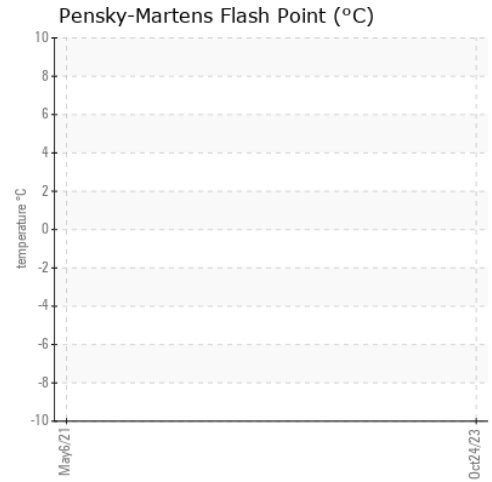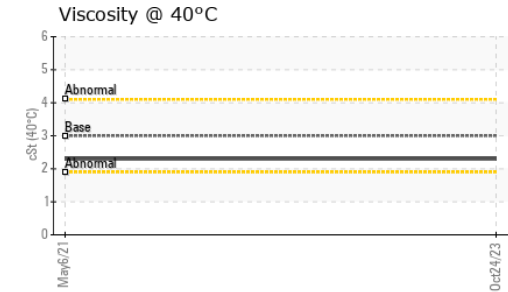

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0029144 **Received** : 15 Nov 2023
Lab Number : **06008772** **Diagnosed** : 05 Dec 2023
Unique Number : 10742534 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)