


PROBLEM SUMMARY

Machine Ic KAESER 1041686 (S/N 1072) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

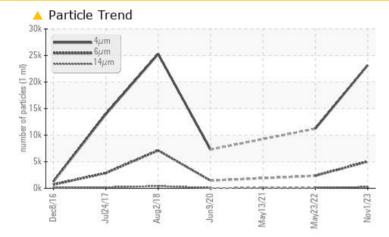

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.


PROBLEMATIC TEST RESULTS Sample Status ABNORMAL ATTENTION ABNORMAL Particles >6µm ASTM D7647 >1300 5040 ▲ 2353 Particles >14µm ASTM D7647 >80 237 **1**16 Particles >21µm ASTM D7647 >20 57 **Oil Cleanliness** ISO 4406 (c) >--/17/13 **A** 22/20/15 21/18/14

Customer Id: ABOLEX Sample No.: KCPA006950 Lab Number: 06009093 Test Package: IND 2



To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

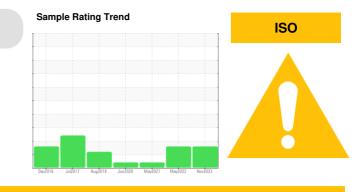

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

23 May 2022 Diag: Don Baldridge




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.




view report

13 May 2021 Diag: Don Baldridge



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT

Machine Id KAESER 1041686 (S/N 1072) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

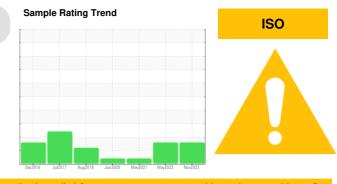


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006950	KCP51218	KCP37148
Sample Date		Client Info		01 Nov 2023	23 May 2022	13 May 2021
Machine Age	hrs	Client Info		4805	4805	4805
Oil Age	hrs	Client Info		0	1000	2000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	5	2	3
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony		ASTM D5185m	>10			0
Vanadium	ppm	ASTM D5185m		0	0	0
	ppm			0		0
Cadmium	ppm	ASTM D5185m		U	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	16	19	10
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	44	67	51
Calcium	ppm	ASTM D5185m	0	1	4	<1
Phosphorus	ppm	ASTM D5185m	0	19	5	6
Zinc	ppm	ASTM D5185m	0	0	9	0
Sulfur	ppm	ASTM D5185m	23500	25682	22375	17609
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	1
Sodium	ppm	ASTM D5185m		6	21	13
Potassium	ppm	ASTM D5185m	>20	2	2	3
Water	%	ASTM D6304	>0.05	0.018	0.033	0.031
ppm Water	ppm	ASTM D6304	>500	181.7	335.2	317.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		23169	11214	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u> </u>	
Particles >14µm		ASTM D7647	>80	<u> </u>	1 16	
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 22/20/15	1 21/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.36	0.375
1.26.22) Pov: 1			Conto	ot/Logation: CE		


Report Id: ABOLEX [WUSCAR] 06009093 (Generated: 11/19/2023 10:26:33) Rev: 1


Contact/Location: SERVICE MANAGER ? - ABOLEX




OIL ANALYSIS REPORT





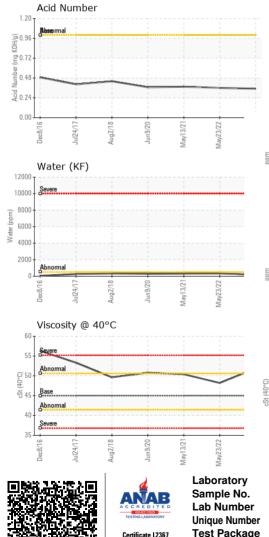

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	51.9	48.2	50.4
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						



Bottom

