

# **PROBLEM SUMMARY**

Sample Rating Trend




4800100 (S/N 1209)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **COMPONENT CONDITION SUMMARY**

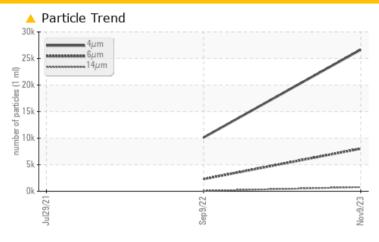

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ATTENTION	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<b>8026</b>	<u>^</u> 2286						
Particles >14μm	ASTM D7647	>80	<b>788</b>	60						
Particles >21µm	ASTM D7647	>20	<u> </u>	7						
Particles >38µm	ASTM D7647	>4	<u> </u>	1						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>22/20/17</u>	<u>^</u> 21/18/13						

Customer Id: DIVCHANC Sample No.: KCPA009785 Lab Number: 06009094 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

## 09 Sep 2022 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 29 Jul 2021 Diag: Angela Borella

VIS DEBRIS




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend

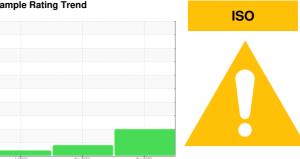

# 4800100 (S/N 1209)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **DIAGNOSIS**

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ju	2021	Sep2022 Nov203	28	
SAMPLE INFORM	ΛΔΤΙΩΝ	method	limit/base	current	history1	history2
Sample Number		Client Info	III III Dasc	KCPA009785	KCP46315	KCP41765
Sample Date		Client Info		09 Nov 2023	09 Sep 2022	29 Jul 2021
Machine Age	hrs	Client Info		22283	19573	17141
Oil Age	hrs	Client Info		0	3000	3000
Oil Changed	1115	Client Info		N/A	Changed	Changed
Sample Status		Ciletit IIIIO		ABNORMAL	ATTENTION	ABNORMAL
-						
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	3
Chromium	ppm	ASTM D5185m		0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m		1	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	5	6	14
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	10	3	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	100	63	60	<1
Calcium	ppm	ASTM D5185m	0	1	1	0
Phosphorus	ppm	ASTM D5185m	0	19	5	4
Zinc	ppm	ASTM D5185m	0	8	28	6
Sulfur	ppm	ASTM D5185m	23500	22429	18818	16851
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	0
Sodium	ppm	ASTM D5185m		11	16	0
Potassium	ppm	ASTM D5185m	>20	3	0	0
Water	%	ASTM D6304	>0.05	0.036	0.025	0.011
ppm Water	ppm	ASTM D6304	>500	366.6	257.2	114.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		26654	10111	
Particles >6µm		ASTM D7647	>1300	<b>A</b> 8026	<u>^</u> 2286	
Particles >14µm		ASTM D7647	>80	<b>^</b> 788	60	
Particles >21µm		ASTM D7647	>20	<u>^</u> 251	7	
Particles >38µm		ASTM D7647	>4	<u> 15</u>	1	
Particles >71μm		ASTM D7647	>3	1	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 22/20/17	<u>^</u> 21/18/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
. 10.1 31011/07				Carront	5(01)	



## **OIL ANALYSIS REPORT**







Certificate L2367

Sample No. Lab Number **Unique Number** 

: KCPA009785

: 10742856

: 06009094

Received : 15 Nov 2023 Diagnosed

: 19 Nov 2023 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

13336 S RIDGE DR CHARLOTTE, NC

US 28273

Contact: Service Manager

Contact/Location: Service Manager - DIVCHANC

T: