




OIL ANALYSIS REPORT

Sample Rating Trend

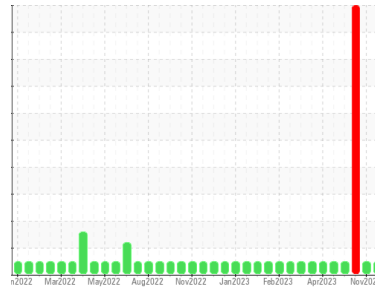

NORMAL



Machine Id
LGS00178

Component
Biogas Engine

Fluid
MAHLER Q8 Mahler G8 SAE 40 (141 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the fluid.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0660943	WC0660936	WC0660877
Sample Date	Client Info	13 Nov 2023	07 Nov 2023	24 Aug 2023
Machine Age	hrs	64440	64305	62892
Oil Age	hrs	210	75	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	SEVERE

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >4.0	<1.0	<1.0	<1.0
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >45	13	10	110
Chromium	ppm ASTM D5185m >2	0	<1	<1
Nickel	ppm ASTM D5185m >2	0	0	2
Titanium	ppm ASTM D5185m	0	<1	0
Silver	ppm ASTM D5185m >5	0	0	0
Aluminum	ppm ASTM D5185m >10	1	2	4
Lead	ppm ASTM D5185m >5	<1	<1	7
Copper	ppm ASTM D5185m >14	8	6	28
Tin	ppm ASTM D5185m >13	<1	<1	5
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	6	0	1
Molybdenum	ppm ASTM D5185m	2	0	1
Manganese	ppm ASTM D5185m	<1	<1	1
Magnesium	ppm ASTM D5185m	6	7	6
Calcium	ppm ASTM D5185m	2355	2129	2495
Phosphorus	ppm ASTM D5185m	449	368	397
Zinc	ppm ASTM D5185m	442	427	505
Sulfur	ppm ASTM D5185m	3728	2618	4811

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >200	72	29	219
Sodium	ppm ASTM D5185m	0	3	0
Potassium	ppm ASTM D5185m >20	2	0	4

INFRA-RED




method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0	0	0.1
Nitration	Abs/cm *ASTM D7624 >20	5.0	4.6	5.4
Sulfation	Abs/.1mm *ASTM D7415 >30	17.3	15.5	20.3

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	9.3	8.9	9.4
Acid Number (AN)	mg KOH/g ASTM D8045	0.71	0.72	0.77
Base Number (BN)	mg KOH/g ASTM D2896 8.0	6.26	7.58	6.75











OIL ANALYSIS REPORT

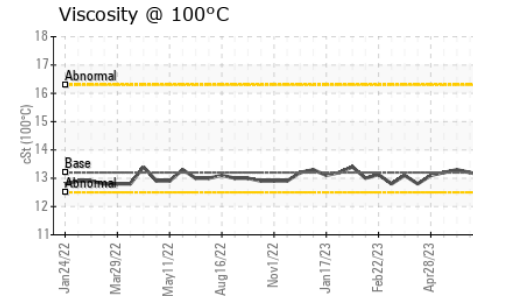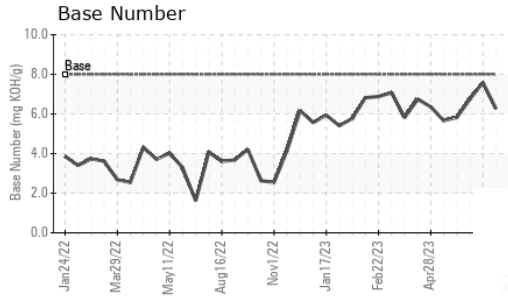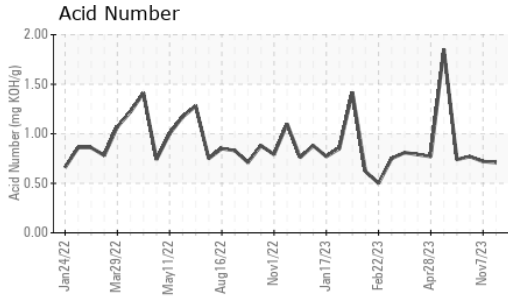

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	13.1	13.2

GRAPHS

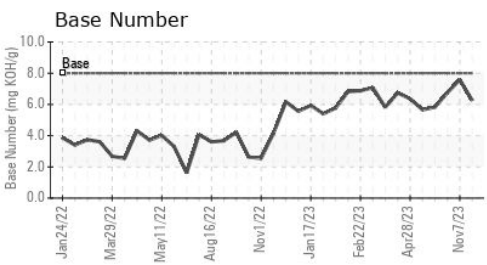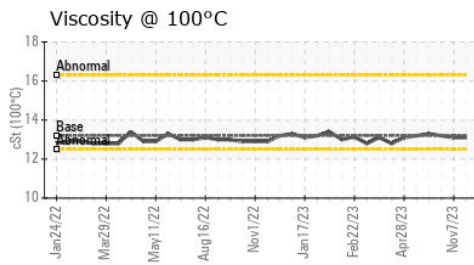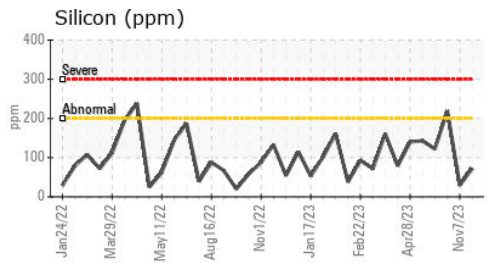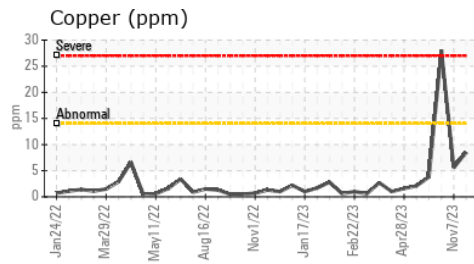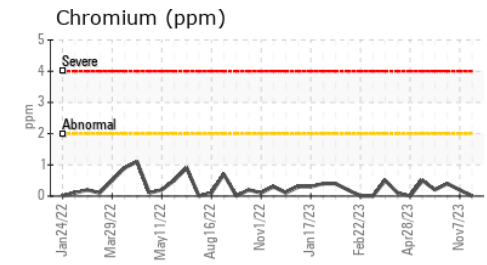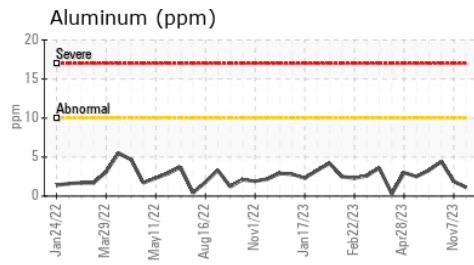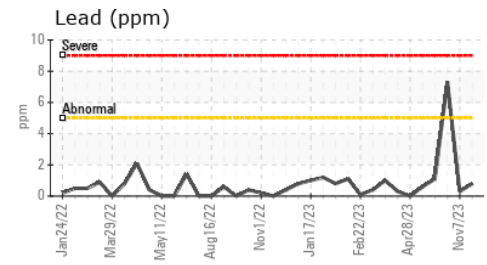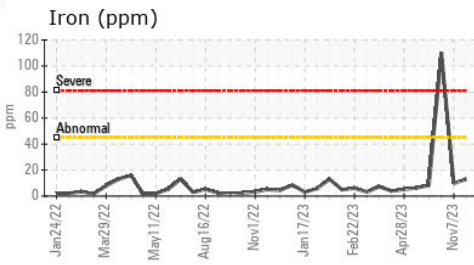

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0660943 **Received** : 15 Nov 2023
Lab Number : 06009140 **Diagnosed** : 17 Nov 2023
Unique Number : 10742902 **Diagnostician** : Angela Borella
Test Package : MOB 2

BI-COUNTY
 3214 DOVER RD
 WOODLAWN, TN
 US 37191
 Contact: KEVIN WEAVER
 kevin.weaver@cubedistrictenergy.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)