




# OIL ANALYSIS REPORT

Sample Rating Trend

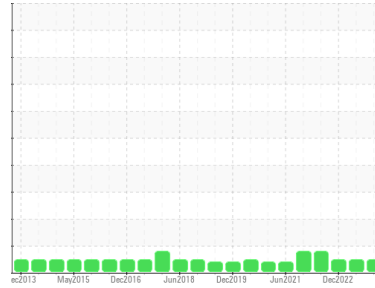

**NORMAL**



Area  
**422**  
 Machine Id  
**93-94 MILL MOTOR**  
 Component  
**Inboard Journal Bearing**  
 Fluid  
**ESSO NUTO H ISO 68 (1 QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0838840</b>	WC0397541	WC0640531
Sample Date	Client Info		<b>10 Nov 2023</b>	05 Jul 2023	30 Dec 2022
Machine Age	mths	Client Info	<b>6</b>	0	6
Oil Age	mths	Client Info	<b>0</b>	6	0
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>10</b>	13	7
Iron	ppm	ASTM D5185m >60	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >250	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m >125	<b>3</b>	1	2
Tin	ppm	ASTM D5185m >80	<b>&lt;1</b>	2	3
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>7</b>	0	1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 5	<b>1</b>	0	2
Calcium	ppm	ASTM D5185m 50	<b>39</b>	44	51
Phosphorus	ppm	ASTM D5185m 330	<b>307</b>	326	338
Zinc	ppm	ASTM D5185m 420	<b>369</b>	430	439
Sulfur	ppm	ASTM D5185m 3100	<b>2827</b>	2612	2441

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>9666</b>	7855	9888
Particles >6µm	ASTM D7647	>2500	<b>1552</b>	1638	1190
Particles >14µm	ASTM D7647	>160	<b>130</b>	127	32
Particles >21µm	ASTM D7647	>40	<b>32</b>	30	5
Particles >38µm	ASTM D7647	>10	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>20/18/14</b>	20/18/14	20/17/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 .40	<b>0.37</b>	0.37	0.40




# OIL ANALYSIS REPORT

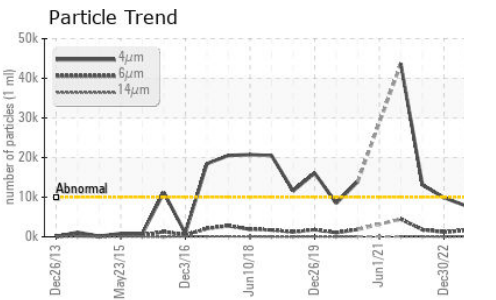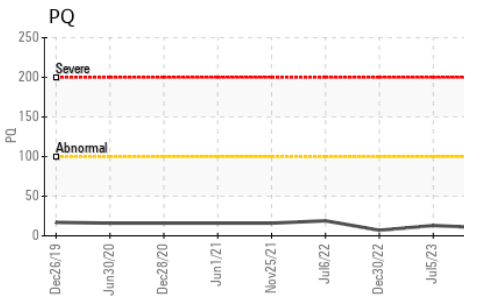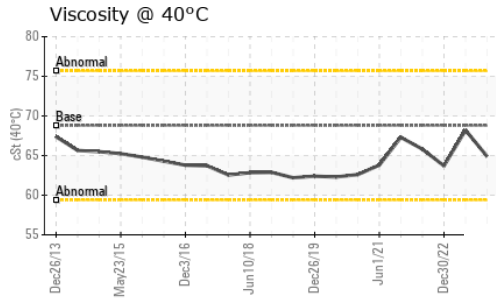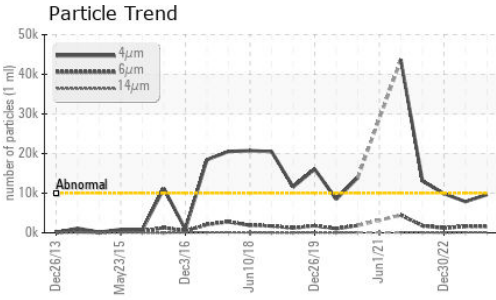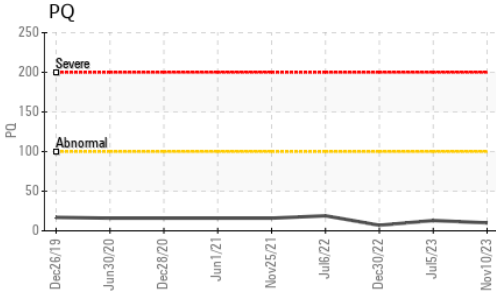






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.8	64.9	68.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

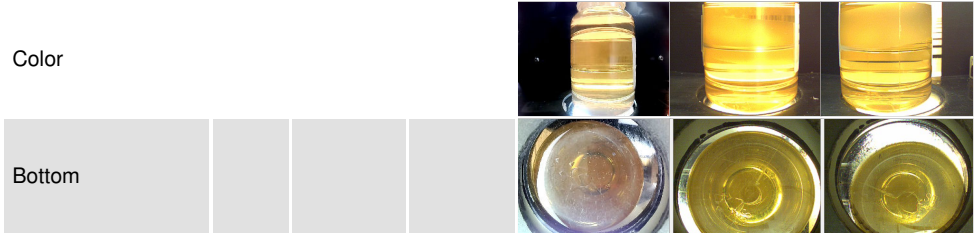

## GRAPHS

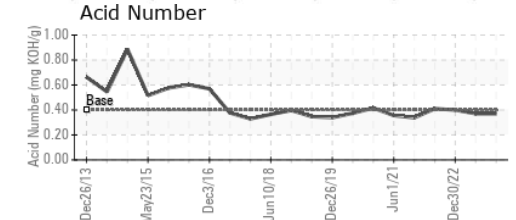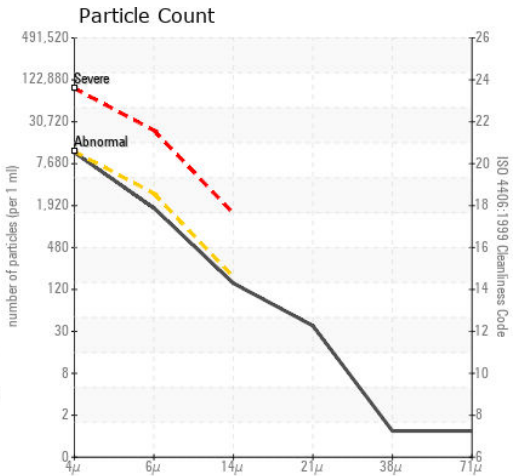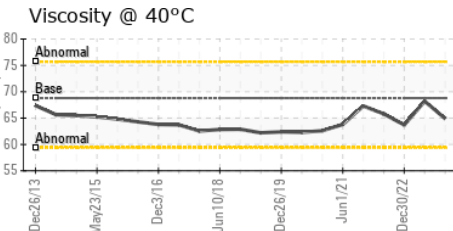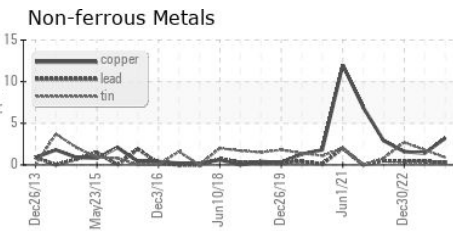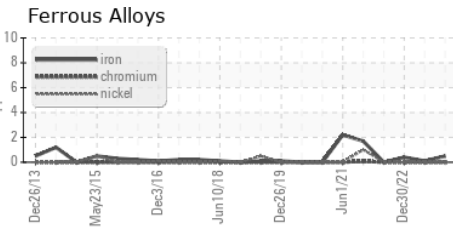

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0838840 **Received** : 16 Nov 2023  
**Lab Number** : 06009518 **Diagnosed** : 19 Nov 2023  
**Unique Number** : 10743280 **Diagnostician** : Don Baldrige

**BRIDGESTONE FIRESTONE - DES MOINES**  
 4600 NW 2ND AVE  
 DES MOINES, IA  
 US 50313  
 Contact: SCOTT CARTER  
 CarterScottA@FirestoneAg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:  
F: x: