




# PROBLEM SUMMARY

## Sample Rating Trend


ISO

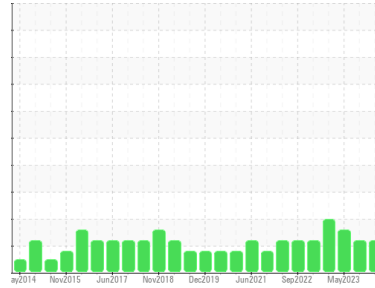

Area  
**412**  
 Machine Id  
**622 BANBURY MOTOR**  
 Component  
**Outboard Journal Bearing**  
 Fluid  
**ESSO NUTO H ISO 68 (1 QTS)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

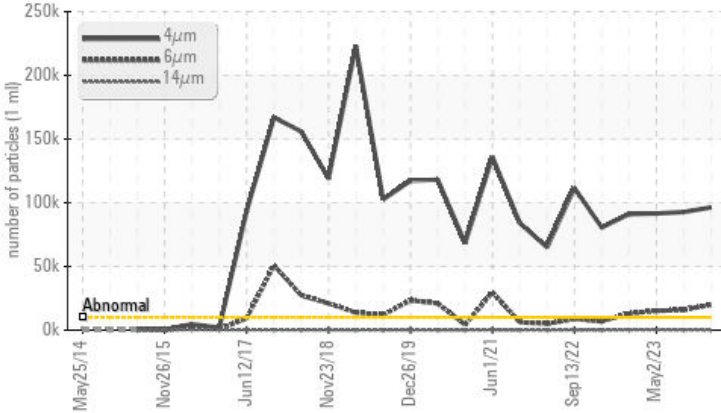

## RECOMMENDATION

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>10000	▲ 96332	▲ 92740	▲ 91554
Particles >6µm	ASTM D7647	>2500	▲ 19999	▲ 15784	▲ 15157
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 24/21/14	▲ 24/21/14	▲ 24/21/15

Customer Id: BRIDES  
 Sample No.: WC0838937  
 Lab Number: 06009526  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 05 Jul 2023 Diag: Angela Borella

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 02 May 2023 Diag: Angela Borella

ISO



Check seals and/or filters for points of contaminant entry. Inspect/change air breather if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 09 Apr 2023 Diag: Don Baldrige

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

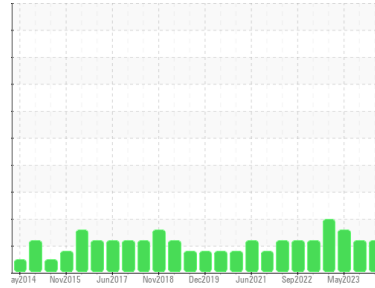

ISO



Area  
**412**  
 Machine Id  
**622 BANBURY MOTOR**  
 Component  
**Outboard Journal Bearing**  
 Fluid  
**ESSO NUTO H ISO 68 (1 QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0838937</b>	WC0640600	WC0640616
Sample Date	Client Info		<b>10 Nov 2023</b>	05 Jul 2023	02 May 2023
Machine Age	mths	Client Info	<b>6</b>	6	1
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	Changed	Not Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>8</b>	7	13
Iron	ppm	ASTM D5185m >60	<b>&lt;1</b>	<1	0
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >250	<b>&lt;1</b>	2	0
Copper	ppm	ASTM D5185m >125	<b>5</b>	8	2
Tin	ppm	ASTM D5185m >80	<b>5</b>	8	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>6</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m 50	<b>49</b>	44	37
Phosphorus	ppm	ASTM D5185m 330	<b>322</b>	330	308
Zinc	ppm	ASTM D5185m 420	<b>405</b>	423	373
Sulfur	ppm	ASTM D5185m 3100	<b>3210</b>	2828	2482

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>3</b>	3	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	0






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 96332</b>	▲ 92740	▲ 91554
Particles >6µm	ASTM D7647	>2500	<b>▲ 19999</b>	▲ 15784	▲ 15157
Particles >14µm	ASTM D7647	>160	<b>156</b>	136	▲ 304
Particles >21µm	ASTM D7647	>40	<b>14</b>	14	47
Particles >38µm	ASTM D7647	>10	<b>1</b>	0	3
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>▲ 24/21/14</b>	▲ 24/21/14	▲ 24/21/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 .40	<b>0.37</b>	0.37	0.41


# OIL ANALYSIS REPORT

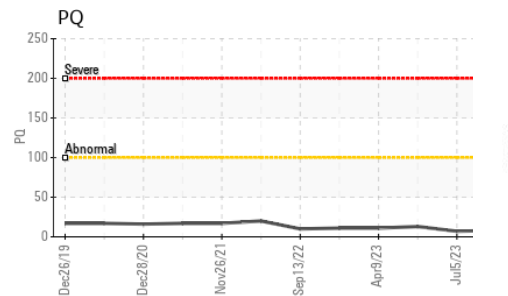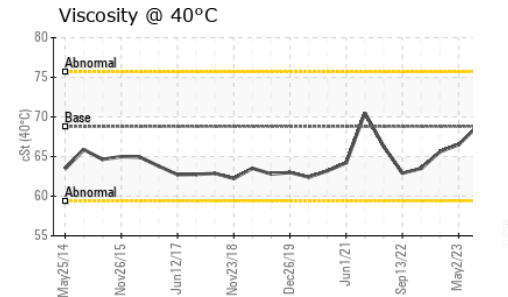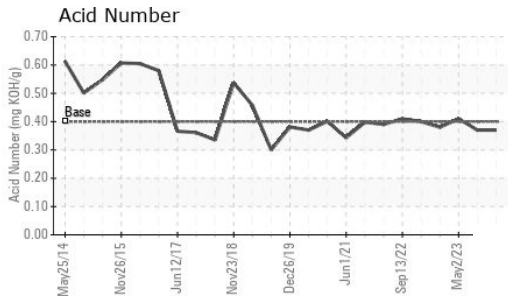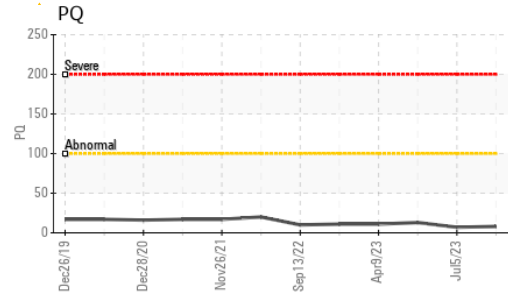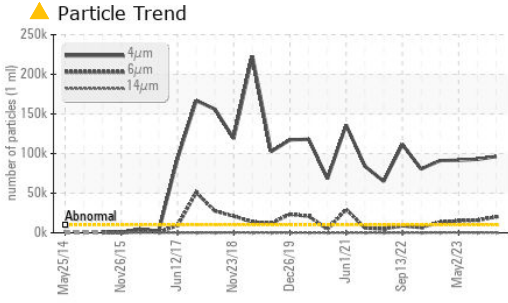






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.8	67.9	68.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

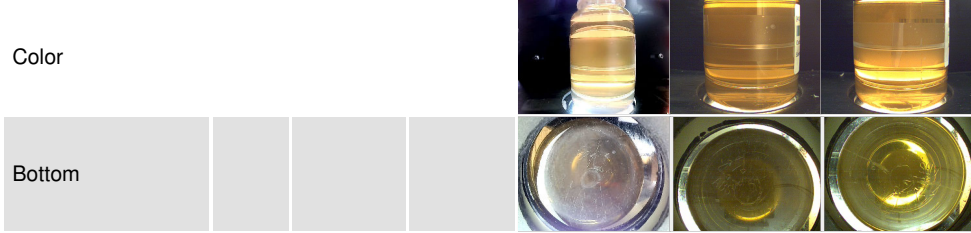

## GRAPHS

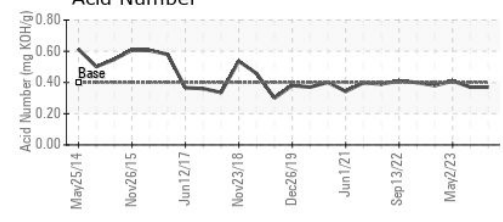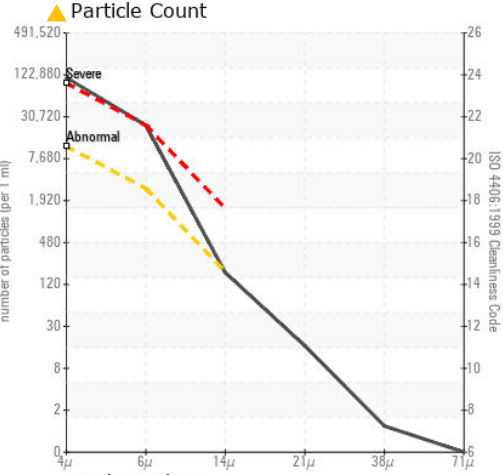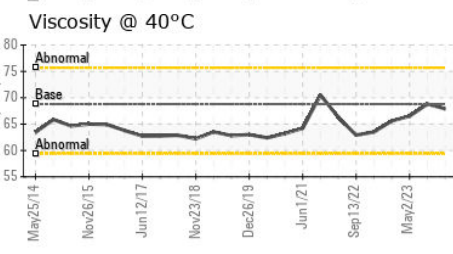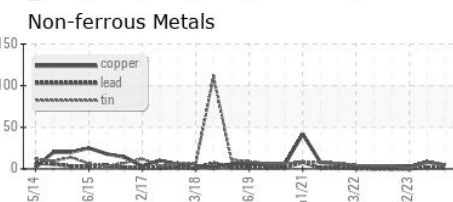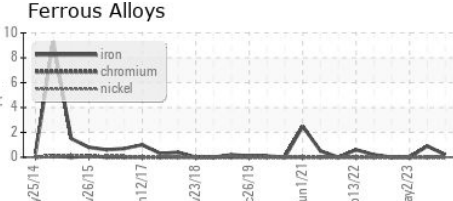

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0838937 **Received** : 16 Nov 2023  
**Lab Number** : 06009526 **Diagnosed** : 19 Nov 2023  
**Unique Number** : 10743288 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount )

**BRIDGESTONE FIRESTONE - DES MOINES**  
 4600 NW 2ND AVE  
 DES MOINES, IA  
 US 50313  
 Contact: SCOTT CARTER  
 CarterScottA@FirestoneAg.com  
 T: x:  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)