




PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
426
 Machine Id
426 STRIP STACKER
 Component
Outboard Journal Bearing
 Fluid
ESSO NUTO H ISO 68 (1 QTS)

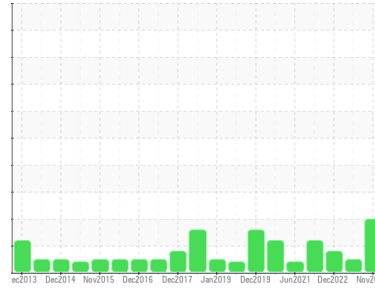

COMPONENT CONDITION SUMMARY

▲ Particle Trend

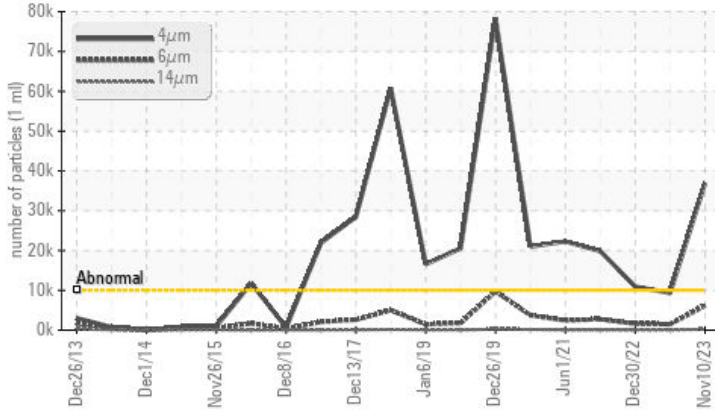

RECOMMENDATION

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | ASTM D7647 | | ABNORMAL | NORMAL | ATTENTION |
|-----------------|--|--------------|-----------|------------|----------|------------|
| Particles >4µm | | ASTM D7647 | >10000 | ▲ 36875 | 9311 | ▲ 10920 |
| Particles >6µm | | ASTM D7647 | >2500 | ▲ 6134 | 1492 | 1615 |
| Particles >14µm | | ASTM D7647 | >160 | ▲ 213 | 49 | 30 |
| Particles >21µm | | ASTM D7647 | >40 | ▲ 44 | 10 | 3 |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/14 | ▲ 22/20/15 | 20/18/13 | ▲ 21/18/12 |

Customer Id: BRIDES
 Sample No.: WC0838859
 Lab Number: 06009535
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

05 Jul 2023 Diag: Angela Borella

NORMAL



No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Dec 2022 Diag: Angela Borella

ISO



No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



06 Jul 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

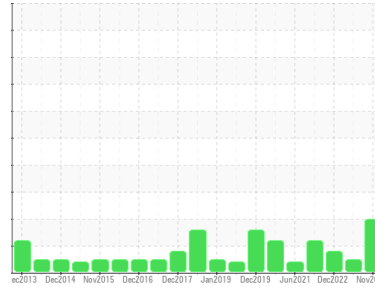

ISO



Area
426
Machine Id
426 STRIP STACKER
Component
Outboard Journal Bearing
Fluid
ESSO NUTO H ISO 68 (1 QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0838859 | WC0397540 | WC0640529 |
| Sample Date | Client Info | | 10 Nov 2023 | 05 Jul 2023 | 30 Dec 2022 |
| Machine Age | mths | Client Info | 6 | 0 | 6 |
| Oil Age | mths | Client Info | 0 | 6 | 0 |
| Oil Changed | Client Info | | Changed | Changed | Changed |
| Sample Status | | | ABNORMAL | NORMAL | ATTENTION |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|------------|------------------|--------------|----------|----------|
| PQ | ASTM D8184 | | 11 | 12 | 15 |
| Iron | ppm | ASTM D5185m >60 | <1 | <1 | <1 |
| Chromium | ppm | ASTM D5185m >20 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >20 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >4 | <1 | <1 | 0 |
| Lead | ppm | ASTM D5185m >250 | <1 | <1 | <1 |
| Copper | ppm | ASTM D5185m >125 | 2 | 2 | 2 |
| Tin | ppm | ASTM D5185m >80 | 3 | 2 | 2 |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|------------------|-------------|----------|----------|
| Boron | ppm | ASTM D5185m 0 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m 0 | 7 | 0 | 1 |
| Molybdenum | ppm | ASTM D5185m 0 | 0 | 0 | <1 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m 5 | 1 | 0 | 2 |
| Calcium | ppm | ASTM D5185m 50 | 43 | 44 | 50 |
| Phosphorus | ppm | ASTM D5185m 330 | 319 | 324 | 337 |
| Zinc | ppm | ASTM D5185m 420 | 385 | 428 | 441 |
| Sulfur | ppm | ASTM D5185m 3100 | 2718 | 2615 | 2597 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >50 | 3 | 2 | 3 |
| Sodium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185m >20 | <1 | <1 | <1 |


FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-------------------|----------|------------|
| Particles >4µm | ASTM D7647 | >10000 | ▲ 36875 | 9311 | ▲ 10920 |
| Particles >6µm | ASTM D7647 | >2500 | ▲ 6134 | 1492 | 1615 |
| Particles >14µm | ASTM D7647 | >160 | ▲ 213 | 49 | 30 |
| Particles >21µm | ASTM D7647 | >40 | ▲ 44 | 10 | 3 |
| Particles >38µm | ASTM D7647 | >10 | 2 | 1 | 1 |
| Particles >71µm | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >20/18/14 | ▲ 22/20/15 | 20/18/13 | ▲ 21/18/12 |


FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 .40 | 0.37 | 0.37 | 0.38 |


Particle Trend

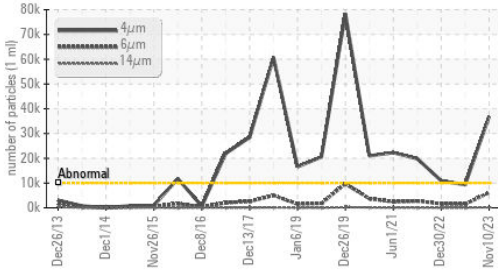


PQ

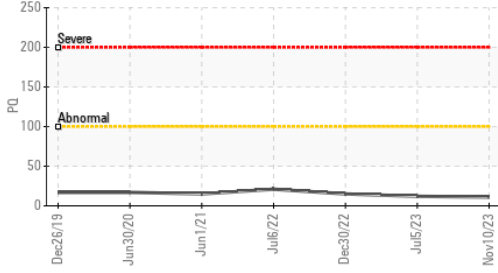


Acid Number

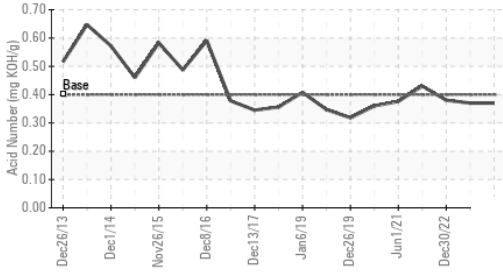

Viscosity @ 40°C

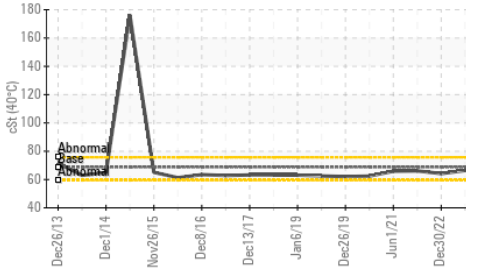


PQ

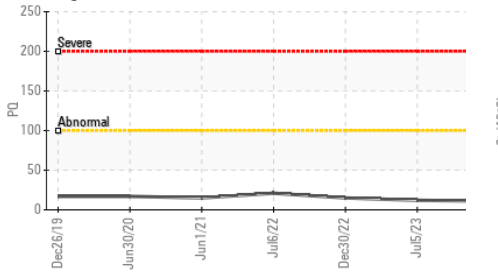

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 68.8 | 66.4 | 64.2 |

SAMPLE IMAGES

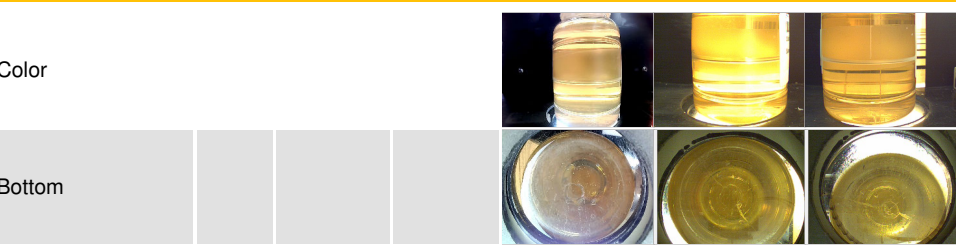


GRAPHS


Ferrous Alloys

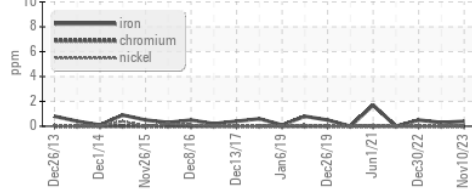


Non-ferrous Metals

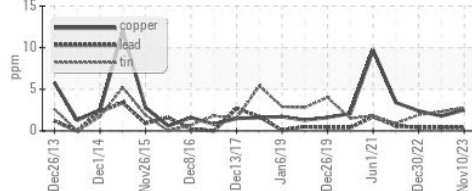


Viscosity @ 40°C

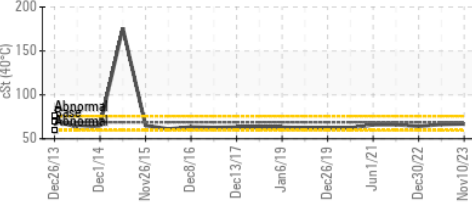

Particle Count

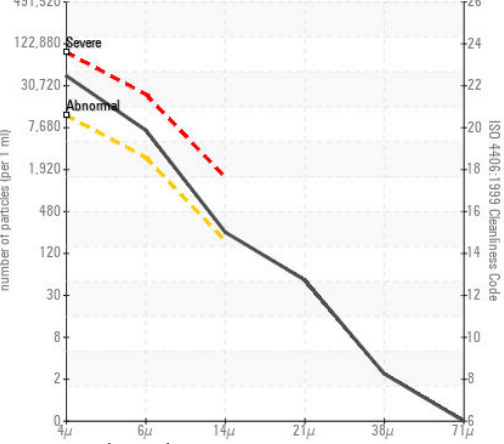

Acid Number

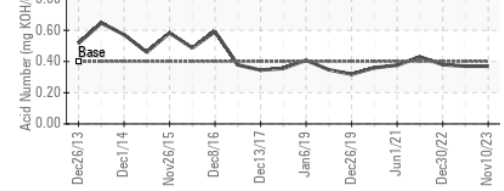

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0838859 **Received** : 16 Nov 2023
Lab Number : 06009535 **Diagnosed** : 19 Nov 2023
Unique Number : 10743297 **Diagnostician** : Don Baldrige

BRIDGESTONE FIRESTONE - DES MOINES
 4600 NW 2ND AVE
 DES MOINES, IA
 US 50313
 Contact: SCOTT CARTER
 CarterScottA@FirestoneAg.com

Test Package : IND 2 (Additional Tests: PQ, PrtCount)
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
 F: x: